NFPA



www.fire-gas.com

Standard on Halon 1301 Fire Extinguishing Systems

2022





مدرس ، طراح و مشاور سیستم های (آتش نشانی ، تهویه ، اگزاست و فشار مثبت)

دارای صلاحیت سازمان آتش نشانی


اخذ تاییده از سازمان آتش نشانی



اولین هند بوک سیستم اطفاء حریق و مدیریت دود در ایران



Handbook of Smoke Control Engineering





طراحی سیستم های اگزاست و تهویه پارکینگ ، فشار مثبت راه پله - اَسانسور واَتریوم ها











نرم افزار انتخاب فن، دمپرهای دود و آتش Sodeca Quick Fan & RF Damper





برای دریافت اطلاعات بیشتر کد روبرو را اسکن کنید



www.fire-gas.com



Aparat/fire-gas.com



02634411758



00989123280127

البرز گوهردشت خ۱۲ شرقی پ۸ ط اول واحد ۲















IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides ("NFPA Standards"), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides ("NFPA Standards") should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the "Codes & Standards" section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides ("NFPA Standards") should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the "Codes & Standards" section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards ("the ANSI Patent Policy"), and hereby gives the following notice pursuant to that policy:

NOTICE: The user's attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term "adoption by reference" means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2021 National Fire Protection Association®. All Rights Reserved.

NFPA® 12A

Standard on

Halon 1301 Fire Extinguishing Systems

2022 Edition

This edition of NFPA 12A, *Standard on Halon 1301 Fire Extinguishing Systems*, was prepared by the Technical Committee on Gaseous Fire Extinguishing Systems. It was issued by the Standards Council on December 10, 2020, with an effective date of December 30, 2020, and supersedes all previous editions.

This edition of NFPA 12A was approved as an American National Standard on December 30, $9090\,$

Origin and Development of NFPA 12A

The Committee on Halogenated Fire Extinguishing Systems was formed in the fall of 1966 and held its first meeting during December of that year. The Committee was organized into four Subcommittees who separately prepared various portions of the standard for review by the full Committee at meetings held in September and December of 1967.

The standard was submitted and adopted at the NFPA Annual Meeting in Atlanta, Georgia, May 20–24, 1968. The 1968 edition was the first edition of this standard and was adopted in tentative form in accordance with NFPA regulations. In 1969 the Committee determined that the standard had not yet been sufficiently tested and elected to carry it in tentative status for one more year. It was presented for official adoption in 1970. The first official version of the standard was adopted at the NFPA Annual Meeting in Toronto, Ontario, in May 1970. Revisions were made in 1972, 1973, 1977, and 1980.

The 1985 edition was a complete revision of the standard. The standard was revised in 1987 and again in 1989.

The standard was completely rewritten for the 1992 edition to state the requirements more clearly and to separate the mandatory requirements from the advisory text in an effort to make the document more usable, enforceable, and adoptable. The main topic addressed in the revision was the decommissioning and removal of systems.

The standard was updated to conform to the Manual of Style for NFPA Technical Committee Documents for the 2004 edition.

For the 2009 edition, the standard was revised to address testing and recharging of Halon 1301 cylinders.

The 2015 edition incorporated support for electronic storage of system maintenance records.

For the 2018 edition, the annex chapter on nozzle and piping calculations (Annex H) was revised to correct errors, comply with the *Manual of Style for NFPA Technical Committee Documents*, and clarify the details of the procedure.

The 2022 edition is a partial revision that incorporates several clarifications and corrections. The requirements for cylinder requalification have been updated to establish better agreement with Code of Federal Regulations Title 49, "Transportation," and a recommendation to follow the HRC Code of Practice for Halon Reclaiming Companies has been added.

Foreword

Halon 1301 (bromotrifluoromethane, or CBrF3) is a colorless, odorless, electrically nonconductive gas that is an effective medium for extinguishing fires. Halon 1301 is included in the Montreal Protocol on Substances That Deplete the Ozone Layer signed September 16, 1987. The

protocol permits continued availability of halogenated fire extinguishing agents at 1986 production levels. That protocol, and subsequent amendments, restrict the production of this agent. In addition, local jurisdictions within some countries (e.g., the EPA in the United States) have enacted further rules regulating the production, use, handling, and disposal of this agent. The user of this standard is advised to consult local authorities for current regulations. Halon 1301 fire extinguishing systems are useful within the limits of this standard in extinguishing fires in specific hazards or equipment and in occupancies where an electrically nonconductive medium is essential or desirable, or where cleanup of other media presents a problem.

Technical Committee on Gaseous Fire Extinguishing Systems

Brent S. Ehmke, Chair Ehmke Associates, TX [SE]

William J. Cary, Secretary Aon Risk Solutions, AZ [I]

Katherine Adrian, Johnson Controls, WI [M]

Paul Anastasia, American International Group, Inc. (AIG), MA [I]

Oded Aron, Port Authority of New York & New Jersey, NY [U]

Jesse Cecil, Fire King LLC., TX [IM]

Todd A. Dillon, AXA XL/Global Asset Protection Services, LLC, OH [1]

William A. Froh, US Department of Energy, MD [U]

Raymond N. Hansen, US Department of the Air Force, FL [E]

Jeffrey L. Harrington, Harrington Group, Inc., GA [SE]

Mark E. Herzog, The Hiller Companies, AL [IM]

Scott A. Hill, JENSEN HUGHES, MD [SE]

Rep. JENSEN HUGHES

Steven Hodges, Alion Science And Technology, CA [U]

Giuliano Indovino, North American Fire Guardian Technology, Inc., Italy [M]

Robert Kasiski, FM Global, RI [I]

Norbert W. Makowka, National Association of Fire Equipment Distributors, IL [IM]

Rep. National Association of Fire Equipment Distributors

Charles O. Bauroth, Liberty Mutual, MA [I]

(Alt. to Matt Pognant)

Andrew S. Carmean, US Department of Airforce, FL [E] (Alt. to Raymond N. Hansen)

Thomas A. Downey, Marsh Risk Consulting, CT [I] (Voting Alt.)

Justin Lee Espinosa, BP Alaska, AK [U]

(Alt. to Michael Lee Moberly)

Mark E. Fessenden, Johnson Controls, WI [M]

(Alt. to Katherine Adrian)

Eric W. Forssell, JENSEN HUGHES, MD [SE]

(Alt. to Scott A. Hill)

Kevin Holly, Jr., UL LLC, IL [RT]

(Alt. to Blake M. Shugarman)

Daniel J. Hubert, Amerex/Janus Fire Systems, IN [M] (Voting Alt.)

Jessica A. Hubert, Guardian Services Inc., IL [SE] (Alt. to Thomas J. Wysocki)

Jonathan G. Ingram, Carrier/Kidde-Fenwal, Inc., MA [M] (Alt. to K. Fred Penden)

Jeffrey S. Kidd, The Hiller Companies, MA [IM] (Alt. to Mark E. Herzog)

Jeffrey Allen McKendree, Harrington Group Inc., GA [SE] (Alt. to Jeffrey L. Harrington)

Ingeborg Schlosser, VdS Schadenverhuetung, Germany [I]

Bella A. Maranion, US Environmental Protection Agency, DC [E]

Justin D. Merrick, S&S Sprinkler Company, LLC, AL [M]

Rep. Automatic Fire Alarm Association, Inc.

Michael Lee Moberly, BP Upstream Engineering Center, TX [U]

Mohamed Mushantat, PLC Fire Safety Solutions, Canada [SE]

K. Fred Penden, United Technologies, MA [M]

Matt Pognant, Liberty Mutual Property, GA [I]

Konstantin A. Pokrovski, Honeywell International, Inc., NY [M]

James R. Richardson, Lisle Woodridge Fire District, IL [E]

Paul E. Rivers, 3M Scott Safety, MN [M]

Mark L. Robin, Chemours, DE [M]

Sarah Rodino, US Coast Guard, DC [E]

Joseph A. Senecal, Firemetrics, MA [SE]

Blake M. Shugarman, UL LLC, IL [RT]

Brad T. Stilwell, Fike Corporation, MO [M]

Robert T. Wickham, Wickham Associates, NH [SE]

Thomas J. Wysocki, Guardian Services, Inc., IL [SE]

Alternates

Joanna Minion, Honeywell, NJ [M]

(Alt. to Konstantin A. Pokrovski)

John G. Owens, 3M Company, MN [M]

(Alt. to Paul E. Rivers)

Emma Palumbo, North American Fire Guardian Technology, Inc./

Safety Hi-Tech, Italy [M]

(Alt. to Giuliano Indovino)

Sean Ramsey, US Coast Guard, DC [E]

(Alt. to Sarah Rodino)

Margaret A. Sheppard, US Environmental Protection Agency, DC

(Alt. to Bella A. Maranion)

Grant Smith, Fike Corporation, MO [M]

(Alt. to Brad T. Stilwell)

Raymond A. Stacy, FM Approvals, MA [I]

(Alt. to Robert Kasiski)

Alfred J. Thornton, The Chemours Company, DE [M]

(Alt. to Mark L. Robin)

Todd W. VanGorder, Silco Fire & Security, OH [IM]

(Alt. to Norbert W. Makowka)

Tom Zornes, Siemens, IN [M]

(Alt. to Justin D. Merrick)

Nonvoting

Fernando Vigara, APICI, Spain [SE]

Barry D. Chase, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This committee shall have primary responsibility for documents on the installation, maintenance, and use of carbon dioxide systems for fire protection.

This committee shall also have primary responsibility for documents on fixed fire extinguishing systems utilizing bromotrifluoromethane and other similar halogenated extinguishing agents, covering the installation, maintenance, and use of systems.

This committee shall also have primary responsibility for documents on alternative protection options to Halon 1301 and 1211 fire extinguishing systems. It shall not deal with design, installation, operation, testing, and maintenance of systems employing dry chemical, wet chemical, foam, aerosols, or water as the primary extinguishing media.

CONTENTS 12A-5

Contents

Chapter	1 Administration	12A – 6	Chapter 6	Inspection, Maintenance, Testing, and	
1.1	Scope	12A – 6	2011412	Training	12A- 13
1.2	Purpose.	12A – 6	6.1 I	nspection and Tests	12A- 13
1.3	Units	12A – 6	6.2	Container Test	12A- 13
1.4	Use and Limitations.	12A – 6	6.3 F	Iose Test	12A- 13
1.5	Safety.	12A- 7	6.4 E	Inclosure Inspection	12A- 14
	100 100		6.5 N	faintenance	12A- 14
Chapter		12 A – 7	6.6 T	raining	12A- 14
2.1	General.	12A- 7	6.7 A	approval of Installations	12A- 14
2.2	NFPA Publications.	12A- 7			
2.3	Other Publications.	12A- 7	Annex A	Explanatory Material	12A - 16
2.4	References for Extracts in Mandatory Sections.	12A– 7	Annex B	Enclosure Integrity Procedure	12A - 20
Chapter	3 Definitions	12A- 7		VEST MACH	
3.1	General.	12A- 7	Annex C	Halogenated Extinguishing Agents	12A - 31
3.2	NFPA Official Definitions	12A-8	Annex D	Hazards to Personnel	12A - 34
3.3	General Definitions	12A-8	Aillex D	Trazarus to 1 ersonner	14A- 34
Chapter	4 Components	12A – 8	Annex E	Storage Containers	12A – 35
4.1	Halon 1301 Supply	12A-8	Annex F	Piping	12A- 39
4.2	Distribution.	12A – 9		-1-3	
4.3	Detection, Actuation, Alarm, and Control		Annex G	System Flow Calculations	12A- 40
	Systems.	12A – 10	Annex H	Nozzles	12A – 43
Chapter	5 System Design	12A-11			
5.1	Specifications, Plans, and Approvals	12A-11	Annex I	Fire Extinguishment	12A- 57
5.2	System Flow Calculations.	12A-11	Name and T	Surface Fires	104 50
5.3	Enclosure.	12A-11	Annex J	Surface Fires	12A – 59
5.4	Design Concentration Requirements	12A – 12	Annex K	Total Flooding Quantity	12A - 60
5.5	Determination of Halon 1301 Quantity for		immer ii	Total Floorang Summer,	14.1
	Total Flooding Systems	12A – 12	Annex L	Approval of Installations	12A- 63
5.6	Altitude Adjustments	12A – 13			
5.7	Distribution System.	12A – 13	Annex M	Informational References	12A – 65
5.8	Nozzle Choice and Location	12A – 13	Indov		194 67

NFPA 12A

Standard on

Halon 1301 Fire Extinguishing Systems

2022 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Standards." They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the "List of NFPA Codes & Standards" at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex M.

Chapter 1 Administration

- **1.1 Scope.** This standard contains minimum requirements for total flooding Halon 1301 fire extinguishing systems. It includes only the essentials necessary to make the standard workable in the hands of those skilled in this field. Only those skilled in this work are competent to design, install, maintain, decommission, and remove this equipment. It might be necessary for many of those charged with purchasing, inspecting, testing, approving, operating, and maintaining this equipment to consult with an experienced and competent fire protection engineer to effectively discharge their respective duties. (*See Annex C.*)
- 1.2 Purpose. This standard is prepared for the use and guidance of those charged with purchasing, designing, installing, testing, inspecting, approving, listing, operating, maintaining, decommissioning, and removing halogenated agent extinguishing systems (Halon 1301), so that such equipment will function as intended throughout its life. Nothing in this standard is intended to restrict new technologies or alternate arrangements provided the level of safety prescribed by this standard is not lowered.

1.2.1 Pre-engineered systems (packaged systems) consist of system components designed to be installed according to pretested limitations as approved or listed by a testing laboratory. Pre-engineered systems sometimes incorporate special nozzles, flow rates, methods of application, nozzle placement, and pressurization levels that sometimes differ from those detailed elsewhere in this standard. All other requirements of the standard shall apply. Pre-engineered systems shall be installed to protect hazards within the limitations that have been established by the testing laboratories where listed.

1.3 Units

- **1.3.1** Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). Two units (liter and bar), outside of but recognized by SI, are commonly used in international fire protection. These units are listed in Table 1.3.1 with conversion factors.
- 1.3.2* If a value for measurement as given in this standard is followed by an equivalent value in other units, the first stated shall be regarded as the requirement. A given equivalent value is often approximate.

1.4 Use and Limitations.

- **1.4.1** Total flooding Halon 1301 fire extinguishing systems are used primarily to protect hazards that are in enclosures or equipment that, in itself, includes an enclosure to contain the agent. Some typical hazards that shall be permitted to use Halon 1301 are as follows:
- (1) Electrical and electronic hazards
- (2) Telecommunications
- (3) Flammable and combustible liquids and gases
- (4) Other high value assets
- **1.4.2** Halon 1301 shall not be used on the following:
- Certain chemicals or mixtures of chemicals such as cellulose nitrate and gunpowder, which are capable of rapid oxidation in the absence of air
- Reactive metals such as sodium, potassium, magnesium, titanium, zirconium, uranium, and plutonium
- (3) Metal hydrides
- (4) Chemicals capable of undergoing autothermal decomposition, such as certain organic peroxides and hydrazine
- 1.4.3* Electrostatic charging of nongrounded conductors can occur during the discharge of liquefied gases. These conductors can discharge to other objects, causing an electric arc of sufficient energy to initiate an explosion.
- **1.4.4*** Where halon systems are used, a fixed enclosure shall be provided about the hazard that is adequate to enable the specified concentration to be achieved and maintained for the specified period of time.

Table 1.3.1 Metric Conversion Factors

Name of Unit	Unit	Conversion Factor
Liter	L	1 gal = 3.785 L
Cubic decimeter	dm^3	$1 \text{ gal} = 3.785 \text{ dm}^3$
Pascal	Pa	1 psi = 6894.757 Pa
Bar	bar	1 psi = 0.0689 bar
Bar	bar	$1 \text{ bar} = 10^5 \text{ Pa}$

DEFINITIONS 12A-7

- **1.4.5** Halon 1301 shall be used only in enclosures where ambient temperatures are between -70° F and 900° F (-57° C and 482° C). (See Annex D.)
- **1.4.6 Duration of Protection.** An effective agent concentration shall be achieved and maintained for a sufficient period of time to allow effective emergency action by trained personnel. This is equally important in all classes of fires since a persistent ignition source (e.g., an arc, heat source, oxyacetylene torch, or "deep-seated" fire) can lead to a recurrence of the initial event once the agent has dissipated. Halon 1301 extinguishing systems normally provide protection for a period of minutes, but are exceptionally effective for certain applications.

1.5 Safety.

- 1.5.1 Hazards to Personnel. (See Annex D.)
- **1.5.1.1 Unnecessary Exposure.** Unnecessary exposure to Halon 1301 and its decomposition products shall be avoided. Exposure to high concentrations or for prolonged periods can produce dizziness, impaired coordination, and disturbances in cardiac rhythm.
- **1.5.1.2* Safety Requirements.** Suitable safeguards shall be provided to ensure prompt evacuation and prevent entry into hazardous atmospheres and also to provide means for prompt rescue of any trapped personnel. Safety items such as personnel training, warning signs, discharge alarms, and self-contained breathing equipment shall be considered.
- **1.5.2 Electrical Clearances.** All system components shall be located to maintain no less than minimum clearances from live electrical parts. The following references shall be considered as the minimum electrical clearance requirements for the installation of Halon 1301 systems:
- (1) ANSI/IEEE C2
- (2) NFPA 70
- (3) 29 CFR 1910, Subpart S
- **1.5.2.1** When the design basic insulation level (BIL) is not available and when nominal voltage is used for the design criteria, the highest minimum clearance listed for this group shall be used.
- 1.5.3* Decommissioning and Removal of Systems. Personnel who are to decommission and remove systems or are to handle system equipment shall be thoroughly trained and competent in safe procedures.

Chapter 2 Referenced Publications

- **2.1 General.** The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.
- **2.2 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 70[®], National Electrical Code[®], 2020 edition. NFPA 72[®], National Fire Alarm and Signaling Code[®], 2019 edition.

2.3 Other Publications.

2.3.1 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

ASME B1.20.1, Standard on Pipe Threads, General Purpose, Inch, 2013.

ASME B31.1, Power Piping Code, 2016.

Boiler and Pressure Vessel Code, 2017.

2.3.2 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM A120, Specification for Pipe, Steel, Black and Hot-Dipped Zinc-Coated (Galvanized) Welded and Seamless for Ordinary Uses, 1984 (withdrawn 1987).

ASTM D5632/D5632M, Standard Specification for Halon 1301, Bromotrifluoromethane (CF_7Br), 2012.

2.3.3 CGA Publications. Compressed Gas Association, 14501 George Carter Way, Suite 103, Chantilly, VA 20151-2923.

CGA C-6, Standard for Visual Inspection of Steel Compressed Gas Cylinders, 2013.

2.3.4 IEEE Publications. IEEE, 3 Park Avenue, 17th Floor, New York, NY 10016-5997.

ANSI/IEEE C2, National Electrical Safety Code, 2017.

2.3.5 ULC Publications. ULC Publications. ULC Standards, 17 Nepean Street, Suite 400, Ottawa, Ontario K2P0B4, Canada.

CAN/ULC S524, Installation of Fire Alarm Systems, 2014, reaffirmed 2016.

CAN/ULC S529, Smoke Detectors for Fire Alarm Systems, 2016.

2.3.6 US Government Publications. US Government Publishing Office, 732 North Capitol Street, NW, Washington, DC 20401-0001.

Title 29, Code of Federal Regulations, Part 1910, Subpart S.

Title 49, Code of Federal Regulations.

2.3.7 Other Publications.

Coll, John P., "Inerting Characteristics of Halon 1301 and 1211 with Various Combustibles," Fenwal Inc., Report PSR 661, July 16, 1976.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections. (Reserved)

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

- 3.2.1* Approved. Acceptable to the authority having jurisdiction.
- **3.2.2*** Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.
- **3.2.3* Listed.** Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.
- **3.2.4 Shall.** Indicates a mandatory requirement.
- **3.2.5 Should.** Indicates a recommendation or that which is advised but not required.
- **3.2.6 Standard.** An NFPA Standard, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase "standards development process" or "standards development activities," the term "standards" includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

3.3 General Definitions.

- **3.3.1 Clearance.** The air distance between Halon 1301 equipment, including piping and nozzles, and unenclosed or uninsulated live electrical components at other than ground potential.
- **3.3.2 Filling Density.** The number of pounds of Halon 1301 per cubic foot of container volume.
- **3.3.3* Normally Occupied Area.** One that is intended for occupancy.

Chapter 4 Components

4.1 Halon 1301 Supply.

4.1.1 Quantities.

- **4.1.1.1** The amount of Halon 1301 in the system shall be at least sufficient for the largest single hazard protected or group of hazards that are to be protected simultaneously.
- **4.1.1.2** Where required, the reserve quantity shall be as many multiples of these minimum amounts as the authority having jurisdiction considers necessary. The time needed to obtain Halon 1301 for replenishment to restore systems to operating conditions shall be considered a major factor in determining the reserve supply needed.

- **4.1.1.3** Where uninterrupted protection is required, both primary and reserve supply shall be permanently connected to the distribution piping and arranged for easy changeover.
- **4.1.2* Quality.** Halon 1301 shall comply with the requirements of either Table 4.1.2 or ASTM D5632/D5632M.

4.1.3 Storage Container Arrangement.

- **4.1.3.1** Storage containers and accessories shall be so located and arranged that inspection, testing, recharging, and other maintenance is facilitated and interruption of protection is held to a minimum.
- **4.1.3.2** Storage containers shall be located as close as possible to the hazard or hazards they protect but shall not be exposed to a fire in a manner likely to impair system performance.
- **4.1.3.3** Storage containers shall not be located where they are likely to be subject to severe weather conditions or mechanical, chemical, or other damage. Where excessive climatic or mechanical exposures are expected, suitable safeguards or enclosures shall be provided.
- **4.1.3.4** Storage containers shall be securely mounted per the manufacturer's listed or approved installation manual. This shall include mounting the container to the appropriate mounting surface.

4.1.4 Storage Containers. (See Annex E.)

- **4.1.4.1** The Halon 1301 supply shall be stored in containers designed to hold Halon 1301 in liquefied form at ambient temperatures.
- **4.1.4.2** Containers shall not be charged to a filling density greater than 70 lb/ft³ (1121 kg/m³).
- **4.1.4.3** Containers shall be superpressurized with dry nitrogen to 360 psi \pm 5 percent or 600 psi \pm 5 percent gauge pressure at 70°F (2482 kPa \pm 5 percent or 4137 kPa \pm 5 percent gauge pressure at 21°C).
- **4.1.4.4** Listed pre-engineered systems shall not be required to comply with 4.1.4.3.
- **4.1.4.5** Each container shall have a permanent nameplate specifying the agent, tare, and gross weight in addition to the superpressurization level. A label that will require the proper return of the agent shall be affixed to all new and existing

Table 4.1.2 Requirements for Halon 1301 (Bromotrifluoromethane)

Property	Requirement
Bromotrifluoromethane, mole percent, minimum	99.6
Other halocarbons, mole percent, maximum	0.4
Acidity, ppm (by weight), maximum	3.0
Water content, percent by weight, maximum	0.001
Boiling point, °C at 760 mm Hg	-57.75
Boiling range, °C, 5 to 85 percent distilled	0.3
High boiling impurities, grams/100 ml, maximum	0.05
Suspended matter or sediment	None visible

COMPONENTS 12A-9

containers. Filled containers shall be returned for recycling or recovery of the agent when no longer needed.

- **4.1.4.6** If used as shipping containers, the Halon 1301 containers used in these systems shall be designed to meet the requirements of the US Department of Transportation or the Canadian Transport Commission. If not used as shipping containers, they shall be designed, fabricated, inspected, certified, and stamped in accordance with ASME *Boiler and Pressure Vessel Code*.
- **4.1.4.7** The design pressure shall be suitable for the maximum pressure developed at 130°F (55°C) or at the maximum controlled temperature limit.
- **4.1.4.8** A reliable means of indication shall be provided to determine the pressure in refillable containers. The means of indication shall account for variation of container pressure with temperature.
- **4.1.4.9** When manifolded, containers shall be adequately mounted and suitably supported in a rack that provides for convenient individual servicing or content weighings. Automatic means shall be provided to prevent agent loss from the manifold if the system is operated when any containers are removed for maintenance.
- **4.1.4.10** In a multiple cylinder system, all cylinders supplying the same manifold outlet for distribution of agent shall be interchangeable and of one select size and charge.
- **4.1.4.11** Storage temperatures shall not exceed 130°F (55°C) nor be less than –20°F (–29°C) for total flooding systems unless the system is designed for proper operation with storage temperatures outside this range. External heating or cooling shall be used to keep the temperature of the storage container within desired ranges.

4.2 Distribution.

4.2.1* Piping.

- **4.2.1.1** Piping shall be of noncombustible material having physical and chemical characteristics such that its integrity under stress can be predicted with reliability. Special corrosion-resistant materials or coatings shall be required in severely corrosive atmospheres. The thickness of the pipe wall shall be calculated in accordance with ASME B31.1. The internal pressure for this calculation shall be the maximum storage pressure at the maximum storage temperature [a 70 lb/ft³ (1121 kg/m³) density shall be assumed], but in no case shall be less than the following:
- (1) For 360 psi (2482 kPa) charging pressure, an internal pressure of 620 psi (4274 kPa) (130°F) (55°C)
- (2) For 600 psi (4137 kPa) charging pressure, an internal pressure of 1000 psi (6895 kPa) (130°F) (55°C)

If higher storage temperatures are approved for a given system, the internal pressure shall be adjusted to the maximum internal pressure at maximum temperature. In performing this calculation, all joint factors and threading, grooving, or welding allowances shall be taken into account. (See Annex F.)

- **4.2.1.2** Cast-iron pipe, steel pipe conforming to ASTM A120, or nonmetallic pipe shall not be used.
- **4.2.1.3** Where used, flexible piping, tubing, or hose (including connections) shall be of approved materials and pressure ratings.

4.2.1.4 Each pipe section shall be cleaned internally after preparation and before assembly by means of swabbing, utilizing a suitable nonflammable cleaner. The piping network shall be free of particulate matter and oil residue before installation of nozzles or discharge devices.

- **4.2.1.5*** In systems where valve arrangement introduces sections of closed piping, such sections shall be equipped with pressure relief devices or the valves shall be designed to prevent entrapment of liquid. In systems using pressure operated cylinder valves, means shall be provided to vent any container leakage that could build up pressure in the pilot system and cause unwanted opening of the cylinder valve. The means of pressure venting shall be arranged so as not to prevent reliable operation of the cylinder valve.
- **4.2.1.6** All pressure relief devices shall be of such design and so located that the discharge therefrom will not injure personnel or be otherwise objectionable.
- **4.2.2 Piping Joints.** Piping joints of other than the screwed or flanged type shall be listed or approved for this application.
- **4.2.3* Fittings.** Fittings for 600 psig (4137 kPa) charging pressure systems shall have a minimum working pressure of 1000 psi (6895 kPa). Systems utilizing 360 psig (2482 kPa) charging pressure shall use fittings having a minimum working pressure of 620 psi (4274 kPa).
- 4.2.3.1 Class 150 lb and cast-iron fittings shall not be used.
- **4.2.3.2** All threads used in joints and fittings shall conform to ASME B1.20.1. Joint compound, tape, or thread lubricant shall be applied only to the male threads of the joint.
- **4.2.3.3** Welding, soldering, or brazing alloys shall have a melting point above 1000°F (538°C).
- **4.2.3.4** Welding shall be performed in accordance with the ASME *Boiler and Pressure Vessel Code*, Section IX, "Welding and Brazing Qualification."
- **4.2.3.5** Where copper, stainless steel, or other suitable tubing is joined with compression-type fittings, the manufacturer's pressure-temperature ratings for the fitting shall not be exceeded.

4.2.4 Valves.

- **4.2.4.1** All valves shall be listed or approved for the intended use.
- **4.2.4.2** Valves shall be protected against mechanical, chemical, or other damage.
- **4.2.4.3** Special corrosion-resistant materials or coatings shall be used in severely corrosive atmospheres.

4.2.5 Discharge Nozzles.

- **4.2.5.1** Discharge nozzles shall be listed for use, including the flow characteristics and area of coverage. Discharge orifices shall be of corrosion-resistant metal.
- **4.2.5.2** Special corrosion-resistant materials or coatings shall be required in severely corrosive atmospheres.
- **4.2.5.3*** Discharge nozzles shall be permanently marked to identify the manufacturer as well as the type and size of the orifice.

4.2.5.4 Where clogging by external foreign materials is likely, discharge nozzles shall be provided with frangible discs, blow-off caps, or other suitable devices. These devices shall provide an unobstructed opening upon system operation and shall be located so they will not injure personnel.

4.3 Detection, Actuation, Alarm, and Control Systems.

- **4.3.1** Detection, actuation, alarm, and control systems shall be installed, tested, and maintained in accordance with *NFPA 70* and *NFPA 72*. In Canada refer to CAN/ULC S524-14 and CAN/ULC S529-16.
- **4.3.1.1** Automatic detection and automatic actuation shall be used, except as permitted in 4.3.1.2.
- **4.3.1.2** Manual-only actuation shall be permitted if acceptable to the authority having jurisdiction.

4.3.2 Automatic Detection.

- **4.3.2.1*** Automatic detection shall be by any listed or approved method or device capable of detecting and indicating heat, flame, smoke, combustible vapors, or an abnormal condition in the hazard, such as process trouble, that is likely to produce fire.
- **4.3.2.2** Adequate and reliable primary and 24-hour minimum standby sources of energy shall be used to provide for operation of the detection, signaling, control, and actuation requirements of the system.

4.3.3 Operating Devices.

- **4.3.3.1** Operating devices shall include Halon 1301 releasing devices or valves, discharge controls, and shutdown equipment necessary for successful performance of the system.
- **4.3.3.2** Operation shall be by listed or approved mechanical, electrical, or pneumatic means. An adequate and reliable source of energy shall be used.
- **4.3.3.3** All devices shall be designed for the service they will encounter and shall not be readily rendered inoperative or susceptible to accidental operation. Devices shall be normally designed to function properly from -20°F to 150°F (-29°C to 65°C) or marked to indicate temperature limitations.
- **4.3.3.4** All devices shall be located, installed, or suitably protected so that they are not subject to mechanical, chemical, or other damage that would render them inoperative.
- **4.3.3.5** The normal manual control(s) for actuation shall be located for easy accessibility at all times, including time of fire within the protected area. The manual control(s) shall be of distinct appearance and clearly recognizable for the purpose intended. Operation of this control shall cause the complete system to operate in its normal fashion.
- **4.3.3.6** An emergency release of the system resulting from a single manual operation shall be provided. This shall be accomplished by a mechanical manual release or by an electrical manual release when the control equipment monitors the battery voltage level of the standby battery supply and provides a low battery signal. The emergency release shall cause simultaneous operation of automatically operated valves controlling agent release and distribution.
- **4.3.3.7*** Manual controls shall not require a pull of more than 40 lbf (178 N) nor a movement of more than 14 in. (356 mm)

- to secure operation. At least one manual control for activation shall be located not more than 5 ft (1.5 m) above the floor.
- **4.3.3.8** Where gas pressure from the system or pilot containers is used as a means for releasing the remaining containers, the supply and discharge rate shall be designed for releasing all of the remaining containers.
- **4.3.3.9** All devices for shutting down supplementary equipment shall be considered integral parts of the system and shall function with the system operation.
- **4.3.3.10** All manual operating devices shall be identified as to the hazard they protect.

4.3.4 Control Equipment.

- **4.3.4.1 Electric Control Equipment.** The control equipment shall supervise the actuating devices and associated wiring and, as required, cause actuation. The control equipment shall be specifically listed or approved for the number and type of actuating devices utilized, and their compatibility shall have been listed or approved.
- **4.3.4.2 Pneumatic Control Equipment.** Where pneumatic control equipment is used, the lines shall be protected against crimping and mechanical damage. Where installations could be exposed to conditions that could lead to loss of integrity of the pneumatic lines, special precautions shall be taken. The control equipment shall be specifically listed or approved for the number and type of actuating devices utilized, and their compatibility shall have been listed or approved.

4.3.5 Operating Alarms and Indicators.

- **4.3.5.1** Alarms or indicators or both shall be used to indicate the operation of the system, hazards to personnel, or failure of any supervised device. The type (audible, visual, or olfactory), number, and location of the devices shall be such that their purpose is satisfactorily accomplished. The extent and type of alarms or indicator equipment or both shall be approved.
- **4.3.5.2** Audible and highly visible alarms shall be provided to give positive warning of discharge. The operation of the warning devices shall be continued after halon discharge, until positive action has been taken to acknowledge the alarm and proceed with appropriate action.
- **4.3.5.3*** Where abort switches are provided, they shall be located only within the protected area and shall be of a type that requires constant manual pressure to cause abort. The abort switch shall not be of a type that would allow the system to be left in an aborted mode without someone present. In all cases, the normal manual and emergency manual control shall override the abort function. Operation of the abort function shall result in both audible and distinct visual indication of system impairment. The abort switch shall be clearly recognizable for the purpose intended.
- **4.3.5.4** Alarms indicating failure of supervised devices or equipment shall give prompt and positive indication of any failure and shall be distinctive from alarms indicating operation or hazardous conditions.
- **4.3.5.5** Warning and instruction signs at entrances to and inside protected areas shall be provided.
- **4.3.5.6** Time delays shall be used only where discharge delay is required for personnel evacuation or to prepare the hazard area for discharge. Time delays shall not be used as a means of

SYSTEM DESIGN 12A-11

confirming operation of a detection device before automatic actuation occurs.

4.3.6* Unwanted System Operation. Care shall be taken to thoroughly evaluate and correct any factors that could result in unwanted discharges.

Chapter 5 System Design

5.1 Specifications, Plans, and Approvals.

5.1.1 Specifications. Specifications for Halon 1301 fire-extinguishing systems shall be prepared under the supervision of a person fully experienced and qualified in the design of Halon 1301 extinguishing systems and with the advice of the authority having jurisdiction. The specifications shall include all pertinent items necessary for the proper design of the system such as the designation of the authority having jurisdiction, variances from the standard to be permitted by the authority having jurisdiction, and the type and extent of the approval testing to be performed after installation of the system.

5.1.2 Plans and Approvals.

- **5.1.2.1** Plans and calculations shall be submitted for approval to the authority having jurisdiction before installation begins. Their preparation shall be entrusted only to persons fully experienced and qualified in the design of Halon 1301 extinguishing systems.
- **5.1.2.2** These plans shall be drawn to an indicated scale or be suitably dimensioned and shall be made so they can be easily reproduced.
- **5.1.2.3** These plans shall contain sufficient detail to enable an evaluation of the hazard(s) and the effectiveness of the system. The detail of the hazards shall include the materials involved in the hazards, the location of the hazards, the enclosure or limits and isolation of the hazards, and the exposures to the hazards.
- **5.1.2.4** The detail on the system shall include information and calculations on the amount of Halon 1301; container storage pressure; internal volume of the container; the location, type, and flow rate of each nozzle including equivalent orifice area; the location, size, and equivalent lengths of pipe, fittings, and hose; and the location and size of the storage facility. Details of pipe size reduction method and orientation of tees shall be clearly indicated. Information shall be submitted pertaining to the location and function of the detection devices, operating devices, auxiliary equipment, and electrical circuitry, if used. Apparatus and devices used shall be identified. Any special features shall be adequately explained. The manufacturer's version of the flow calculation program shall be identified on the computer calculation printout. Only the currently listed calculation method shall be used.
- **5.1.2.5** An as-built instruction and maintenance manual that includes a full sequence of operation and a full set of drawings and calculations shall be maintained in a clearly identified protective enclosure at or near the system control panel.
- **5.1.3** When field conditions necessitate any material change from approved plans, the change shall be submitted for approval
- **5.1.3.1** When such material changes from approved plans are made, corrected as-built plans shall be provided.

5.2 System Flow Calculations. (See Annex G.)

- **5.2.1** As part of the design procedure, system flow calculations shall be performed using a listed calculation method. The system design shall be within the manufacturer's listed limitations.
- **5.2.2** Nozzle orifice sizes shall be selected to achieve the designed flow rate. The nozzle shall be selected by consulting the discharge characteristic information in the manufacturer's listed design manual. Flow shall be calculated on the basis of an average container pressure during discharge, taking into account the original pressurization level, storage filling density, and percent in piping for 70°F (21°C) storage temperature as shown in Figure H.1(e).
- **5.2.3** Valves shall be rated for equivalent length in terms of the pipe or tubing sizes with which they will be used. The equivalent length of container valves shall be listed and shall include siphon tube, valve, discharge head, and flexible connector.
- **5.2.4** The nozzle and fitting orientation shall be in accordance with the manufacturer's listed limitations to ensure proper system performance. (*See Annex H.*)
- **5.2.5** If the final installation varies from the prepared calculations, new calculations representing the as-built installation shall be prepared.
- **5.2.6** Halon 1301 total flooding systems shall not be used in concentrations greater than 10 percent in normally occupied areas. Areas that might contain 10 percent Halon 1301 shall be evacuated immediately upon discharge of the agent. Where egress cannot be accomplished within 1 minute, Halon 1301 total flooding systems shall not be used in normally occupied areas in concentrations greater than 7 percent. (See Annex D.)
- **5.2.7** Halon 1301 total flooding systems utilizing concentrations greater than 10 percent but not exceeding 15 percent shall be permitted to be used in areas not normally occupied, provided egress can be accomplished within 30 seconds. Where egress cannot be accomplished within 30 seconds or where concentrations greater than 15 percent must be used, provisions shall be made to prevent inhalation by personnel. (See Annex D.)
- **5.3 Enclosure.** In the design of total flooding systems, the characteristics of the enclosure as identified in 5.3.1 through 5.3.4 shall be considered.
- **5.3.1*** For all types of fires, the area of unclosable openings shall be kept to a minimum.
- **5.3.2** To prevent loss of agent through openings to adjacent hazards or work areas, openings shall be permanently sealed or equipped with automatic closures.
- **5.3.3*** Where reasonable confinement of agent is not practicable, protection shall be extended to include the adjacent connected hazards or work areas.
- **5.3.4** Forced-air ventilating systems including in-room air-conditioning units shall be shut down or closed automatically where their continued operation would adversely affect the performance of the Halon 1301 system or result in propagation of the fire.

5.4 Design Concentration Requirements.

5.4.1* For a particular fuel, either flame extinguishment or inerting concentrations shall be used.

5.4.1.1 Inerting. The inerting concentrations shall be used where conditions for subsequent reflash or explosion could exist. These conditions are found when both of the following situations occur:

- The quantity of fuel permitted in the enclosure is sufficient to develop a concentration equal to or greater than one-half of the lower flammable limit throughout the enclosure.
- (2) The volatility of the fuel before the fire is sufficient to reach the lower flammable limit in air (maximum ambient temperature or fuel temperature exceeds the closed cup flash point temperature), or the system response is not rapid enough to detect and extinguish the fire before the volatility of the fuel is increased to a dangerous level as a result of the fire.

CAUTION: Under certain conditions, it could be dangerous to extinguish a burning gas jet. As a first measure, the gas supply should be shut off.

5.4.1.1.1 The minimum design concentrations specified in Table 5.4.1.1.1 shall be used to inert atmospheres involving several flammable liquids and gases. Design inerting concentrations not given in Table 5.4.1.1.1 shall be determined by test plus a 10 percent safety factor. The minimum design concentration shall be 5 percent.

5.4.1.2* Flame Extinguishment. The minimum design concentrations specified in Table 5.4.1.2 shall be used to extinguish normal fires involving several flammable liquids and gases. Design flame extinguishment concentrations not given in Table 5.4.1.2 shall be obtained by test plus a 20 percent safety factor. Minimum design concentrations shall be 5 percent.

5.4.1.3 For combinations of fuels, the flame extinguishment or inerting value for the fuel requiring the greatest concentration shall be used unless tests are made on the actual mixture.

5.4.2 Fires in Solid Materials. Flammable solids shall be classified as those that do not develop deep-seated fires and those that do. (*See Annex I.*)

Table 5.4.1.1.1 Halon 1301 Design Concentrations for Inerting

	Minimum Conc.	
Fuel	% by Volume*	
Acetone	7.6	
Benzene	5.0	
Ethanol	11.1	
Ethylene	13.2	
Hydrogen	31.4	
Methane	7.7	
n-Heptane	6.9	
Propane	6.7	

Note: Includes a safety factor of 10 percent added to experimental values.

*Coll, John P., "Inerting Characteristics of Halon 1301 and 1211 with Various Combustibles," Fenwal Inc., Report PSR 661, July 16, 1976.

Table 5.4.1.2 Halon 1301 Design Concentrations for Flame Extinguishment (in 25°C at 1 atm)

T 1	Minimum Design Conc.	
Fuel	% by Volume	
Acetone	5.0	
Benzene	5.0	
Ethanol	5.0	
Ethylene	8.2	
Methane	5.0	
n-Heptane	5.0	
Propane	5.2	

5.4.2.1 Solid Surface Fires. To protect materials that do not develop deep-seated fires, a minimum concentration of 5 percent shall be used. (*See Annex J.*)

5.4.2.2 Deep-Seated Fires. Where the solid material is in such a form that a deep-seated fire can be established before a flame extinguishing concentration has been achieved, provisions shall be made to the satisfaction of the authority having jurisdiction for a means to effect complete extinguishment of the fire.

5.5 Determination of Halon 1301 Quantity for Total Flooding Systems.

5.5.1 Total Flooding Quantity. The amount of Halon 1301 required to achieve the design concentration shall be calculated from the following formula:

$$W = \frac{V}{s} \left(\frac{C}{100 - C} \right)$$
 [5.5.1a]

where:

W = weight of Halon 1301 required to achieve design concentration (lb)

s = 2.2062 + 0.005046t

t = minimum anticipated temperature of the protected volume (°F)

 $V = \text{net volume of hazard ft}^3$ (enclosed volume minus fixed structures impervious to halon)

C = Halon 1301 concentration, percent by volume

[5.5.1b]

$$W = \frac{V}{s} \left(\frac{C}{100 - C} \right)$$

where:

W = weight of Halon 1301 required to achieve design concentration (kg)

s = 0.14781 + 0.000567t

t =minimum anticipated temperature of the protected volume (°C)

 $V = \text{net volume of hazard } (\text{m}^3) \text{ (enclosed volume minus fixed structures impervious to halon)}$

C = Halon 1301 concentration, percent by volume

5.5.1.1 This calculation in 5.5.1 includes an allowance for normal leakage from a "tight" enclosure due to agent expansion. (See Annex K.)

- **5.5.2*** In addition to the concentration requirements, additional quantities of agent shall be required to compensate for any special conditions that would affect the extinguishing efficiency.
- **5.6* Altitude Adjustments.** The design quantity of Halon 1301 shall be adjusted to compensate for altitudes of more than 3000 ft (1000 m) above or below sea-level and pressures that vary by 10 percent above or below standard sea-level pressure (29.92 in. Hg at 70°F). The Halon 1301 quantity shall be corrected by multiplying the quantity determined in 5.5.1 and 5.5.2 by the ratio of average ambient enclosure pressure to standard sea level pressure.

5.7 Distribution System.

5.7.1* Rate of Application.

- **5.7.1.1** The minimum design rate of application shall be based on the quantity of agent required for the desired concentration and the time allotted to achieve the desired concentration.
- **5.7.1.2* Discharge Time.** The agent discharge shall be substantially completed in a nominal 10 seconds or as otherwise required by the authority having jurisdiction.
- **5.7.1.2.1** This period shall be measured as the interval between the first appearance of liquid at the nozzle and the time when the discharge becomes predominantly gaseous.
- **5.7.2*** When an extended discharge is necessary, the rate shall be sufficient to maintain the desired concentration for the duration of application.

5.8 Nozzle Choice and Location.

- **5.8.1** Nozzles shall be of the type listed for the intended purpose and shall be placed within the protected enclosure in compliance with listed limitations with regard to spacing, floor coverage, and alignment.
- **5.8.2*** The type of nozzles selected, their number, and their placement shall be such that the design concentration will be established in all parts of the hazard enclosure and such that the discharge will not unduly splash flammable liquids or create dust clouds that might extend the fire, create an explosion, or otherwise adversely affect the contents or integrity of the enclosure.

Chapter 6 Inspection, Maintenance, Testing, and Training

6.1* Inspection and Tests.

- **6.1.1** At least semiannually, all systems shall be thoroughly inspected, tested, and documented for proper operation by trained competent personnel. Tests shall be in accordance with the appropriate NFPA or Canadian standards.
- **6.1.2** The documented report, with recommendations, shall be filed with the owner.
- **6.1.3** The documented report shall be permitted to be stored and accessed using paper or electronic media.
- **6.1.4*** The agent quantity and pressure of refillable containers shall be checked. If a container shows a loss in net weight of more than 5 percent or a loss in pressure (adjusted for temperature) of more than 10 percent, it shall be refilled or replaced. When the amount of agent in the container is determined by

- special measuring devices in lieu of weighing, these devices shall be listed.
- **6.1.5** All halon removed from refillable containers during service or maintenance procedures shall be collected for recycling.
- **6.1.6** Factory-charged nonrefillable containers that do not have a means of pressure indication shall be weighed at least semiannually. If a container shows a loss in net weight of more than 5 percent, it shall be replaced. All factory-charged nonrefillable containers removed from useful service shall be returned for recycling of the agent.
- **6.1.7** The weight and pressure of the container shall be recorded on a tag attached to the container.

6.2 Container Test.

- **6.2.1** US Department of Transportation (DOT), Canadian Transport Commission (CTC), or similar design Halon 1301 cylinders shall not be recharged without retesting if the requalification period specified by the regulating authority for the container has elapsed since the date of the last test and inspection.
- **6.2.1.1** The retest shall be permitted to consist of a complete visual inspection as described in 49 CFR.
- **6.2.1.2** A cylinder shall be permitted to be requalified at any time during or before the month and year that the requalification is due.
- **6.2.1.3** A cylinder filled before the requalification becomes due shall be both of the following:
- (1) Permitted to remain in service
- (2) Periodically inspected in accordance with 6.2.2
- **6.2.1.4** A cylinder with a specified service life shall not be refilled and offered for transportation after its authorized service life has expired.
- **6.2.2** Cylinders continuously in service without discharging shall be given a complete external visual inspection every 5 years, in accordance with CGA C-6, Section 5, except that the cylinders need not be emptied or stamped while under pressure.
- **6.2.3** Where external visual inspection indicates that the container has been damaged, additional strength tests shall be required.
- **CAUTION:** If additional tests used include hydrostatic testing, containers should be thoroughly dried before refilling.
- **6.2.4** Before recharging a container, a visual inspection of its interior shall be performed.
- **6.3 Hose Test.** All system hoses shall be examined annually for damage. If visual examination shows any deficiency, the hose shall be immediately replaced or tested as specified in 6.3.1.
- **6.3.1** All hoses shall be tested at 1500 psi (10342 kPa) for 600 psi (4137 kPa) charging pressure systems, and at 900 psi (6205 kPa) for 360 psi (2482 kPa) charging pressure systems. The test shall be performed as follows:
- (1) Remove the hose from any attachment.

- (2) The hose assembly is then to be placed in a protective enclosure designed to permit visual observation of the test.
- (3) The hose must be completely filled with water before testing.
- (4) Pressure then is applied at a rate-of-pressure rise to reach the test pressure within a minimum of 1 minute. The test pressure is to be maintained for 1 full minute. Observations are then made to note any distortion or leakage.
- (5) If the test pressure has not dropped or if the couplings have not moved, the pressure is released. The hose assembly is then considered to have passed the hydrostatic test if no permanent distortion has taken place.
- (6) Hose assembly passing the test must be completely dried internally. If heat is used for drying, the temperature must not exceed 150°F (66°C).
- (7) Hose assemblies failing a hydrostatic test must be destroyed. They shall be replaced with new assemblies.
- (8) Each hose assembly passing the hydrostatic test shall be marked to show the date of test.
- **6.3.2** All hoses shall be tested every 5 years in accordance with 6.3.1.
- **6.4 Enclosure Inspection.** At least every 6 months the halon-protected enclosure shall be thoroughly inspected to determine if penetrations or other changes have occurred that could adversely affect halon leakage.
- **6.4.1** Where the inspection indicates that conditions exist that could result in inability to maintain the halon concentration, they shall be corrected. If uncertainty still exists, the enclosures shall be retested for integrity.

6.5 Maintenance.

- **6.5.1** These systems shall be maintained in full operating condition at all times. Use, impairment, and restoration of this protection shall be reported promptly to the authority having jurisdiction.
- **6.5.2** Any troubles or impairments shall be corrected at once by competent personnel.
- **6.5.3** Any penetrations made through the halon-protected enclosure shall be sealed immediately. The method of sealing shall restore the original fire resistance rating and tightness of the enclosure.
- **6.6 Training.** All persons who could be expected to inspect, test, maintain, operate, or decommission and remove fire extinguishing systems shall be thoroughly trained and kept thoroughly trained in the functions they are expected to perform.
- **6.6.1** Personnel working in a halon-protected enclosure shall receive training regarding halon safety issues.

6.7 Approval of Installations. (See Annex L.)

6.7.1 The completed system shall be tested by qualified personnel to meet the approval of the authority having jurisdiction. Only listed or approved equipment and devices shall be used in the systems. To determine that the system has been properly installed and will function as specified, the tests in 6.7.2.1, 6.7.2.2, 6.7.2.3, and 6.7.2.4 shall be performed.

6.7.2 Installation Acceptance.

6.7.2.1 Mechanical Acceptance.

- **6.7.2.1.1** The piping distribution system shall be inspected to determine that it is in compliance with the system drawings and the hydraulic calculations indicated on the computer printout associated with each agent storage container piping and nozzle configuration.
- **6.7.2.1.2** Nozzles and pipe size shall be in accordance with system drawings. Means of pipe size reduction and attitudes of tees shall be checked for conformance to the design.
- **6.7.2.1.3** Piping joints, discharge nozzles, and piping supports shall be securely fastened to prevent unacceptable movement during discharge.
- **6.7.2.1.4** During assembly, the piping distribution system shall be inspected internally to detect the possibility of any oil or particulate matter soiling the hazard area or affecting the agent distribution due to a reduction in the effective nozzle orifice area
- **6.7.2.1.5** The discharge nozzle shall be oriented in such a manner that optimum agent dispersal can be effected.
- **6.7.2.1.6** If nozzle deflectors are installed, they shall be positioned to obtain maximum benefit.
- **6.7.2.1.7** The discharge nozzles, piping, and mounting brackets shall be installed in such a manner that they will not potentially cause injury to personnel.
- **6.7.2.1.7.1** The liquid phase of the discharge shall not come in contact with people performing their normal tasks.
- **6.7.2.1.7.2** Agent shall not directly impinge on any loose objects or shelves, cabinet tops, or similar surfaces where loose objects could be present and become missiles.
- **6.7.2.1.8** All agent storage containers shall be properly located in accordance with an approved set of system drawings.
- **6.7.2.1.9** All containers and mounting brackets shall be securely fastened in accordance with the manufacturer's requirements.
- **6.7.2.1.10** If a discharge test is to be conducted, containers for the agent to be used shall be weighed before and after discharge. Fill weight of container shall be verified by weighing or other approved methods.
- **6.7.2.1.11** Adequate quantity of agent to produce the desired specified concentration shall be provided. The actual room volumes shall be checked against those indicated on the system drawings to ensure the proper quantity of agent. Fan coast-down and damper closure time shall be taken into consideration.
- **6.7.2.1.12** The piping shall be pneumatically tested in a closed circuit for a period of 10 minutes at a gauge pressure of 150 psi (1034 kPa).

CAUTION: Pneumatic pressure testing creates a potential risk of injury to personnel in the area, as a result of airborne projectiles, if rupture of the piping system occurs. Prior to conducting the pneumatic pressure test, the protected area shall be evacuated and appropriate safeguards shall be provided for test personnel.

- **6.7.2.1.12.1** The pressure test shall be permitted to be omitted if the total piping contains no more than one change in direction fitting between the storage container and the discharge nozzle, and where all piping is physically checked for tightness.
- **6.7.2.1.12.2** When pressurizing the piping, pressure shall be increased in 50 psi (3.5 bar) increments.
- **6.7.2.1.12.3** At the end of 10 minutes, the pressure drop shall not exceed 20 percent of the test pressure.
- **6.7.2.1.13** A puff test with nitrogen shall be performed to check for continuous piping.
- **6.7.2.2*** Enclosure Integrity Acceptance. All total flooding systems shall have the enclosure examined and tested to locate and then effectively seal any significant air leaks that could result in a failure of the enclosure to hold the specified Halon 1301 concentration level for the specified holding period.

6.7.2.3 Electrical Acceptance.

- **6.7.2.3.1** All wiring systems shall be properly installed in compliance with system drawings.
- **6.7.2.3.2** All field circuitry shall be measured for ground-fault and short-circuit condition. When measuring field circuitry, all electronic components (such as smoke and flame detectors or special electronic equipment for other detectors or their mounting bases) shall be removed and jumpers properly installed to prevent the possibility of damage within these devices. Components shall be replaced after measuring.
- **6.7.2.3.3** Power shall be supplied to the control unit from a separate dedicated source that will not be shut down on system operation.
- **6.7.2.3.4** Adequate and reliable primary and 24-hour minimum standby sources of energy shall be used to provide for operation of the detection, signaling, control, and actuation requirements of the system.
- **6.7.2.3.5** All auxiliary functions such as alarm sounding or displaying devices, remote annunciators, air-handling shutdown, and power shutdown shall be checked for proper operation in accordance with system requirements and design specifications. If possible, all air-handling and power-cutoff controls shall be of the type that, once interrupted, require manual restart to restore power.
- **6.7.2.3.6** Silencing of alarms (if desirable) shall not affect other auxiliary functions such as air handling or power cutoff if required in the design specification.
- **6.7.2.3.7** The detection devices shall be checked for proper type and location as specified on the system drawings.
- **6.7.2.3.8*** Detectors shall not be located near obstructions or air ventilation and cooling equipment that would appreciably affect their response characteristics. Where applicable, air changes for the protected area shall be taken into consideration.
- **6.7.2.3.9** The detectors shall be installed in a professional manner and in accordance with technical data regarding their installation.
- **6.7.2.3.10** Manual pull stations shall be properly installed, readily accessible, accurately identified, and properly protected to prevent damage.

- **6.7.2.3.11** All manual stations used to release halon shall require two separate and distinct actions for operation. They shall be properly identified. Particular care shall be taken where manual release devices for more than one system are in close proximity and could be confused or the wrong system actuated. Manual stations in this instance shall be clearly identified as to which zone or suppression area they affect.
- **6.7.2.3.12** For systems with a main/reserve capability, the main/reserve switch shall be properly installed, readily accessible, and clearly identified.
- **6.7.2.3.13** For systems using abort switches, the switches shall be of the deadman type requiring constant manual pressure, properly installed, readily accessible within the hazard area, and clearly identified. Switches that remain in the abort position when released shall not be used for this purpose. Manual pull stations shall always override abort switches.
- **6.7.2.3.14** The control unit shall be properly installed and readily accessible.

6.7.2.4 Functional Testing.

- **6.7.2.4.1*** Preliminary functional tests shall include the following:
- (1) If the system is connected to an alarm receiving office, the alarm receiving office shall be notified that the system test is to be conducted and that an emergency response by the fire department or alarm station personnel is not desired. All concerned personnel at the end user's facility shall be notified that a test is to be conducted and instructed as to the sequence of operation.
- (2) Each agent storage container release mechanism shall be disabled so that activation of the release circuit will not release agent. The release circuit shall be reconnected with a functional device in lieu of each agent storage container release mechanism. For electrically actuated release mechanisms, these devices shall sometimes include 24-volt lamps, flash bulbs, or circuit breakers. Pneumatically actuated release mechanisms shall sometimes include pressure gauges.
- (3) Each initiating device shall be checked for proper response.
- (4) All polarized alarm devices and auxiliary relays shall be checked to ensure that polarity has been observed.
- (5) All end-of-line resistors shall be checked to ensure that they have been installed across the detection and alarm bell circuits where required.
- (6) All supervised circuits shall be checked for proper trouble response.
- All supervisory devices shall be checked for proper operation.
- **6.7.2.4.2** System functional operational test shall include the following:
- (1) Operate detection initiating circuit(s). All alarm functions shall occur according to the design specification.
- Operate the necessary circuit(s) to initiate halon release.
- (3) Operate manual release. Verify that manual release functions occur according to design specifications.
- (4) If supplied, operate abort switch circuit. Verify that abort functions occur according to this standard (see 4.3.5.3). Confirm that visual and audible supervisory signals are received at the control panel.

- (5) All automatic valves shall be tested unless testing the valve will release halon or damage the valve (destructive testing).
- (6) Where required, pneumatic equipment shall be checked for integrity to ensure proper operation.
- **6.7.2.4.3** Testing of remote monitoring operations, if applicable, shall include the following:
- Operate one of each type of input device while on standby power. Verify that an alarm signal is received at remote panel after device is operated. Reconnect primary power supply.
- (2) Operate each type of alarm condition on each signal circuit and verify receipt of trouble condition at the remote station.
- **6.7.2.4.4** Testing of the control panel primary power source shall include the following:
- Verify that the control panel is connected to a dedicated circuit and labeled properly. This panel shall be readily accessible, yet restricted to unauthorized personnel.
- (2) A primary power failure shall be tested in accordance with the manufacturer's specification, with the system fully operated on standby power for the required design period.
- **6.7.2.4.5** When all functional testing is completed, each agent storage container shall be reconnected so that activation of the release circuit will release the agent. The system shall be returned to its fully operational design condition.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.3.2 For additional conversions and information see ASTM SI10.

A.1.4.3 See NFPA 77.

A.1.4.4 From a performance viewpoint, a total flooding system is designed to develop a concentration of Halon 1301 that will extinguish fires in combustible materials located in an enclosed space. It must also maintain an effective concentration until the maximum temperature has been reduced below the reignition point.

The concentration of Halon 1301 required will depend on the type of combustible material involved. This has been determined for many surface-type fires, particularly those involving liquids and gases. For deep-seated fires, the critical concentration required for extinguishment is less definite and has, in general, been established by practical test work.

It is important that an effective agent concentration not only be achieved, but that it be maintained for a sufficient period of time to allow effective emergency action by trained personnel. This is equally important for all classes of fires since a persistent ignition source (e.g., an arc, heat source, oxyacetylene torch, or "deep-seated" fire) can lead to a recurrence of the initial event once the agent has dissipated. Halon 1301 extinguishing systems normally provide protection for a period of minutes but are exceptionally effective for certain applications. Water supplies for standard sprinklers, on the other hand, are

normally designed to provide protection for an extended period of time. The designer, buyer, and emergency force in particular need to closely review the advantages and limitations of available systems as applied to the specific situation at hand, the residual risks being assumed, and the proper emergency procedures.

The discharge of minimum extinguishing concentration of Halon 1301 into enclosures containing operating diesel engines not drawing combustion air from outside the space creates a special problem. Experience has shown that the engine will continue to operate, resulting in a decrease in agent concentration and extensive decomposition of the halon.

- **A.1.5.1.2** The steps and safeguards necessary to prevent injury or death to personnel in areas where atmospheres will be made hazardous by the discharge or thermal decomposition of Halon 1301 can include the following:
 - Provision of adequate aisleways and routes of exit and keeping them clear at all times.
 - (2) Provision of emergency lighting and directional signs as necessary to ensure quick, safe evacuation.
 - (3) Provision of alarms within such areas that will operate immediately upon detection of the fire.
 - (4) Provision of only outward-swinging, self-closing doors at exits from hazardous areas, and, where such doors are latched, provision of panic hardware.
 - (5) Provision of continuous alarms at entrances to such areas until the atmosphere has been restored to normal.
- (6) Provision of warning and instruction signs at entrances to and inside such areas. These signs should inform persons in or entering the protected area that a Halon 1301 system is installed, and can contain additional instructions pertinent to the conditions of the hazard.
- (7) Provision for prompt discovery and rescue of persons rendered unconscious in such areas. This can be accomplished by having such areas searched immediately by trained personnel equipped with proper breathing equipment. Self-contained breathing equipment and personnel trained in its use, and in rescue practices, including artificial respiration, should be readily available.
- (8) Provision of instruction and drills for all personnel within or in the vicinity of such areas, including maintenance or construction people who could be brought into the area, to ensure their correct action when Halon 1301 protective equipment operates.
- (9) Provision of means for prompt ventilation of such areas. Forced ventilation will often be necessary. Care should be taken to really dissipate hazardous atmospheres and not merely move them to another location. Halon 1301 is heavier than air.
- (10) Prohibition against smoking by persons until the atmosphere has been purged of Halon 1301.
- (11) Provision of such other steps and safeguards that a careful study of each particular situation indicates are necessary to prevent injury or death.
- **A.1.5.3** Halon system cylinders contain liquefied compressed gas that, if discharged from a cylinder that is not properly connected to system pipe, can propel the cylinder and other equipment with great force. Before disconnecting cylinders from a system, proper safety precautions should be followed. Cylinder outlets should be fitted with antirecoil devices, listed or approved whenever the cylinder outlet is not connected to

ANNEX A 12A-17

the system pipe. Safe handling procedures should be followed to transport system cylinders. Actuators should be disabled or removed before the cylinder is released from its bracketing. Proper equipment should be used to transport cylinders, dollies, or carts, and means to secure the cylinder should be used if cylinders need to be transported within a facility. (See CGA P-1.)

Also consult equipment manufacturer representative for specific recommendations.

Further information can be found in the EPA Safety Guide for Decommissioning Halon Systems. This guide contains generic information for safe decommissioning of halon systems and manufacturer's specifications for handling specific equipment.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase "authority having jurisdiction," or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection departrating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.3 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.3 Normally Occupied Area. Spaces occasionally visited by personnel, such as transformer bays, switch-houses, pump rooms, vaults, engine test stands, cable trays, tunnels, microwave relay stations, flammable liquid storage areas, enclosed energy systems, and so forth, are examples of areas considered not normally occupied.

A.4.1.2 Transfer of full Halon 1301 containers that do not change ownership does not require recycling or quality testing. Where agent recycling is performed, it is recommended that the guidance of the *HRC Code of Practice for Halon Reclaiming Companies* be followed. All other design features should comply with this standard.

A.4.2.1 Piping should be installed in accordance with good commercial practice. Care should be taken to avoid possible restrictions due to foreign matter, faulty fabrication, or improper installation.

The piping system should be securely supported with due allowance for agent thrust forces and thermal expansion and contraction and should not be subjected to mechanical, chemical, vibration, or other damage. ASME B31.1 should be consulted for guidance on this matter. Where explosions are likely, the piping should be attached to supports that are least likely to be displaced.

Although halon systems are not subjected to continuous pressurization, some provisions should be made to ensure that the type of piping installed can withstand the maximum stress at maximum storage temperatures. Maximum allowable stress levels for this condition should be established at values of 90 percent of the minimum yield strength or 50 percent of the minimum tensile strength, whichever is less. All joint factors should be applied after this value is determined.

A.4.2.1.5 Pressure-operated cylinder valves are opened by the application of "pilot pressure" from the halon cylinder or from a separate pressure source. Depending on the particular valve design, the pilot pressure must be applied either to a special actuation port or to the discharge outlet of the cylinder valve. A leak in source of pilot pressure can build up sufficient pressure in closed sections of pilot actuation pipe to cause the cylinder valve to open. To prevent such accidental discharge, a pressure vent must be installed in any closed section of pipe that is used to supply pressure. The vent must be sized or otherwise designed so that when actuation is required, sufficient pilot pressure can be built up in the pilot pipe or discharge manifold to reliably open all cylinder valves. [See Table A.4.2.1.5(a) and Table A.4.2.1.5(b).]

A.4.2.3 Information on specific fittings is provided as follows:

- (1) 300 lb class malleable iron fittings, sizes through 3 in., are acceptable. Forged steel fittings should be used for all larger sizes. Flanged joints should be 600 lb class.
- (2) 300 lb class malleable iron fittings are acceptable through 3 in. internal pipe size, and 1000 ductile iron or forged steel fittings should be used in larger sizes. Flanged joints should be 300 lb class.
- (3) Pressure–temperature ratings have been established for certain types of fittings. A list of ANSI standards covering the different types of fittings is given in Table 126.1 of ASME B31.1. Where fittings not covered by one of these standards are used, the design recommendations of the manufacturer of the fittings should not be exceeded.

The materials listed in (1) and (2) do not preclude the use of other materials that would satisfy the requirements of 4.2.3.

A.4.2.5.3 The type and size of the nozzle can be identified by part number, orifice code, orifice diameter, or other suitable markings. The marking should be readily discernible after installation.

A.4.3.2.1 Detectors installed at the maximum spacing as listed or approved for fire alarm use could result in excessive delay in agent release, especially where more than one detection device is required to be in alarm before automatic actuation results.

A.4.3.3.7 Manual controls should be located at the exit from the enclosure, preferably on the door latch side.

Table A.4.2.1.5(a)	Minimum Piping	Requirements Halon	1301 Systems — 360	psi Charging Pressure

Pipe/Tubing Type and Joining Method	Pipe/Tubing Specification	Minimum Wall Thickness
Steel Pipe — Threaded Connections	ASTM A106 Seamless, Grade C ASTM A106/A53 Seamless, Grade B ASTM A106/A53 Seamless, Grade A ASTM A53 ERW Grade B ASTM A53 ERW Grade A ASTM A53 Furnace Weld Class F	Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 1 $\frac{1}{2}$ in. NPS Schedule $80 - 2$ in. through 8 in. NPS
Steel Pipe — Welded or Rolled Groove Connections	ASTM A106 Seamless, Grade C ASTM A106/A53 Seamless, Grade B ASTM A106/A53 Seamless, Grade A ASTM A53 ERW Grade B ASTM A53 ERW Grade A ASTM A53 Furnace Weld Class F	Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 6 in. NPS
Steel Pipe — Cut Groove Connections	ASTM A106 Seamless, Grade C ASTM A106/A53 Seamless, Grade B ASTM A106/A53 Seamless, Grade A ASTM A53 ERW Grade B ASTM A53 ERW Grade A ASTM A53 Furnace Weld Class F	Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 5 in. NPS Schedule $80 - 6$ in. through 8 in. NPS Schedule $40 - \frac{1}{8}$ in. through 3 in. NPS Schedule $80 - 4$ in. through 8 in. NPS Schedule $80 - 4$ in. through 8 in. NPS
Copper Tubing — Compression Fittings	ASTM B88 Seamless, Drawn ASTM B88 Seamless, Drawn ASTM B88 Seamless, Drawn ASTM B88 Seamless, Annealed ASTM B88 Seamless, Annealed ASTM B88 Seamless, Annealed	Type K $\frac{1}{4}$ in. through 8 in. Type L $\frac{1}{4}$ in. through 3 in. Type M $\frac{1}{4}$ in. through $\frac{1}{2}$ in. Type K $\frac{1}{4}$ in. through 1 in. Type L $\frac{1}{4}$ in. through $\frac{3}{4}$ in. Type M $\frac{1}{4}$ in. ONLY

A.4.3.5.3 The abort switch should be located near the means of egress for the area. Abort switches are generally not recommended.

A.4.3.6 Accidental discharge has been recognized as a significant factor in unwanted Halon 1301 emissions.

Equipment lockout or service disconnects can be instrumental in preventing false discharges when the Halon 1301 system is being tested or serviced. In addition, servicing of airconditioning systems with the release of refrigerant aerosols, soldering, or turning electric plenum heaters on for the first time after a long period of idleness can trip the Halon 1301 system. When used, an equipment service disconnect switch should be of the keyed-access type if external of the control panel or can be of the toggle type if within the locked control panel. Either type should annunciate at the panel when in the out-of-service mode. Written procedures should be established for taking the Halon 1301 system out of service.

A.5.3.1 The authority having jurisdiction can require tests to ensure proper performance as defined by this standard.

A.5.3.3 The design of total flooding Halon 1301 systems only beneath the raised floor of electronic data processing (EDP) facilities when the occupied space above the raised floor is not similarly protected by a total flooding Halon 1301 system does not meet the intent of this standard. Such a design does not comply with the definition of a total flooding system or with this chapter.

A.5.4.1 Flammable liquid and gas fires are subject to prompt extinguishment when Halon 1301 is quickly introduced into the enclosure in sufficient quantity to provide an extinguishing concentration for the particular materials involved. NFPA 69 should be referred to when possible flammable concentrations of gases make explosion protection techniques necessary.

Where an explosion potential exists due to the presence of gaseous, volatile, or atomized fuels either before or following a fire, NFPA 68 and NFPA 69, covering vapor detection and explosion venting and suppression, should be consulted. In particular, extreme caution should be taken following inerting of a rich fuel—air mixture since compartment leakage or ventilation will cause the mixture to pass through the explosive range of concentrations when fresh air is admitted.

A.5.4.1.2 The following are flame extinguishment considerations:

- Applicability of Flame Extinguishment Concentrations. The minimum design concentration required to extinguish normal fires involving certain flammable gases and liquids at atmospheric pressure is applicable if the conditions for reflash or explosion do not exist.
- (2) Temperature Sensitivity. The flame extinguishing concentration required for some fuels depends on the fuel temperature. All fuels should be tested at least at two temperatures to determine temperature sensitivity.

ANNEX A 12A-19

Table A.4.2.1.5(b) Minimum Piping Requirements Halon 1301 Systems — 600 psi Charging Pressure

Pipe/Tubing Type and Joining Method	Pipe/Tubing Specification	Minimum Wall Thickness
Steel Pipe — Threaded Connections	ASTM A106 Seamless, Grade C	Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS
-	ASTM A106/A53 Seamless, Grade B	Schedule $40 - \frac{1}{8}$ in. through 5 in. NPS
		Schedule 80 — 6 in. through 8 in. NPS
	ASTM A106/A53 Seamless, Grade A	Schedule $40 - \frac{1}{8}$ in. through $2\frac{1}{2}$ in. NPS
		Schedule 80 — 3 in. through 8 in. NPS
	ASTM A53 ERW Grade B	Schedule $40 - \frac{1}{2}$ in. through 3 in. NPS
		Schedule 80 — 4 in. through 8 in. NPS
	ASTM A53 ERW Grade A	Schedule $40 - \frac{1}{8}$ in. through $1\frac{1}{4}$ in. NPS
		Schedule $80 - 1\frac{1}{2}$ in. through 8 in. NPS
	ASTM A53 Furnace Weld Class F	Schedule $40 - \frac{1}{8}$ in. through $\frac{1}{2}$ in. NPS
		Schedule $80 - \frac{3}{4}$ in. through $2\frac{1}{2}$ in. NPS
		Schedule 120 — 3 in. through 8 in. NPS
Steel Pipe — Welded Connections	ASTM A106 Seamless, Grade C	Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS
-	ASTM A106/A53 Seamless, Grade B	Schedule 40 — 1/8 in. through 8 in. NPS
	ASTM A106/A53 Seamless, Grade A	Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS
	ASTM A53 ERW Grade B	Schedule $40 - \frac{1}{8}$ in. through 8 in. NPS
	ASTM A53 ERW Grade A	Schedule $40 - \frac{1}{8}$ in. through 6 in. NPS
		Schedule 80 — 8 in. NPS
	ASTM A53 Furnace Weld Class F	Schedule $40 - \frac{1}{8}$ in. through 3 in. NPS
		Schedule 80 — 4 in. through 6 in. NPS
Copper Tubing — Compression Fittings	ASTM B88 Seamless, Drawn	Type K $\frac{1}{4}$ in. through $1\frac{1}{4}$ in.
	ASTM B88 Seamless, Drawn	Type L $\frac{1}{4}$ in. through $\frac{3}{4}$ in.
	ASTM B88 Seamless, Drawn	Type M ¼ in. through ¾ in.
	ASTM B88 Seamless, Annealed	Type K 1/4 in. through 3/8 in.
	ASTM B88 Seamless, Annealed	Type L DO NOT USE
	ASTM B88 Seamless, Annealed	Type M DO NOT USE

(3) Special Fire Consideration. Where high temperatures or pressures exist or can result from delayed system activation and for configurations other than simple pool or gas jet fires, added tests specific to the intended application should be made.

The basis of Table 5.4.1.2 is covered in this annex material.

A.5.5.2 Halon 1301 discharged into an enclosure for total flooding will result in an air–agent mixture that has a higher specific gravity than the air surrounding the enclosure. Therefore, any opening in the walls of the enclosure will allow the heavier air–agent mixture to flow out of the enclosure, being replaced with lighter outside air flowing into the enclosure through the same opening. The rate at which agent is lost through openings depends on the height and width of the opening, the location of the opening in the wall, and the concentration of agent in the enclosure.

Fresh air entering the enclosure will collect toward the top, forming an interface between the air–agent mixture and fresh air. As leakage proceeds, the interface will move toward the bottom of the opening. The space below the interface will contain essentially the original extinguishing concentration of agent, whereas the upper space will be completely unprotected. The rate at which the interface moves downward increases as concentrations of agent increase, so that simply injecting an overdose of agent initially will not provide an extended period of protection.

A.5.6 At elevations above sea level, Halon 1301 vapor expands to a greater specific volume because of the reduced atmospheric pressure. A system designed for sea-level conditions will therefore develop an actual higher concentration at elevations above sea level. For example, a system designed to produce a 6 percent Halon 1301 concentration at sea level would actually produce an 8.7 percent concentration if installed at 10,000 ft (3000 m) elevation. This concentration would be higher than recommended for normally occupied areas and with egress times longer than 1 minute. (See 5.2.6 and 5.2.7.)

To correct for this effect, the quantity indicated at sea-level conditions should be reduced for installations at higher elevations of altitude above sea level. Correction factors are given in Table A.5.6.

For elevations substantially below sea level, the effect is the opposite of that described for elevations above sea level. For those instances, the reciprocal of the appropriate correction factor in Table A.5.6 should be used.

A.5.7.1 The minimum rates established are considered adequate for the usual surface or deep-seated fire. However, where the spread of fire could be faster than normal for the type of fire, or where high values or vital machinery or equipment are involved, rates higher than the minimums can, and in many cases should, be used. Where a hazard contains material that will produce both surface and deep-seated fires, the rate of application should be at least the minimum required for surface fires. Having selected a rate suitable to the hazard, the tables and information that follow in the standard should be used, or such special engineering as is required should be

Table A.5.6 Correction Factors for Altitude

Altitu	ıde	
ft	m	Correction Factor
3000	914	0.90
4000	1219	0.86
5000	1524	0.83
6000	1829	0.80
7000	2134	0.77
8000	2438	0.74
9000	2743	0.71
10,000	3048	0.69
11,000	3353	0.66
12,000	3658	0.64
13,000	3962	0.61
14,000	4267	0.59
15,000	4572	0.56

carried out, to obtain the proper combination of container releases, supply piping, and orifice sizes that will produce this desired rate.

A.5.7.1.2 This point is distinguished by a marked change in both the sound and the appearance of the discharge.

A.5.7.2 Where leakage is appreciable and the design concentration must be obtained quickly and maintained for an extended period of time, agent quantities provided for leakage compensation can be applied at a reduced rate.

This type of application is particularly suitable for enclosed rotating electric apparatus, such as generators, motors, and converters, and also could be needed for total flooding protection of deep-seated fires.

The initial discharge should be completed within the limits specified in 5.7.1.2.

A.5.8.2 Of particular concern in maintaining the integrity of the enclosure is preventing the lifting of ceiling tiles. Clipping of ceiling tiles will prevent their movement during discharge.

For a given type of nozzle, selection of the appropriate nozzle discharge rate is critical to reducing the potential of damage due to discharging agent. Careful consideration of ceiling type and construction, nozzle discharge characteristics, and installation methods is necessary. Maximum flow rates should be based on manufacturer's recommendations.

- **A.6.1** Some protected area conditions could require inspections more frequent than semiannually. A service contract with an approved fire protection contractor is recommended. The inspection and test is to be conducted in accordance with the manufacturer's recommendations and procedures and appropriate NFPA standards and guides. Inspection criteria include but are not limited to the following:
- Detection. All detectors are to be checked for proper alarm, supervision, and trouble functions.
- (2) Actuation.
 - (a) Remove automatic actuation controls from agent containers. Test detection system to operate the necessary circuit(s) to simulate agent release.
 - (b) Operate all manual devices to simulate agent release.

- (c) After testing, reset and reinstall all actuation controls.
- (3) Containers.
 - Examine all containers for evidence of corrosion or mechanical damage.
 - (b) Check container bracketing and supports to determine that their condition is satisfactory.
- (4) Piping and Nozzles.
 - (a) Examine piping for any evidence of corrosion.
 - (b) Examine pipe hangers and straps to see that the piping is securely supported.
 - (c) Check nozzles for proper position and alignment and determine that the orifices are clear and unobstructed.
 - (d) Check nozzle seals, if applicable, for signs of deterioration and replace if necessary.
- Auxiliary Equipment.
 - (a) Operate all auxiliary and supplementary components such as switches, door and window releases, interconnected valves, damper releases, airhandling equipment shutdown, and supplementary alarms to ensure that they are in proper operating condition.
 - (b) Return all devices to normal "operating" condition after testing.
- **A.6.1.4** The charging or recharging of cylinders or the removal or transfer of agent should be done using a closed loop system. A closed loop system permits transfer of halon between supply cylinders, system cylinders, and recovery cylinders, with only minor loss of halon to the atmosphere.
- **A.6.7.2.2** See Annex B. The currently preferred method is using a blower door fan unit and smoke pencil. If quantitative results are recorded, these could be useful for comparison at future tests.
- **A.6.7.2.3.8** Refer to *NFPA 72* and the manufacturer's recommended guidelines concerning this area.
- **A.6.7.2.4.1** Refer to the manufacturer's recommendations in all cases.

Annex B Enclosure Integrity Procedure

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

B.1 Procedure Fundamentals.

B.1.1 Scope.

- **B.1.1.1** This procedure outlines a method to equate enclosure leakage as determined by a door fan test procedure to worst-case halon leakage. The calculation method provided makes it possible to predict the time it will take for a descending interface to fall to a given height or, for the continually mixed cases, the time for the concentration to fall to a given percentage concentration.
- **B.1.1.2** Enclosure integrity testing is not intended to verify other aspects of Halon 1301 system reliability, that is, hardware operability, agent mixing, hydraulic calculations, and piping integrity.

ANNEX B 12A-21

B.1.1.3 This procedure is limited to door fan technology. This is not intended to preclude alternative technology such as acoustic sensors.

B.1.1.4 This procedure should not be considered to be an exact model of a discharge test. The complexity of this procedure should not obscure the fact that most failures to hold concentration are due to the leaks in the lower surfaces of the enclosure, but the door fan does not differentiate between upper and lower leaks. The door fan provides a worst-case leakage estimate that is very useful for enclosures with complex hidden leaks, but it will generally require more sealing than is necessary to pass a discharge test.

B.1.2 Limitations and Assumptions.

B.1.2.1 Halon System Enclosure. The following should be considered regarding the halon system and the enclosure:

- (1) Halon System Design. This test procedure only concerns halon total flooding fire suppression systems using Halon 1301 that are designed, installed, and maintained in accordance with this standard.
- (2) Enclosure Construction. Halon 1301-protected enclosures, absent of any containing barriers above the false ceiling, are not within the scope of this document.
- (3) Halon Concentration. Special consideration should be given to Halon 1301 systems with concentrations greater than 10 percent where the concern exists that high concentrations could result in significant overpressures from the discharge event in an enclosure with minimal leakage.
- (4) Enclosure Height. Special consideration should be given to high enclosures where the static pressure due to the Halon 1301 column is higher than the pressure possible to attain by means of the door fan.
- (5) Static Pressures. Where at all possible, static pressure differentials (HVAC system, elevator connections, etc.) across the enclosure envelope should be minimized during the door fan test. The test can be relied upon only for enclosures having a range of static pressures outlined in B.2.5.2.3.

B.1.2.2 Door Fan Measurements. The following should be considered regarding the door fan and its associated measurements:

- Door Fan Standards. Guidance regarding fan pressurization apparatus design, maintenance, and operation is provided by ASTM E779 and CAN/CGSB-149.10-M86.
- (2) Attached Volumes. There can be no significant attached volumes within or adjoining the enclosure envelope that will allow detrimental halon leakage that would not be measured by the door fan. Such an attached volume would be significant if it is absent of any leakage except into the design envelope and is large enough to adversely affect the design concentration.
- (3) Return Path. All significant leaks must have an unrestricted return path to the door fan.
- (4) Leak Location. The difficulty in determining the specific leak location on the enclosure envelope boundaries using the door fan is accounted for by assuming halon leakage occurs through leaks at the worst location. This is when one-half of the total equivalent leakage area is assumed to be at the maximum enclosure height and the other half is at the lowest point in the enclosure. In cases where the below false ceiling leakage area (BCLA) is measured

using B.2.6.2, the value attained for BCLA is assumed to exist entirely at the lowest point in the enclosure.

(5) Technical Judgment. Enclosures with large overhead leaks but no significant leaks in the floor slab and walls will yield unrealistically short retention time predictions. Experience has shown that enclosures of this type can be capable of retaining halon for prolonged periods. However, in such cases the authority having jurisdiction can waive the quantitative results in favor of a detailed witnessed leak inspection of all floors and walls with a door fan and smoke pencil.

B.1.2.3 Retention Calculations. The following should be considered regarding the retention calculations and the associated theory:

- Dynamic Discharge Pressures. Losses due to the dynamic discharge pressures resulting from halon system actuation are not specifically addressed.
- (2) Static Pressure. Variable external static pressure differences (wind, etc.) are additive and should be considered.
- (3) Temperature Differences. When temperature differences exceeding 18°F (10°C) exist between the enclosure under test and the other side of the door fan, special considerations outlined in this document should be considered.
- (4) Floor Area. The floor area is assumed to be the volume divided by the maximum height of the protected enclosure.
- (5) Descending Interface. The enclosure integrity procedure assumes a sharp interface. When halon is discharged, a uniform mixture occurs. As leakage takes place, air enters the room. This procedure assumes that the incoming air rides on top of the remaining mixture. In reality, the interface usually spreads because of diffusion and convection. These effects are not modeled because of their complexity. Where a wide interface is present, the descending interface is assumed to be the midpoint of a wide interface zone. Because of the conservatism built into the procedure, the effects of interface spreading can be ignored. If continual mechanical mixing occurs, a descending interface might not be formed (see B.2.7.1.6).
- (6) Leak Flow Characteristics. All leak flow is one-dimensional and does not take into account stream functions.
- (7) Leak Flow Direction. A particular leak area does not have bidirectional flow at any point in time. Flow through a leak area is either into or out of the enclosure.
- (8) Leak Discharge. The outflow from the leak discharges into an infinitely large space.
- Leak Locations. Calculations are based on worst-case halon leak locations.
- (10) Halon Delivery. The calculations assume that the design concentration of halon will be achieved. If a suspended ceiling exists, it is assumed that the halon discharge will not result in displacement of the ceiling tiles. Increased confidence can be obtained if ceiling tiles are clipped within 4 ft (1.2 m) of the nozzles and all perimeter tiles.

B.1.3 Definitions. For the purpose of Annex B, the following definitions apply.

Attached Volumes. A space within or adjoining the enclosure envelope that is not protected by halon and cannot be provided with a clearly defined return path.

Blower. The component of the door fan used to move air.

Ceiling Slab. The boundary of the enclosure envelope at the highest elevation.

Column Pressure. The theoretical maximum positive pressure created at the floor slab by the column of the halon–air mixture.

Descending Interface. The enclosure integrity procedure assumes a sharp interface. When halon is discharged, a uniform mixture occurs. As leakage takes place, air enters the room. This procedure assumes that the incoming air rides on top of the remaining mixture. In reality, the interface usually spreads because of diffusion and convection. These effects are not modeled because of their complexity. Where a wide interface is present, the descending interface is assumed to be the midpoint of a wide interface zone. Because of the conservatism built into the procedure, the effects of interface spreading can be ignored. If continual mechanical mixing occurs, a descending interface might not be formed. (*See B.2.7.1.6.*)

Door Fan. The device used to pressurize or depressurize an enclosure envelope to determine its leakage characteristics. Also called the fan pressurization apparatus.

Effective Floor Area. The volume divided by the maximum halon-protected height.

Effective Flow Area. The area that results in the same flow area as the existing system of flow areas when it is subjected to the same pressure difference over the total system of flow paths.

Enclosure. The volume being tested by the door fan. This includes the halon-protected enclosure and any attached volumes.

Enclosure Envelope. The floor, walls, ceiling, or roof that together constitute the enclosure.

Equivalent Leakage Area (ELA). The total combined area of all leaks, cracks, joints, and porous surfaces that act as leakage paths through the enclosure envelope. This is represented as the theoretical area of a sharp-edged orifice that would exist if the flow into or out of the entire enclosure at a given pressure were to pass solely through it. For the purposes of this document, the ELA is calculated at the column pressure.

Fan Pressurization Apparatus. The device used to pressurize or depressurize an enclosure envelope to determine its leakage characteristics. Also called the *door fan*.

Floor Slab. The boundary of the enclosure envelope at the lowest elevation.

Flow Pressure Gauge. The component of the door fan used to measure the pressure difference across the blower to give a value used in calculating the flow into or out of the enclosure envelope.

Halon Protected Enclosure. The volume protected by the Halon 1301 system.

Maximum Halon Protected Height. The design height of the halon column from the floor slab. This does not include the height of unprotected ceiling spaces.

Minimum Halon Protected Height. The minimum acceptable height from the floor slab to which the descending interface is allowed to fall during the retention time as specified by the authority having jurisdiction.

Return Path. The path outside the enclosure envelope that allows air to travel to/from the leak to/from the door fan.

Return Path Area. The effective flow area that the air being moved by the door fan must travel through to complete a return path back to the leak.

Room Pressure Gauge. The component of the door fan used to measure the pressure differential across the enclosure envelope.

Static Pressure Difference. The pressure differential across the enclosure envelope not caused by the discharge process or by the weight of the Halon 1301. A positive static pressure difference indicates that the pressure inside the enclosure is greater than on the outside, that is, smoke would leave the enclosure at the enclosure boundary.

B.2 Test Procedure.

- **B.2.1 Preliminary Preparations.** Contact the individual(s) responsible for the Halon 1301-protected enclosure and establish, obtain, and provide the following preliminary information:
 - (1) Provide a description of the test
- (2) Advise the time required
- (3) Determine the staff needed (to control traffic flow, set HVAC, etc.)
- (4) Determine the equipment required (e.g., ladders)
- (5) Obtain a description of the HVAC system
- (6) Establish the existence of a false ceiling space and the size of ceiling tiles
- (7) Visually determine the readiness of the room with respect to the completion of obvious sealing
- (8) Determine if conflict with other building trades will occur
- (9) Determine the size of doorways
- (10) Determine the existence of adequate return path area outside the enclosure envelope used to accept or supply the door fan air
- (11) Evaluate other conflicting activities in and around space (e.g., interruption to the facility being tested)
- (12) Obtain appropriate architectural HVAC and halon system design documents
- **B.2.2 Equipment Required.** The following equipment is required to test an enclosure using fan pressurization technology.

B.2.2.1 Door Fan System.

- **B.2.2.1.1** The door fan(s) should have a total airflow capacity capable of producing a pressure difference at least equal to the predicted column pressure or 10 Pa, whichever is greater.
- **B.2.2.1.2** The fan should have a variable speed control or a control damper in series with the fan.
- **B.2.2.1.3** The fan should be calibrated in airflow units or be connected to an airflow metering system.
- **B.2.2.1.4** The accuracy of airflow measurement should be ±5 percent of the measured flow rate.
- **B.2.2.1.5** The room pressure gauge should be capable of measuring pressure differences from 0 Pa to at least 50 Pa. It should have an accuracy of ± 1 Pa and divisions of 2 Pa or less. Inclined oil-filled manometers are considered to be traceable to a primary standard and need not be calibrated. All other

ANNEX B 12A-23

pressure-measurement apparatus (e.g., electronic transducer or magnehelic) should be calibrated at least yearly.

B.2.2.1.6 Door fan systems should be checked for calibration every 5 years under controlled conditions, and a certificate should be available for inspection at all integrity tests. The calibration should be performed according to manufacturer's specifications.

The certificate should include the following:

- Description of calibration facility and responsible technician
- (2) Date of calibration and serial number of door fan
- (3) Room pressure gauge error estimates at 0.002 in./Hg (7 Pa), 0.0029 in./Hg (10 Pa), 0.0035 in./Hg (12 Pa), 0.0044 in./Hg (15 Pa), 0.006 in./Hg (20 Pa), and 0.0118 in./Hg (40 Pa) measured by both ascending and descending pressures (minimum)
- (4) Fan calibration at a minimum of three leakage areas (approximate): 5.38 ft² (0.5 m²), 2.69 ft² (0.25 m²), and 0.54 ft² (0.05 m²) measured at a pressure of 0.0029 in./Hg (10 Pa)
- **B.2.2.1.7** A second blower or multiple blowers with flex duct and panel to flow to above ceiling spaces is optional.

B.2.2.2 Accessories. The following equipment is also useful:

- (1) Smoke pencil, fully charged (see Caution) CAUTION: Use of chemically generated smoke as a means of leak detection could result in activation of building or halon system smoke detectors. Appropriate precautions should be taken. Due to corrosive nature of the smoke, it should be used sparingly.
- (2) Bright light source
- (3) Floor tile lifter
- (4) Measuring tape
- (5) Masking or duct tape
- (6) Test forms
- (7) Multi-tip screwdrivers
- (8) Shop knife or utility knife
- (9) Several sheets of thin plastic and cardboard
- (10) Door stops
- (11) Signs to post on doors that say "DO NOT SHUT DOOR FAN TEST IN PROGRESS" or "DO NOT OPEN DOOR FAN TEST IN PROGRESS"
- (12) Thermometer

B.2.2.3 Field Calibration Check.

- **B.2.2.3.1** This procedure enables the authority having jurisdiction to obtain an indication of the door fan and system calibration accuracy upon request.
- **B.2.2.3.2** The field calibration check should be done in a separate enclosure. Seal off any HVAC registers and grilles if present. Install the door fan per manufacturer's instructions and B.2.4. Determine whether a static pressure exists using B.2.5.2. Check openings across the enclosure envelope for airflow with chemical smoke. If any appreciable flow or pressure exists, choose another room or eliminate the source.
- **B.2.2.3.3** Install a piece of rigid material less than $\frac{1}{8}$ in. (3.2 mm) thickness (free of any penetrations) in an unused blower port or other convenient enclosure opening large enough to accept an approximately 0.01 m² sharp-edged round or square opening.

B.2.2.3.4 Ensure that the door fan flow measurement system is turned to properly measure pressurization or depressurization and operate the blower to achieve a convenient pressure differential, preferably 10 Pa.

- **B.2.2.3.5** At the pressure achieved, measure the flow and calibrate an initial ELA value using B.2.6.3. Repeat the ELA measurement under positive pressure and average the two results.
- **B.2.2.3.6** Create a sharp-edged round or square opening in the rigid material. The area of this opening should be at least 33 percent of the initial ELA measured. Typical opening sizes are approximately 0.5 ft 2 (0.05 m 2), 1.1 ft 2 (0.1 m 2), and 2.2 ft 2 (0.2 m 2), depending on the initial leakage of the enclosure. Adjust the blower to the previously used positive or negative pressure differential. Measure the flows and calculate an average ELA value using B.2.6.3.
- **B.2.2.3.7** Field calibration is acceptable if the difference between the first and second ELA value is within ±15 percent of the hole area cut in the rigid material. If the difference in ELA values is greater than ±15 percent, the door fan apparatus should be recalibrated according to the manufacturer's recommendations and either ASTM E779 or CAN/CGSB-149.10-M86.

B.2.3 Initial Enclosure Evaluation.

B.2.3.1 Inspection.

- **B.2.3.1.1** Note the areas outside the enclosure envelope that will be used to supply or accept the door fan air.
- **B.2.3.1.2** Inspect all openable doors, hatches, and movable partitions for their ability to remain shut during the test.
- **B.2.3.1.3** Obtain or generate a sketch of the floor plan showing walls, doorways, and the rooms connected to the test space. Number or name each doorway.
- **B.2.3.1.4** Look for large attached volumes open to the test space via the floor or walls of the test space. Note volumes and apparent open connecting areas.
- **B.2.3.1.5** Check floor drains and sink drains for traps with liquid.

B.2.3.2 Measurement of Enclosure.

- **B.2.3.2.1** Measure the halon-protected enclosure volume. Record all dimensions. Deduct the volume of large solid objects to obtain the net volume.
- **B.2.3.2.2** Measure the highest point in the halon-protected enclosure.
- **B.2.3.2.3** Calculate the effective floor area by dividing the net halon-protected volume by the maximum halon-protected enclosure height.

B.2.3.3 Preparation.

- **B.2.3.3.1** Advise supervisory personnel in the area about the details of the test.
- **B.2.3.3.2** Remove papers and objects likely to be affected by the air currents from the discharge of the door fan.
- **B.2.3.3.3** Secure all doorways and openings as for a halon discharge. Post personnel to ensure they stay shut/open. Open doorways inside the halon-protected enclosure even though they may be closed upon discharge.

B.2.3.3.4 Get the user's personnel and/or the halon contractor to set up the room in the same state as when a discharge would occur, that is, HVAC shut down, dampers closed, and so forth. Confirm that all dampers and closable openings are in the discharge mode position.

B.2.4 Door Fan Installation.

- **B.2.4.1** The door fan apparatus generally consists of a single door fan. A double or multiple door fan for larger spaces or for neutralizing leakage through a suspended ceiling can be used for certain applications.
- **B.2.4.2** Set up one blower unit in the most convenient doorway leading into the space. Choose the doorway that opens into the largest return path area. Consideration should be given to individuals requiring access into or out of the facility.
- **B.2.4.3** Follow the manufacturer's instructions regarding setup.
- **B.2.4.4** Before door fan installation, examine the sealing around the door that the fan will be mounted in to determine whether significant leakage exists. If significant leaks are found, they should be corrected. If the manufacturer's stated door fan sealing system leakage is less than the apparent remaining leakage of the doorway, the difference must be added to the leakage calculated in B.2.6 (see B.2.6.3.5).
- **B.2.4.5** Ensure that all pressure gauges are leveled and zeroed prior to connecting them to the fan apparatus. This should be done by first gently blowing into or drawing from the tubes leading to the pressure gauges so the needle fluid or readout moves through its entire span and stays at the maximum gauge reading for 10 seconds. This confirms proper gauge operation. If using a magnehelic gauge, gently tap the gauge face for 10 seconds. With both ports of each gauge on the same side of the doorway (using tubes if necessary), zero the gauges with their particular adjusting method.
- **B.2.4.6** Connect the tubing for the room pressure gauge. Ensure that the tube is at the floor slab elevation and extends at least 10 ft away from the outlet side of the door fan blower, away from its air stream path and away from all significant air streams (i.e., HVAC airflows or openings where airflow could impinge on the tube).
- **B.2.4.7** The door fan should be arranged to alternately blow out of (depressurize) and blow into the space (pressurize). Both measurements should be taken as described in B.2.6.

B.2.5 Door Fan Enclosure Evaluation.

B.2.5.1 Pressure Run-up Inspection.

- **B.2.5.1.1** Activate the blower and adjust the enclosure pressure to negative 15 Pa or maximum negative achievable (up to –15 Pa).
- **B.2.5.1.2** Inspect all dampers with smoke to ensure that they are closing properly. Record problems and notify individuals responsible for the enclosure of the problems.
- **B.2.5.1.3** Inspect doors and hatches to ensure correct closure. Record problems and notify individuals responsible for the enclosure of the problems.
- **B.2.5.1.4** Inspect the wall perimeter (above and below the false floor) and the floor slab for major leaks. Note location and size of major leaks. Track down major airflow currents.

B.2.5.2 Static Pressure Measurement.

- **B.2.5.2.1** Seal the blower opening with the door fan properly installed but without the blower operating. Observe the room pressure gauge for at least 30 seconds. Look for minor fluctuations in pressure.
- **B.2.5.2.2** Under pre-halon discharge conditions, measure the worst-case (greatest) pressure differential (P_{SH}) across a section of envelope containing the largest quantity of leaks expected to leak halon. If the subfloor is pressurized at discharge, measure the differential between the subfloor and outside the envelope. Call this value P_{SH} (for static at halon discharge). Determine the flow direction with smoke or other indicating method.
- **B.2.5.2.3** If the static pressure (P_{SH}) has an absolute value greater than 25 percent of the column pressure calculated in B.2.6.1.3, it must be permanently reduced. Large static pressures decrease the level of certainty inherent in this procedure. The most common causes of excessive static pressure are leaky dampers and ducts and failure to shut down air-handling equipment serving the enclosure.
- **B.2.5.2.4** Record the position of all doorways, whether open or shut, when the static pressure (P_{SH}) was measured.

B.2.6 Door Fan Measurement.

B.2.6.1 Total Enclosure Leakage Method.

- **B.2.6.1.1** This method determines the equivalent leakage area of the entire enclosure envelope. It is determined by measuring the enclosure leakage under both positive and negative pressures and averaging the readings. This approach is used in order to minimize the influence of static pressures on the ELA calculation.
 - Block open all doorways around the enclosure and post personnel to ensure that they stay open.
- (2) Ensure that adequate return path area is provided to allow an unrestricted return airflow path back to the door fan from enclosure leaks.
- (3) Remove 1 percent of the floor tiles (for false floors) if an equivalent area is not already open.
- (4) If halon is designed to discharge above the false ceiling, remove 1 percent of the ceiling tiles.
- (5) Remeasure the static pressure (P_{ST}) at the time of the door fan test, between the room (not below the false floor) and the return path space.
- (6) Make every effort to reduce the static pressure (P_{ST}) by shutting down air-handling equipment even though it can operate during discharge.
- (7) Record P_{ST} and determine its direction using smoke or other means.
- (8) Record the position of each doorway, open/shut.
- (9) If the static pressure fluctuates due to wind, use a wind damping system incorporating four averaging tubes on each side of the building to eliminate its effects. The CAN/CGSB-149.10-M86 standard can be used.
- (10) If a subfloor pressurization air handler cannot be shut down for the test and leaks exist in the subfloor, these leaks might not be accurately measured. Every attempt should be made to reduce subfloor leaks to insignificance. During the test as many floor tiles as possible should be lifted to reduce the amount of subfloor pressurization. Note that under such conditions the Suspended Ceiling Leakage Neutralization Method will be

ANNEX B 12A-25

difficult to conduct due to massive air turbulence in the room.

CAUTION: The removal of raised floor tiles creates a serious safety hazard. Appropriate precautions should be taken.

B.2.6.1.2 Calculate the column pressure in the halon-protected enclosure using the following equation:

[B.2.6.1.2]

$$P_c = gH_o(r_m - r_a)$$

where:

 P_{c} = pressure due to the halon column (Pa)

 $g = acceleration due to gravity (9.81 m/sec^2)$

 H_o = height of protected enclosure (m)

 r_m = halon/air mixture density (kg/m³; see Equation B.2.7.1.4)

 $r_a = \text{air density } (1.202 \text{ kg/m}^3)$

If the calculated column pressure is less than 10 Pa, use 10 Pa as the column pressure.

- **B.2.6.1.3** Depressurize the enclosure with a door fan blower(s) until the measured pressure differential reading on the gauge (P_m) goes through a total pressure reduction (dP_m) equal to the column pressure (P_e) . As an example, if the static pressure (P_{ST}) measured in B.2.6.1.1 was -1 Pa and the calculated column pressure is 10 Pa, blow air out of the room until a P_m of -11 Pa is obtained. If the static pressure (P_{ST}) was +1 Pa and the calculated column pressure is 10 Pa, blow air out of the room until a P_m of -9 Pa is obtained. If using magnehelic gauges, tap both the room pressure and flow pressure gauges for 10 seconds each. Wait a further 30 seconds before taking the readings.
- **B.2.6.1.4** Measure the airflow (Q_n) required to obtain the pressure reduction (dP_m) required. It is important to ensure that manufacturer instructions are followed to ensure that airflow is accurately measured with respect to direction of flow.
- **B.2.6.1.5** The pressure reduction generated dP_m could be up to 30 percent greater but not lower in absolute value than the calculated column pressure.
- **B.2.6.1.6** Repeat B.2.6.1.3 through B.2.6.1.5 while pressurizing the enclosure. As an example, if the static pressure (P_{ST}) measured in B.2.6.1.1 was -1 Pa and the calculated column pressure is 10 Pa, blow air into the room until +9 Pa is obtained. If the static pressure was +1 Pa and the calculated column pressure is 10 Pa, blow air into the room until +11 Pa is obtained.
- **B.2.6.1.7** Ensure that the door fan flow measurement system is actually turned around between tests to properly measure pressurization or depressurization and that the motor rotation is not simply reversed. Ensure that the airflow entering the room is not deflected upward, which can cause lifting of any existing ceiling tiles.
- **B.2.6.1.8** Measure the air temperature within the enclosure (T_l) and outside the enclosure (T_o) .
- B.2.6.2 Suspended Ceiling Leakage Neutralization Method (Optional).
- **B.2.6.2.1** When an unobstructed suspended ceiling exists, the leakage area below the ceiling can optionally be measured by

neutralizing ceiling leaks. This method can provide a more accurate estimate of halon leakage rates. This method should not be used if the walls between rooms within the zone are sealed at the ceiling slab. This method cannot be used when the halon system is designed to protect above this suspended ceiling. This test method does not imply that leakage above the suspended ceiling is acceptable. This technique can be difficult or impossible to perform under the following conditions:

- Air movement within the room can make it difficult to observe neutralization, particularly in small rooms.
- (2) Obstructions above the suspended ceiling, that is, beams, ducts, and partitions, can make it difficult to obtain uniform neutralization.
- (3) Limited clearance above the suspended ceiling, for example, less than 1 ft (0.3 m), can make it difficult to obtain neutralization.
- **B.2.6.2.2** If not already done, obtain the equivalent leakage area of the halon-protected enclosure using the total enclosure leakage method in B.2.6.1.
- **B.2.6.2.3** Ceiling level supply registers and return grilles can be temporarily sealed off to increase the accuracy of this method. If sealed, P_{ST} should be remeasured.

NOTE: Temporary sealing of such openings is not permitted when conducting a Total Enclosure Leakage Test.

- **B.2.6.2.4** Install two separate door fans or a multiple-blower door fan with one blower ducted to the above suspended ceiling space and the other into the room space below the suspended ceiling. It is not necessary to measure airflow through the upper fan.
- **B.2.6.2.5** Depressurize above and below the suspended ceiling by adjusting two separate blowers until the required pressure reduction and suspended ceiling leak neutralization (i.e., no airflow through the suspended ceiling) is achieved.

Leaks are neutralized when at opened locations in the suspended ceiling smoke does not move up or down when emitted within $\frac{1}{4}$ in. of the openings. If neutralization is not possible at all locations, ensure that smoke either does not move or moves down (but not up). Choose undisturbed locations away from flex duct flows, airstreams, and lighting fixtures because local air velocities make neutralization difficult to detect.

- **B.2.6.2.6** Measure the airflow (Q_{μ}) through the fan that is depressurizing the volume below the false ceiling to obtain the pressure reduction (dP_m) required.
- **B.2.6.2.7** The pressure reduction generated in the volume below the false ceiling can be up to 30 percent greater, but not lower, in absolute value than the calculated column pressure.
- **B.2.6.2.8** Repeat B.2.6.2.5 through B.2.6.2.7 while pressurizing the enclosure except that smoke either does not move or moves up but not down.
- **B.2.6.2.9** An alternate method for measuring the below-ceiling leaks consists of temporarily sealing identifiable ceiling level leaks using a flexible membrane, such as polyethylene sheet and tape, and then measuring the below-ceiling leakage solely using door fans drawing from the lower part of the room. No flex duct is needed. Examples of sealable leaks are undampered ceiling level supply registers or return grilles or an entire suspended ceiling lower surface.

B.2.6.3 Equivalent Leakage Area Calculation.

B.2.6.3.1 Paragraph B.2.6.3 outlines the door fan calculation to be used in conjunction with B.2.6.1 and B.2.6.2.

B.2.6.3.2 The leakage area is generally derived per CAN/CGSB-149.10-M86. The CGSB document calculates area at 10 Pa only, whereas this procedure calculates area at a minimum of 10 Pa but allows for calculation at the halon column pressure, which could be greater than 10 Pa.

B.2.6.3.3 The airflow should be corrected for temperature if the difference between the temperature of the air being blown through the door fan and the temperature of the air going into or out of the leaks during the door fan test exceeds 10°C (18°F). If this condition exists, correct the flows as follows:

[B.2.6.3.3]

$$Q_{c} = Q_{u} \left(\frac{T_{L} + 273}{T_{F} + 273} \right)^{0.5}$$

where:

 $Q_c = \text{corrected flow (m}^3/\text{sec)}$

 Q_{μ} = uncorrected flow (m³/sec)

 T_L = temperature of air going through room leaks (°C)

 T_F = temperature of air going through door fan (°C)

NOTE: When depressurizing, $T_L = T_O$, $T_F = T_F$ When pressurizing, $T_L = T_F$, $T_F = T_O$.

B.2.6.3.4 For Equation B.2.6.3.3, corrections for barometric pressure are not necessary since they cancel out, and corrections for humidity are too small to be of concern. No other corrections apply. If Equation B.2.6.3.3 is not used, then the following applies:

[B.2.6.3.4]

$$Q_r = Q_u$$

B.2.6.3.5 After measurements are taken from pressurizing and depressurizing the enclosure, the leakage area in each direction should be calculated, and the results should be averaged. Each leakage area is calculated assuming the density of air is $1.202~{\rm kg/m^3}$ and the discharge coefficient for a hole in a flat plate (door fan) is 0.61. The equation is as follows:

[B.2.6.3.5]

$$A = \frac{1.271Q_{c}}{\left| \frac{P_{m}}{\sqrt{|P_{m}|}} - \frac{P_{ST}}{\sqrt{|P_{ST}|}} \right|}$$

where:

 $A = \text{area of leaks (m}^2)$

 $Q_c = \text{door fan flow, corrected } (\text{m}^3/\text{sec})$

 P_m = measured pressure from door fan gauge (Pa)

 P_{ST} = static pressure at time of door fan test (Pa)

The final value for A is determined by averaging the areas obtained under both a positive and a negative pressure.

B.2.6.3.6 Equation B.2.6.3.5 should be used for both the total enclosure leakage method (B.2.6.1) and the optional suspended ceiling leakage neutralization method (B.2.6.2). For B.2.6.1, the area of leaks (A) equals the equivalent leakage area (ELA). For B.2.6.2, the area of leaks (A) equals the below ceiling leakage area (BCLA).

B.2.7 Retention Calculation.

B.2.7.1 Calculation.

B.2.7.1.1 Total Leakage Area. Calculate the total leakage area (A_T) using the equivalent leakage area (ELA) determined from the door fan measurements as per B.2.6.3. This calculation should be based on a discharge coefficient of 0.61 that is used with the door fan apparatus. The following equations apply:

[B.2.7.1.1a]

$$ELA = \frac{A_d + A_p}{2}$$

where:

 A_d = leakage area (depressurization)

 A_p = leakage area (pressurization)

[B.2.7.1.1b]

$$A_T = 0.61(ELA)$$

where:

 A_T = total leakage area (m²)

ELA = equivalent leakage area (m^2)

B.2.7.1.2 Lower Leakage Area. If the leakage area is measured using only B.2.6.1, Total Enclosure Leakage Method, then Equation B.2.7.1.2a should be used to calculate the lower leakage area (A_{LL}) . If the below ceiling leakage area (BCLA) is measured using B.2.6.2, Suspended Ceiling Neutralization Method, Equation B.2.7.1.2b applies instead. These equations are as follows:

[B.2.7.1.2a]

$$A_{LL} = \frac{A_T}{2}$$

[B.2.7.1.2b]

$$A_{II} = 0.61(BCLA)$$

where:

 A_{LL} = lower leakage area (m²)

BCLA = below ceiling leakage area (m^2)

 A_T = total leakage area (m²)

ANNEX B 12A-27

B.2.7.1.3 Leak Fraction. Determine the lower leak fraction (F_A) using the following equation:

[B.2.7.1.3]

$$F_A = \frac{A_L}{A_T}$$

where:

 F_A = lower leak fraction

 A_L = leakage area

If F_A is >0.5, make $F_A = 0.5$.

B.2.7.1.4 Halon Mixture Density. Calculate the density of the Halon 1301/air mixture (r_m) using the following equation:

[B.2.7.1.4]

$$r_{m} = 6.283 \frac{c}{100} + \left(r_{a} \frac{100 - c}{100}\right)$$

where:

 r_m = halon/air mixture density (kg/m³)

c = Halon 1301 concentration (%)

 $r_a = \text{air density } (1.202 \text{ kg/m}^3)$

B.2.7.1.5 Static Pressure. Determine the correct value for (P_{SH}) to be used in Equation B.2.7.1.7b; if the (P_{SH}) recorded is negative, let it equal zero (0); if it is positive, use the recorded value

B.2.7.1.6 Minimum Height. Determine from the authority having jurisdiction the minimum height from the floor slab (*H*) that is not to be affected by the descending interface during the holding period.

If continuous mechanical mixing occurs during the retention time such that a descending interface does not form and the halon concentration is constant throughout the protected enclosure, calculate an assumed value for *H* based on the initial and final specified concentrations using the following equation:

[B.2.7.1.6]

$$H = \frac{C_F}{c} H_o$$

where:

H =assumed value for H for mixing calculation

c = actual Halon 1301 concentration (%)

 C_F = final halon concentration per authority having jurisdiction requirement

 H_o = maximum halon protected height

Example: $H_o = 4$ m, initial concentration = 7%, final = 5%, $H = \frac{5}{7} \times 4$ m = 2.86 m. Ensure that mixing is not created by ductwork that leaks excessively to zones outside the enclosure.

B.2.7.1.7 Time. Calculate the minimum time (t) that the enclosure is expected to maintain the descending interface above (H), using the following equations:

[B.2.7.1.7a]

$$C_3 = \frac{2g(r_m - r_a)}{r_m + r_a \left(\frac{F_A}{1 - F_A}\right)^2}$$

[B.2.7.1.7b]

$$C_4 = \frac{2P_{SH}}{r_{-}}$$

[B.2.7.1.7c]

$$t = 2A_{R} \left(\frac{\sqrt{C_{3}H_{o} + C_{4}} - \sqrt{C_{3}H + C_{4}}}{C_{3}F_{A}A_{T}} \right)$$

where:

t = time (sec)

 C_3 = constant for equation simplification

 C_4 = constant for equation simplification

 A_R = room floor area (m²)

 $g = \text{acceleration due to gravity (9.81 m/sec}^2)$

 P_{SH} = static pressure during halon discharge (Pa)

 H_o = height of ceiling (m)

H = height of interface from floor (m)

B.2.7.2 Acceptance Criteria. The time (*t*) that was calculated in B.2.7.1.7 must equal or exceed the holding time period specified by the authority having jurisdiction per 6.7.2.2.

B.2.7.3 Sample Calculation.

B.2.7.3.1 General. This section provides an example of leakage area calculations and retention calculations. Door fan measurements using the total enclosure leakage method (B.2.6.1) and the optional suspended ceiling leakage neutralization method (B.2.6.2) are both considered.

B.2.7.3.2 Enclosure and System Data. The following data regarding the enclosure and the halon system are provided:

- (1) Initial Halon 1301 concentration (c): 6.0%
- (2) Volume of halon-protected enclosure (V): 153.2 m³
- (3) Height of halon-protected enclosure (H_o) : 2.7 m
- (4) Calculation static pressure measurement (P_{SH}): -2.0 Pa (per B.2.5.2.2; smoke flows into room)
- (5) Door fan static pressure measurement (P_{ST}): -1.0 Pa (per B.2.6.1.2; smoke flows into room)
- (6) Temperature inside (T_I) enclosure: 18°C
- (7) Temperature outside (T_0) enclosure: 20°C
- (8) Minimum acceptable halon height (H): 2 m (per B.2.7.1.6)

B.2.7.3.3 Preliminary Calculations.

B.2.7.3.3.1 Calculate the effective floor area (per B.2.3.2.3) as follows:

[B.2.7.3.3.1]

$$A_R = \frac{153.2}{2.7} = 56.7 \text{ m}^2$$

B.2.7.3.3.2 Calculate the column pressure in the halon-protected enclosure (P_c) using Equation B.2.6.1.2 (per B.2.6.1.3). Equation B.2.6.1.2 requires that the halon/air mixture density (r_m) be known. Thus, the halon/air mixture density (r_m) is first calculated using Equation B.2.7.1.4 (per B.2.7.1.4) as follows:

[B.2.7.3.3.2a]

$$r_m = 6.283 \frac{6}{100} + 1.202 \frac{(100 - 6)}{100}$$
$$= 0.377 + 1.130$$
$$= 1.507 \text{ kg/m}^3$$

[B.2.7.3.3.2b]

$$P_e = (9.81)(2.7)(1.507 - 1.202)$$

= 8.1 Pa

 $P_c < 10 \text{ Pa}$; therefore $P_c = 10 \text{ Pa per B.2.6.1.3}$.

B.2.7.3.3.3 Determine the target depressurization pressure range (*per B.2.6.1.4 and B.2.6.1.6*) for taking door fan measurements as follows:

dep.
$$target = -1 - 10 = -11 Pa$$

pressure range =
$$-1 - (10 \times 1.3) = -14 \text{ Pa}$$

B.2.7.3.3.4 Determine the target pressurization pressure range (*per B.2.6.1.7*) for taking door fan measurements as follows:

pressure target =
$$-1 + 10 = +9$$
 Pa

pressure range =
$$-1 + (10 \times 1.3) = +12 \text{ Pa}$$

B.2.7.3.4 Total Enclosure Leakage Method.

B.2.7.3.4.1 Leakage Area Calculation. The following methodology should be used for the leakage area calculation:

(1) Depressurize the enclosure into the 11 Pa to 14 Pa range with the door fan. Measure the airflow required and pressure created (per B.2.6.1.4, B.2.6.1.5, and B.2.6.1.6) as follows:

[B.2.7.3.4.1a]

$$Q_n = 0.2046 \text{ m}^3/\text{sec}$$
 (depressurizing to -12 Pa)

(2) Pressurize the enclosure into the +9 Pa to +12 Pa range with the door fan. Measure the airflow required and pressure created (per B.2.6.1.7) as follows:

[B.2.7.3.4.1b]

$$Q_u = 0.3480 \text{ m}^3/\text{sec} (\text{pressurizing to } +10 \text{ Pa})$$

- (3) Correct the door fan airflow for the temperature difference between the inside and outside enclosure temperatures (per B.2.6.3.3). This correction is not necessary if the temperature difference is less than 10°C (18°F) and is not needed for these sample calculations; however, it is included herein for demonstrative purposes. Using Equation B.2.6.3.5, this correction is as follows:
 - (a) For depressurization,

[B.2.7.3.4.1c]

$$Q_e = 0.2046 \left(\frac{20 + 273}{18 + 273} \right)^{0.5} = 0.2053 \text{ m}^3/\text{sec}$$

(b) For pressurization,

[B.2.7.3.4.1d]

$$Q_c = 0.3480 \left(\frac{18 + 273}{20 + 273} \right)^{0.5} = 0.3468 \text{ m}^3/\text{sec}$$

- (4) Calculate the leakage area (*A*) from the door fan measurements (*per B.2.6.3.5*). Using Equation B.2.6.3.5, the calculations are as follows:
 - (a) For depressurization,

[B.2.7.3.4.1e]

$$A = \frac{(1.271)(0.2053)}{\left|\frac{-12}{\sqrt{|-12|}} - \frac{-1}{\sqrt{|-1|}}\right|}$$
$$= \frac{(1.271)(0.2053)}{\left|\sqrt{12} - 1\right|} = 0.1059 \text{ m}^2$$

(b) For pressurization,

[B.2.7.3.4.1f]

$$A = \frac{(1.271)(0.3468)}{\left|\frac{10}{\sqrt{|10|}} - \frac{-1}{\sqrt{|-1|}}\right|}$$
$$= \frac{(1.271)(0.3468)}{\left|\sqrt{10} + 1\right|} = 0.1059 \text{ m}^2$$

ANNEX B 12A-29

(c) The average is as follows:

[B.2.7.3.4.1g]

$$A = \frac{0.1059 + 0.1059}{2} = 0.1059$$

$$ELA = A = 0.1059 \text{ m}^2$$

B.2.7.3.4.2 Retention Calculation.

(1) Calculate the total leakage area (A_T) using Equation B.2.7.1.1b (per B.2.7.1.1) as follows:

[B.2.7.3.4.2a]

$$A_T = (0.61)(0.1059) = 0.0646 \text{ m}^2$$

(2) Calculate the lower leak area (A_{LL}) using Equation B.2.7.1.2a (per B.2.7.1.2) as follows:

[B.2.7.3.4.2b]

$$A_{LL} = \frac{0.0646}{9} = 0.0323 \text{ m}^2$$

(3) Calculate the leak fraction (F_A) using Equation B.2.7.1.3 (per B.2.7.1.3) as follows:

[B.2.7.3.4.2c]

$$F_A = \frac{(0.0323)}{(0.0646)} = 0.5$$

(4) Calculate the constants for equation simplification (C_3 and C_4) using Equations B.2.7.1.7a and B.2.7.1.7b (per B.2.7.1.7). Since the value for (P_{SH}) is negative, it is set equal to zero (per B.2.7.1.5). The calculations are as follows:

[B.2.7.3.4.2d]

$$C_3 = \frac{(2)(9.81)(1.507 - 1.202)}{1.507 + 1.202 \left[\frac{0.5}{1 - 0.5}\right]^2} = 2.2090$$

[B.2.7.3.4.2e]

$$C_4 = \frac{2(0)}{1.507} = 0$$

(5) Calculate the minimum time (*t*) that the enclosure is expected to maintain the descending interface using Equation B.2.7.1.7c (*per B.2.7.1.7*) as follows:

[B.2.7.3.4.2f]

$$t = 2(56.7) \frac{\sqrt{(2.2090)(2.7) + 0} - \sqrt{(2.2090)(2) + 0}}{(2.2090)(0.5)(0.0646)}$$
$$= 113.4 \left(\frac{0.3403}{0.0713}\right)$$
$$= 540 \sec = 9 \min$$

B.2.7.3.5 Suspended Ceiling Leakage Neutralization Method (Optional).

B.2.7.3.5.1 Leakage Area Calculation. The following methodology should be used for the leakage area calculation:

(1) Determine the equivalent leakage area (*ELA*) for the total enclosure as described previously in B.2.7.3.4.1. The result is as follows:

[B.2.7.3.5.1a]

$$ELA = 0.1059 \text{ m}^2$$

(2) Depressurize the enclosure below the ceiling with the door fan into the -11 Pa to -14 Pa range. Measure the airflow required and the pressure created (per B.2.6.2.5, B.2.6.2.6, and B.2.6.2.7) as follows:

[B.2.7.3.5.1b]

$$Q_u = 0.0512 \text{ m}^3/\text{sec}$$
 (depressurizing to -12 Pa)

(3) Pressurize the enclosure below the ceiling with the door fan into the +9 Pa to +12 Pa range. Measure the airflow required and the pressure created (per B.2.6.2.8) as follows:

[B.2.7.3.5.1c]

$$Q_u = 0.0871 \text{ m}^3/\text{sec}$$
 (pressurizing to +10 Pa)

- (4) Correct the door fan airflow for the temperature difference between the inside and outside enclosure temperatures (per B.2.6.3.3). This correction is not necessary if the temperature difference is less than 10°C (18°F) and is not needed for these sample calculations; however, it is included herein for demonstrative purposes. Using Equation B.2.6.3.3, this correction is as follows:
 - (a) For depressurization,

[B.2.7.3.5.1d]

$$Q_c = 0.0512 \left[\frac{20 + 273}{18 + 273} \right]^{0.5} = 0.0514 \text{ m}^3/\text{sec}$$

(b) For pressurization,

[B.2.7.3.5.1e]

$$Q_c = 0.0871 \left[\frac{18 + 273}{20 + 273} \right]^{0.5} = 0.0868 \text{ m}^3/\text{sec}$$

- (5) Calculate the leakage area (A) from the door fan measurements (per B.2.6.3.5). Using Equation B.2.6.3.5, the calculations are as follows:
 - (a) For depressurization,

[B.2.7.3.5.1f]

$$A = \frac{(1.271)(0.0514)}{\left|\frac{-12}{\sqrt{|-12|}} - \frac{-1}{\sqrt{|-1|}}\right|}$$
$$= \frac{(1.271)(0.0514)}{\left|\sqrt{12} - 1\right|} = 0.0265 \text{ m}^2$$

(b) For pressurization,

[B.2.7.3.5.1g]

$$A = \frac{(1.271)(0.0868)}{\left|\frac{-10}{\sqrt{|10|}} - \frac{-1}{\sqrt{|-1|}}\right|}$$
$$= \frac{(1.271)(0.0868)}{\left|\sqrt{10} + 1\right|} = 0.0265 \text{ m}^2$$

(c) The average is as follows:

[B.2.7.3.5.1h]

$$A = \frac{0.0265 + 0.0265}{2} = 0.0265 \text{ m}^2$$

$$BCLA = A = 0.0265 \text{ m}^2$$

B.2.7.3.5.2 Retention Calculation. Use the following for the retention calculation:

(1) Calculate the total leakage area (A_T) using Equation B.2.7.1.1b (per B.2.7.1.1) as follows:

[B.2.7.3.5.2a]

$$A_T = (0.61)(0.1059) = 0.0646 \text{ m}^2$$

(2) Calculate the lower leakage area (A_{IL}) using Equation B.3.7.1.2b $(per\ B.2.7.1.2)$ as follows:

[B.2.7.3.5.2b]

$$A_{LL} = (0.61)(0.0265) = 0.0161 \text{ m}^2$$

(3) Calculate the leak fraction (F_A) using Equation B.2.7.1.3 $(per\ B.2.7.1.3)$ as follows:

[B.2.7.3.5.2c]

$$F_A = \frac{(0.0161)}{(0.0646)} = 0.2492$$

(4) Calculate the constants for equation simplification (C₃ and C₄) using Equations B.2.7.1.7a and B.2.7.1.7b (per B.2.7.1.7). Since the value for (P_{SH}) is negative, it is set equal to zero (per B.2.7.1.5). The calculations are as follows:

[B.2.7.3.5.2d]

$$C_3 = \frac{\left(2\right)\!\left(9.81\right)\!\left(1.507 - 1.202\right)}{1.507 + 1.202\!{\left[\frac{0.2492}{1 - 0.2492}\right]^{\!2}}}$$

[B.2.7.3.5.2e]

$$C_4 = \frac{2(0)}{1.507} = 0$$

(5) Calculate the minimum time (t) that the enclosure is expected to maintain the descending interface using Equation B.2.7.1.7c (per B.2.7.1.7) as follows:

[B.2.7.3.5.2f]

$$t = 2(56.7) \frac{\sqrt{(3.6502)(2.7) + 0} - \sqrt{(3.6502)(2) + 0}}{(3.6502)(0.2492)(0.0646)}$$
$$= 113.4 \frac{0.4374}{0.0588}$$
$$= 840 \text{ sec} = 14 \text{ min}$$

B.2.7.3.6 Sample Calculation Results. The minimum time (*t*) that the enclosure is expected to maintain the descending interface above height (*H*) is 9 minutes using the Total Enclosure Leakage Method and 14 minutes using the optional Suspended Ceiling Leakage Neutralization Method. Both of these predictions are conservative, and the actual time is expected to be greater than these values. Because the optional Suspended Ceiling Leakage Neutralization Method is more accurate, its results are closer to what will actually occur.

B.2.8 Leakage Control.

B.2.8.1 Leakage Identification.

- **B.2.8.1.1** While the enclosure envelope is being pressurized or depressurized, a smoke pencil or other smoke source should be used to locate and identify leaks. The smoke source should not be produced by an open flame or any other source that is a potential source of fire ignition. Chemical smoke should be used only in small quantities, and consideration should be given to the corrosive nature of certain chemical smokes and their effects on the facility being tested.
- **B.2.8.1.2** Leakage identification should focus on obvious points of leakage including wall joints, penetrations of all kinds, HVAC ductwork, doors, and windows.
- **B.2.8.1.3** Alternate methods for leakage identification are available and should be considered. One method is the use of a directional acoustic sensor that can be selectively aimed at different sound sources. Highly sensitive acoustic sensors are available that can detect air as it flows through an opening. Openings can be effectively detected by placing an acoustic source on the other side of the barrier and searching for acoustic transmission independent of fan pressurization or depressurization. Another alternative is to use an infrared scanning device if temperature differences across the boundary are sufficient.

ANNEX C 12A-31

B.2.8.2 Leakage Alteration.

B.2.8.2.1 Procedure.

B.2.8.2.1.1 Protected areas should be enclosed with wall partitions that extend from the floor slab to ceiling slab or floor slab to roof.

B.2.8.2.1.2 If a raised floor continues out of the halon-protected area into adjoining rooms, partitions should be installed under the floor directly under above-floor border partitions. These partitions should be caulked top and bottom. If the adjoining rooms share the same under-floor air handlers, then the partitions should have dampers installed in the same manner as required for ductwork.

B.2.8.2.1.3 Any holes, cracks, or penetrations leading into or out of the protected area should be sealed. This includes pipe chases and wire troughs. All walls should be caulked around the inside perimeter of the room where the walls rest on the floor slab and where the walls intersect with the ceiling slab or roof above.

B.2.8.2.1.4 Porous block walls should be sealed slab-to-slab to prevent gas from passing through the block. Multiple coats of paint could be required.

B.2.8.2.1.5 All doors should have door sweeps or drop seals on the bottoms, weather stripping around the jambs, latching mechanisms, and door-closer hardware. In addition, double doors should have a weather-stripped astragal to prevent leakage between doors and a coordinator to ensure proper sequence of closure.

B.2.8.2.1.6 Windows should have solid weather stripping around all joints.

B.2.8.2.1.7 All unused and out-of-service ductwork leading into or from a protected area should be permanently sealed off (airtight) with metal plates caulked and screwed in place. Ductwork still in service with the building air-handling unit should have butterfly blade–type dampers installed with neoprene seals. Dampers should be spring-loaded or motor-operated to provide 100 percent air shutoff. Alterations to air-conditioning, heating, ventilating ductwork, and related equipment should be in accordance with NFPA 90A or NFPA 90B, as applicable.

B.2.8.2.1.8 All floor drains should have traps, and the traps should be designed to have water or other compatible liquid in them at all times.

B.2.8.2.2 Materials.

B.2.8.2.2.1 All materials used in altering leaks on enclosure envelope boundaries, including walls, floors, partitions, finish, acoustical treatment, raised floors, suspended ceilings, and other construction, should have a flame-spread rating that is compatible with the flame-spread requirements of the enclosure

B.2.8.2.2.2 Exposed cellular plastics should not be used for altering leakage unless considered acceptable by the authority having jurisdiction.

B.2.8.2.2.3 Cable openings or other penetrations into the enclosure envelope should be firestopped with material that is compatible with the fire rating of the barrier.

B.2.9 Test Report.

B.2.9.1 Upon completion of a door fan test, a written test report should be prepared for the authority having jurisdiction and made part of the permanent record. The test report should include the following:

- (1) Date, time, and location of test
- (2) Names of witnesses to the test
- (3) Room dimensions and volume
- (4) All data generated during test, including computer printouts
- (5) Descriptions of any special techniques utilized by the test technician (i.e., use of optional ceiling neutralization and temporary sealing of suspended ceiling)

(6) In the case of technical judgment, a full explanation and documentation of the judgment

- (7) Test equipment make, model, and serial number
- (8) Copy of current calibration certificate of test equipment
- (9) Name and affiliation of testing technician, and signature

Annex C Halogenated Extinguishing Agents

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

C.1 Introduction. A halogenated compound is one that contains one or more atoms of an element from the halogen series, which includes fluorine, chlorine, bromine, and iodine. When hydrogen atoms in a hydrocarbon compound, such as methane (CH₄) or ethane (CH₃CH₃), are replaced with halogen atoms, the chemical and physical properties of the resulting compound are markedly changed. Methane, for example, is a light, flammable gas. Carbon tetrafluoride (CF₄), also a gas, is chemically inert, nonflammable, and extremely low in toxicity. Carbon tetrachloride (CCl₄) is a volatile liquid that not only is nonflammable, but also was widely used for many years as a fire extinguishing agent in spite of its rather high toxicity. Carbon tetrabromide (CBr₄) and carbon tetraiodide (CI₄) are solids that decompose easily under heat. Generally, the presence of fluorine in the compound increases its inertness and stability; the presence of other halogens, particularly bromine, increases the fire extinguishing effectiveness of the compound. Although a very large number of halogenated compounds exist, only the following five have been used to a significant extent as fire extinguishing agents:

- (1) Halon 1011, bromochloromethane, CH₂BrCl
- (2) Halon 1211, bromochlorodifluoromethane, $CBrClF_2$
- (3) Halon 1202, dibromodifluoromethane, CBr₂F₂
- (4) Halon 1301, bromotrifluoromethane, CBrF₃
- Halon 2402, dibromotetrafluoroethane, CBrF₂CBrF₂

C.2 Halon Nomenclature System. The halon system for naming halogenated hydrocarbons was devised by the US Army Corps of Engineers to provide a convenient and quick means of reference to candidate fire extinguishing agents. The first digit in the number represents the number of carbon atoms in the compound molecule; the second digit, the number of fluorine atoms; the third digit, the number of chlorine atoms; the fourth digit, the number of bromine atoms; and the fifth digit, the number of iodine atoms. Terminal zeros are dropped. Valence requirements not accounted for are assumed to be hydrogen atoms (number of hydrogen atoms = first digit times 2, plus 2, minus the sum of the remaining digits).

C.2.1 Halon 1301. Halon 1301 chemically is bromotrifluoromethane, CBrF₃. Its cumbersome chemical name is often shortened to "bromotri" or even further to "BT." The compound is used as a low-temperature refrigerant and as a cryogenic fluid, as well as a fire extinguishing agent.

C.2.1.1 Physical Properties. A list of important physical properties of Halon 1301 is given in Table C.2.1.1. Under normal conditions, Halon 1301 is a colorless, odorless gas with a density approximately five times that of air. It can be liquefied upon compression for convenient shipping and storage. Unlike carbon dioxide, Halon 1301 cannot be solidified at temperatures above –270°F (–167.8°C).

The variation of vapor pressure with temperature for Halon 1301 is shown in Figure C.2.1.1(a) and Figure C.2.1.1(b) (Metric). As the temperature is increased, the vapor pressure and vapor density increase and the liquid density decreases, until the critical temperature of 152.6°F (67°C) is reached. At this point, the densities of the liquid and vapor phases become equal and the liquid phase ceases to exist. Above the critical temperature, the material behaves as a gas, but it can no longer be liquefied at any pressure.

C.2.1.2 Fire Extinguishment Characteristics. Halon 1301 is an effective fire extinguishing agent that can be used on many types of fires. It is effective in extinguishing surface fires, such as flammable liquids, and on most solid combustible materials except for a few active metals and metal hydrides and materials that contain their own oxidizer, such as cellulose nitrate and gunpowder.

C.2.1.3 Extinguishing Mechanism. The mechanism by which Halon 1301 extinguishes fires is not thoroughly known; neither is the combustion process of the fire itself. It appears, however, to be a physicochemical inhibition of the combustion reaction. Halon 1301 has also been referred to as a "chain breaking" agent, meaning that it acts to break the chain reaction of the combustion process. Halon 1301 dissociates in the flame into two radicals:

[C.2.1.3a]

$$CBrF_3 \rightarrow CF_3 + Br$$

Two inhibiting mechanisms have been proposed, one that is based on a free radical process, and another based on ionic activation of oxygen during combustion.

The "free radical" theory supposes that the bromide radical reacts with the fuel to give hydrogen bromide,

[C.2.1.3b]

$$R - H + Br \rightarrow R + HBr$$

which then reacts with active hydroxyl radicals in the reaction zone:

[C.2.1.3c]

$$HBr + OH \rightarrow H_9O + Br \rightarrow$$

Table C.2.1.1 Physical Properties of Halon 1301

Physical Properties	US Customary	SI
Molecular weight	148.93	148.93
Boiling point at 1 atm	-71.95°F	−57.75°C
Freezing point	$-270^{\circ}\mathrm{F}$	−168°C
Critical temperature	152.6°F	67.0°C
Critical pressure	575 psia	39.6 bar
Critical volume	$0.02\overline{15} \text{ ft}^3/\text{lb}$	$0.000\ 276\ \mathrm{m^3/kg}$
Critical density	46.5 lb/ft^3	745 kg/m^3
Specific heat, liquid, at 77°F (25°C)	0.208 Btu/lb-°F	870 J/kg-°C
Specific heat, vapor, at constant pressure (1 atm) and 77°F (25°C)	0.112 Btu/lb-°F	469 J/kg-°C
Heat of vaporization at boiling point	51.08 Btu/lb	118.8 kJ/kg
Thermal conductivity of liquid at 77°F (25°C)	0.024 Btu/hr-ft-°F	$0.85\mathrm{W/m ext{-}K}$
Viscosity, liquid, at 77°F (25°C)	1.01×10^4 lb/ft-sec	1.59× 10 ⁻⁴ Centipoise
Viscosity, vapor, at 77°F (25°C)	1.08×10^{-5} lb/ft-sec	1.63× 10 ⁻⁵ Centipoise
Surface tension at 77°F (25°C)	4 dynes/cm	0.004 N/m
Refractive index of liquid at 77°F (25°C)	1.238	1.238
Relative dielectric strength at 1 atm, 77°F (25°C) (nitrogen = 1.00)	1.83	1.83
Solubility of Halon 1301 in water at 1 atm 77°F (25°C)	0.03% by weight	0.03% by weight
Solubility of water in Halon 1301 at 70°F (21°C)	0.0095% by weight	0.0095% by weight

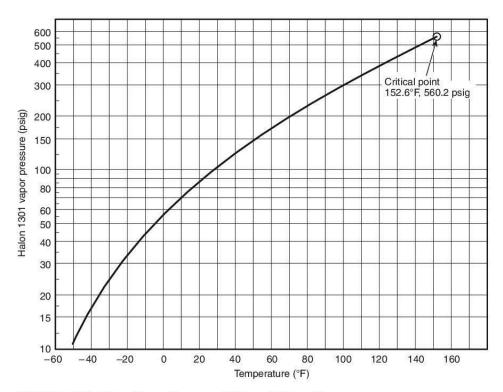


FIGURE C.2.1.1(a) Vapor Pressure of Halon 1301 vs. Temperature.

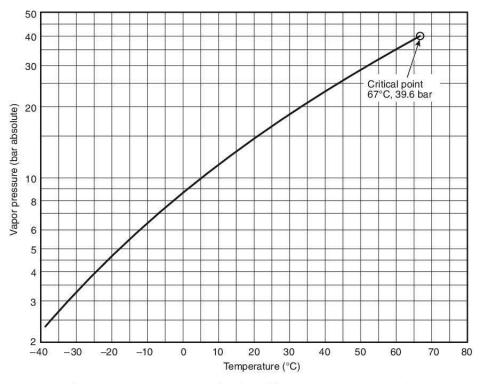


FIGURE C.2.1.1(b) Vapor Pressure of Halon 1301 vs. Temperature (Metric).

The bromide radical again reacts with more fuel, and so on, with the result that active H_{\bullet} , OH_{\bullet} , and O: radicals are removed, and less reactive alkyl radicals are produced.

The "ionic" theory supposes that the uninhibited combustion process includes a step in which O_2 -ions are formed by the capture of electrons that come from ionization of hydrocarbon molecules. Since bromine atoms have a much higher cross section for the capture of slow electrons than O_2 , the bromine inhibits the reaction by removing the electrons that are needed for activation of the oxygen.

Portable Halon 1301 extinguishers are covered in NFPA 10.

Annex D Hazards to Personnel

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

D.1 Hazards to Personnel. The discharge of Halon 1301 to extinguish a fire can create a hazard to personnel from the natural Halon 1301 itself and from the products of decomposition that result from exposure of the agent to the fire or other hot surfaces. Exposure to the natural agent is generally of less concern than is exposure to the decomposition products. However, unnecessary exposure of personnel to either the natural agent or to the decomposition products should be avoided.

Other potential hazards to be considered for individual systems are as follows:

- Noise. Discharge of a system can cause noise loud enough to be startling but ordinarily insufficient to cause traumatic injury.
- (2) Turbulence. High-velocity discharge from nozzles can be sufficient to dislodge substantial objects or injure people directly in the path. System discharge can also cause enough general turbulence in the enclosures to move unsecured paper and light objects.
- (3) Cold Temperature. Direct contact with the vaporizing liquid being discharged from a Halon 1301 system has a strong chilling effect on objects and can cause frostbite burns to the skin. The liquid phase vaporizes rapidly when mixed with air and thus limits the hazard to the immediate vicinity of the discharge point. In humid atmospheres, minor reduction in visibility can occur for a brief period due to the condensation of water vapor.
- **D.2 Natural or Undecomposed Halon 1301.** When Halon 1301 is used in systems designed and installed according to this NFPA standard, risk to exposed individuals is minimal. Its toxicity is very low in both animals and humans. The main physiologic actions of Halon 1301 at high inhaled levels are central nervous system (CNS) depression and cardiovascular effects.
- **D.2.1** Animals. Halon 1301 has a 15-minute approximate lethal concentration (ALC) of 83 percent (O_2 added) (Paulet, 1962), suggesting a very low degree of acute inhalation toxicity. In monkeys and dogs, mild CNS effects occur after a few minutes of exposure above 10 percent, progressing to lethargy in monkeys and tremors and convulsion in dogs at levels above 20 percent (Van Stee et al., 1969).

Spontaneous effects on blood pressure and cardiac rhythm occur at much higher levels, approximately 20 percent and 40 percent, respectively (Van Stee et al., 1969).

It has also been known since the early 1900s that the inhalation of many halocarbons and hydrocarbons, like carbon tetrachloride and hexane, can make the heart abnormally sensitive to elevated adrenalin levels, resulting in cardiac arrhythmia and possibly death. This phenomenon has been referred to as cardiac sensitization. Halon 1301 can also sensitize the heart, but only at high inhaled levels. For example, in standard cardiac sensitization screening studies in dogs using 5-minute exposures and large doses of injected adrenalin, the threshold for sensitization is in the 7.5 to 10 percent range (Clark, 1970).

In other studies on dogs, a certain critical blood level was associated with inspired levels needed to sensitize the heart. With exposure to Halon 1301, a relatively insoluble fluorocarbon, blood concentrations rise rapidly, equilibrate within 5 to 10 minutes, and fall rapidly upon cessation of exposure. There is no accumulation of Halon 1301 as indicated by similar blood concentration at 5 to 10 minutes and at 60 minutes of exposure. When dogs exposed to Halon 1301 for 60 minutes are given a large dose of adrenalin, the threshold for cardiac sensitization remains the same as for 5-minute exposures — 7.5 to 10 percent. In addition, studies have shown that sensitization is only a temporary effect, since adrenalin injections given 10 minutes after exposure to known sensitizing levels have not resulted in arrhythmias (Trochimowicz et al., 1974).

All percentage levels in this section refer to volumetric concentrations of Halon 1301 in air.

Using the standard cardiac sensitization test protocol and large doses of adrenalin, dogs with experimentally induced myocardial infarction were tested to determine whether this type of heart condition might significantly lower the threshold for cardiac sensitization (Trochimowicz et al., 1978). Results on Halon 1301 showed no greater potential for cardiac sensitization among dogs having recovered from myocardial infarction than for normal, healthy animals.

Halon 1301 has also been tested for mutagenic and teratogenic effects. In a standard 48-hour Ames Test at levels of 40 percent, no evidence of mutagenicity was seen in *Salmonella typhimurium* bacteria with or without metabolic activation. Pregnant rats exposed to Halon 1301 at levels as high as 5 percent exhibited no embryotoxic or teratogenic effects.

The preceding animal studies show that Halon 1301 is very low in toxicity. Although high inhaled levels can affect the CNS and cardiovascular system, such effects are rapidly and completely reversible upon removal from exposure if the exposure conditions were not severe enough to produce death.

D.2.2 Humans. The very low toxicity of Halon 1301 in animal studies has been confirmed by over 20 years of safe manufacture and use. There has never been a death or any permanent injury associated with exposure to Halon 1301.

Exposure to Halon 1301 in the 5 to 7 percent range produces little, if any, noticeable effect. At levels between 7 and 10 percent, mild CNS effects such as dizziness and tingling in the extremities have been reported. Above 10 percent, some subjects report a feeling of impending unconsciousness after a few minutes, although test subjects exposed up to 14 percent for 5 minutes have not actually lost consciousness (Clark, 1970). These types of CNS effects were completely reversible upon removal from exposure.

In many experimental studies on humans, no subject has ever had a serious arrhythmia at Halon 1301 levels below

10 percent. One arrhythmia has been observed at a 14 percent level after a few minutes of exposure, but the subject reverted to a normal rhythm upon removal to fresh air (Hine Laboratories, 1968). In studies at the Medical College of Wisconsin (Stewart et al., 1978), exposure to Halon 1301 up to 7.1 percent for 30 minutes did not produce sufficient adverse effects to harm, confuse, or debilitate human subjects or prevent them from performing simple mechanical tasks, following instructions, or exiting from the Halon 1301 exposure area. In addition, these subjects experienced no significant EKG or EEG abnormalities during or after exposure.

It is considered good practice to avoid all unnecessary exposure to Halon 1301 and to limit exposures to the following times:

- (1) 7 percent and below 15 minutes
- (2) 7 to 10 percent 1 minute
- (3) 10 to 15 percent 30 seconds
- (4) Above 15 percent prevent exposure

Anyone suffering from the toxic effects of Halon 1301 vapors should immediately move or be moved to fresh air. In treating persons suffering toxic effects due to exposure to this agent, the use of epinephrine (adrenaline) and similar drugs must be avoided because they can produce cardiac arrhythmias, including ventricular fibrillation.

Halon 1301 is colorless and odorless. Discharge of the agent can create a light mist in the vicinity of the discharge nozzle, resulting from condensation of moisture in the air, but the mist rarely persists after discharge is completed. Thus, little hazard is created from the standpoint of reduced visibility. Once discharged into an enclosure, it is difficult to detect its presence through normal human senses; in concentrations above approximately 3 percent, voice characteristics are changed due to the increased density of the agent/air mixture.

In total flooding systems, the high density of Halon 1301 vapor (five times that of air) requires the use of discharge nozzles that will achieve a well-mixed atmosphere to avoid local pockets of higher concentration. Once mixed into the air, the agent will not settle out.

D.3 Decomposition Products of Halon 1301. Although Halon 1301 vapor has a low toxicity, its decomposition products can be hazardous. The most accepted theory is that the vapor must decompose before Halon 1301 can inhibit the combustion reactions (*see 1.4.1*). The decomposition takes place on exposure to a flame or to a hot surface at above approximately 900°F (482°C). In the presence of available hydrogen (from water vapor or the combustion process itself), the main decomposition products are the halogen acids (HF, HBr) and free halogens (Br₂) with small amounts of carbonyl halides (COF₂, COBr₂).

The decomposition products of Halon 1301 have a characteristic sharp, acrid odor, even in minute concentrations of only a few parts per million. This characteristic provides a built-in warning system for the agent, but at the same time creates a noxious, irritating atmosphere for those who must enter the hazard following the fire.

The amount of Halon 1301 that can be expected to decompose in extinguishing a fire depends to a large extent on the size of the fire, the concentration of Halon vapor, and the length of time that the agent is in contact with flame or heated surfaces above 900°F (482°C). If there is a very rapid buildup

of concentration to the critical value, the fire will be extinguished quickly, and there will be little decomposition. The actual concentration of the decomposition products must then depend on the volume of the room in which the fire was burning and on the degree of mixing and ventilation. For example, extinguishment of a 25 ft² (2.3 m²) heptane fire in a 10,000 ft³ (283 m³) enclosure within 0.5 second produced only 12 ppm HF. A similar test having an extinguishment time of 10 seconds produced an average HF level of 250 ppm over a 9-minute period.

Clearly, longer exposure of the vapor to temperatures in excess of 900°F (482°C) would produce greater concentrations of these gases. The type and sensitivity of detection, coupled with the rate of discharge, should be selected to minimize the exposure time of the vapors to the elevated temperature if the concentration of breakdown products must be minimized. In most cases the area would be untenable for human occupancy due to the heat and breakdown products of the fire itself.

Annex E Storage Containers

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

E.1 Storage Containers. Storage containers for Halon 1301 must be capable of withstanding the total pressure exerted by the Halon 1301 vapor plus the nitrogen partial pressure, at the maximum temperature contemplated in use. Generally, steel cylinders meeting US Department of Transportation requirements will be used. Manifolded cylinders are used for large installations.

Each container must be equipped with a discharge valve capable of discharging liquid Halon 1301 at the required rate. Containers with top-mounted valves require an internal dip tube extending to the bottom of the cylinder to permit discharge of liquid phase Halon 1301.

E.1.1 Nitrogen Superpressurization. Although the 199 psig (1372 kPa) vapor pressure of Halon 1301 at 70°F (21°C) is adequate to expel the contents of the storage containers, this pressure decreases rapidly with temperature. At 0°F (-18°C), for example, the vapor pressure is 56.6 psig (390 kPa), and at -40°F (-40°C) it is only 17.2 psig (119 kPa). The addition of nitrogen to Halon 1301 storage containers to pressurize the agent above the vapor pressure, called "superpressurizing," will prevent the container pressure from decreasing so drastically at low temperatures.

Superpressurization causes some of the nitrogen to permeate the liquid portion of the Halon 1301. This "solubility" is related both to the degree of superpressurization and to temperature, as follows:

[E.1.1]

$$H_{x} = \frac{P_{n}}{X_{-}}$$

where:

 H_x = Henry's Law constant, psi (bar) per mole fraction

 P_n = partial pressure of nitrogen above solution, psi (bar)

 X_n = nitrogen concentration in liquid Halon 1301, mole fraction

Nitrogen partial pressure can be calculated from the total pressure of the system and the vapor pressure of Halon 1301 [see Figure E.1.1(a) and Figure E.1.1(b)] as follows:

(1)
$$P_n = P - (1 - X_n)P_v$$

$$(2) P = P_n + P_a$$

where:

 P_a = partial pressure of agent vapor P_v = vapor pressure of agent

By ideal solution law

(3) $P_a = P_v X_a$

where:

 P_v = vapor pressure of agent

 X_a = liquid mole fraction of agent

(4) $X_a = 1 - X_n$, where X_n is liquid mole fraction of nitrogen

From (2), (3), (4) we get

(5)
$$P = P_n + (1 - X_n)P_v$$
, which is (1)

Figure E.1.1(a) and Figure E.1.1(b) (Metric) show that variation of Henry's Law constant, H_{xy} with temperature.

Isometric diagrams for Halon 1301 superpressurized with nitrogen, Figure E.1.1(c), Figure E.1.1(d) (Metric) [360 psig (2482 kPa)], and Figure E.1.1(e), Figure E.1.1(f) (Metric) [600 psig (4137 kPa)] show the relationship of storage container pressure vs. temperature with lines of constant fill density.

These curves demonstrate the danger in overfilling containers with Halon 1301. A container filled completely with Halon 1301 at 70°F (21°C) and filled to 97.8 lb/ft³ (1566 kg/m³) and subsequently superpressurized to 600 psig (4137 kPa) would develop a pressure of 3000 psig (20685 kPa) when heated to 130°F (54°C); if filled to 70 lb/ft³ (1121 kg/m³) or less as permitted in this standard, a pressure of 1040 psig (7171 kPa) would be developed. The same principles apply to liquid Halon 1301 that becomes trapped between two valves in pipelines. Adequate pressure relief should always be provided in such situations.

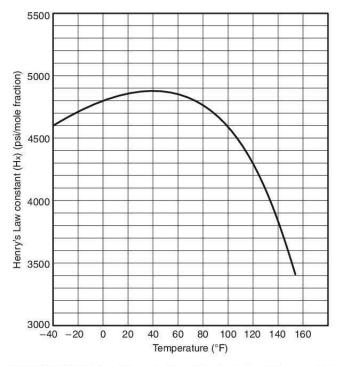


FIGURE E.1.1(a) Henry's Law Constant for Nitrogen Solubility in Liquid Halon 1301.

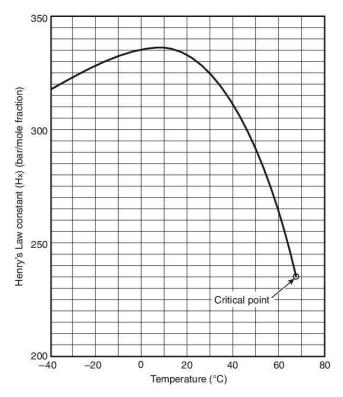


FIGURE E.1.1(b) Henry's Law Constant for Nitrogen Solubility in Liquid Halon 1301 (Metric).

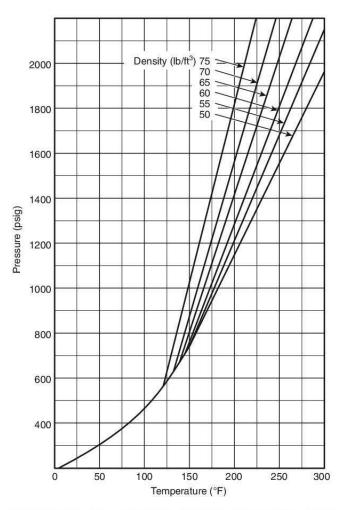


FIGURE E.1.1(c) $\,$ Isometric Diagram. Halon 1301 Pressurized to 360 psig at 70 $^{\circ}\text{F}.$

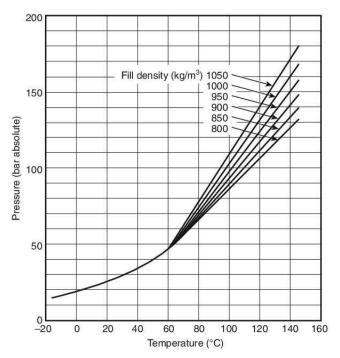


FIGURE E.1.1(d) Isometric Diagram. Halon 1301 Pressurized to 2482 kPa at 21°C (Metric).

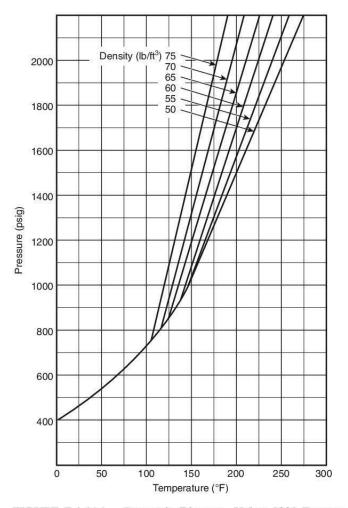


FIGURE E.1.1(e) $\,$ Isometric Diagram. Halon 1301 Pressurized to 600 psig at $70\,^{\circ}\text{F}.$

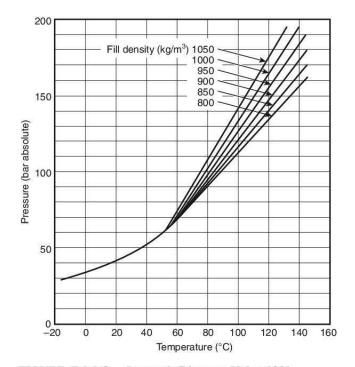


FIGURE E.1.1(f) Isometric Diagram. Halon 1301 Pressurized to 4137 kPa at 21°C (Metric).

Annex F Piping

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

- **F.1 Introduction.** The development of the pipe and fittings specifications in this standard is based on field experience and the application of the data and calculation methods found in ASME pipe and fittings codes. Paragraph 4.2.1.1 requires that "the thickness of the pipe wall shall be calculated in accordance with ASME B31.1." The text of Annex F is taken from ASME B31.1. The information in Section 4.2, Annex A, and Annex F is based on the equations for calculation of pipe wall thickness found in ASME B31.1. The SE values stated in this annex allow calculation of the minimum wall thickness of pipe to be used in Halon 1301 systems. Section F.2 presents calculations to provide minimum pipe schedules (wall thickness) for use with both 360 psi (2482 kPa) and 600 psi (4137 kPa) Halon 1301 fire extinguishing systems in accordance with this standard.
- F.2 Minimum Piping Requirements for Halon 1301 Systems with 360 psi (2482 kPa) and 600 psi (4137 kPa) Charging Pressure. Limitations on piping to be used for halon systems (or any pressurized fluid) are set by the following:

(1) Maximum pressure expected within the pipe

- Material of construction of the pipe and tensile strength, yield strength, and temperature limitations of the material
- (3) Joining methods (i.e., threaded, welded, grooved)
- (4) Pipe construction method [i.e., seamless, electric resistance welded (ERW), furnace welded]
- (5) Pipe diameter
- (6) Wall thickness of the pipe

The calculations are based on the following:

- (1) The minimum calculated pressure is 1000 psi (6895 kPa) for systems using an initial charging pressure of 600 psi (4137 kPa) and 620 psi (4275 kPa) for systems using an initial charging pressure of 360 psi (2482 kPa).
- (2) The calculations apply only to steel pipe conforming to ASTM A53/A53M or ASTM A106/A106M, and copper tubing conforming to ASTM B88.
- (3) The calculations cover threaded, welded, and grooved joints for steel pipe and compression fittings for copper tubing.

The basic equation to find the minimum wall thickness for piping under internal pressure is as follows:

[F.2a]

$$t = \frac{PD}{2SE} + A$$

where:

t = required wall thickness (in.)

P = maximum allowable pressure (psi)

D = outside pipe diameter (in.)

A = allowance for threading, grooving, etc. (in.)

SE = maximum allowable stress including joint efficiency (psi)

Note: For these calculations,

A = depth of thread for threaded connections

A =depth of groove for cut groove connections

A =zero for welded or rolled groove connections

A = zero for joints in copper tubing using compression fittings

The term SE is defined as $\frac{1}{4}$ of the tensile strength of the piping material or $\frac{2}{3}$ of the yield strength (whichever is lower) multiplied by a joint efficiency factor.

Joint efficiency factors are as follows:

- (1) 1.0 for seamless
- (2) 0.85 for ERW
- (3) 0.60 for furnace butt weld (continuous weld) (Class F)

The values for SE in Table F.2(a) are taken from Appendix A of ASME B31.1. Identical values are given in ASME B31.9.

The basic equation can be rewritten as follows to solve for P to determine the maximum allowable pressure for which a pipe of thickness t can be used:

[F.2b]

$$P = 2SE \frac{t - A}{D}$$

As required by 4.2.1.1 of this standard, for systems having a charging pressure of 360 psi (2482 kPa), the calculated pressure (*P*) must be equal to or greater than 620 psi (4275 kPa).

For systems having a charging pressure of 600 psi (4137 kPa), the calculated pressure (P) must be equal to or greater than 1000 psi (6895 kPa).

These pressure values are based on a maximum agent storage temperature of 130° F (54° C).

If higher storage temperatures are approved for a given system, the internal pressure should be adjusted to the maximum internal pressure at maximum temperature. In performing this calculation, all joint factors and threading, grooving, or welding allowances should be taken into account.

Paragraph 102.2.4(B) of ASME B31.1 allows the maximum allowable stress (SE) to be exceeded by 20 percent if the duration of the pressure (or temperature) increase is limited to less than 1 percent (14.4 minutes) of any 24-hour period. Since the halon piping is normally unpressurized, the system discharge period typically satisfies this criterion. Therefore, the piping calculations set out in this paragraph are based on values of SE, which are 20 percent greater than those shown in Table F.2(a) outlined in Paragraph 4 (per Appendix A of the Power Piping Code). The specific values for maximum allowable stress used in these calculations are given in Table F.2(b).

Notes:

(1) When rolled groove connections or welded connections with internal projections (backup rings, etc.) are used, the hydraulic calculations should consider the additional losses due to friction.

- (2) Pipe supplied as dual stenciled A120/A53 Class F meets the requirements of Class F furnace welded pipe ASTM A53/A53M as listed previously. Ordinary cast-iron pipe, steel pipe conforming to ASTM A120, or nonmetallic pipe should not be used.
- (3) All grooved couplings/fittings should be listed/approved for use with Halon 1301 extinguishing systems.
- (4) These calculations do not apply to extended discharge exceeding 14.4 minutes.
- (5) Compression fittings should be listed or approved for use with the type of tubing and pressures per 4.2.3 of this standard [600 psi (4137 kPa) systems 1000 psi (6895 kPa) working pressure; 360 psi (2482 kPa) systems 620 psi (4275 kPa) working pressure].

Table F.2(a) SE Values for Pipe and Tubing per ASME B31.1

Pipe/Tubing Grade/Type	Pipe Specification	SE Value (psi)	SE Value (kPa)
Grade C seamless pipe	ASTM A106/ A106M	17,500	120,662
Grade B seamless pipe	ASTM A53/ A53M	15,000	103,425
Grade B seamless pipe	ASTM A106/ A106M	15,000	103,425
Grade A seamless pipe	ASTM A53/ A53M	12,000	82,740
Grade A seamless pipe	ASTM A106/ A106M	12,000	82,740
Grade B ERW pipe	ASTM A53/ A53M	12,800	88,256
Grade A ERW pipe	ASTM A53/ A53M	10,200	70,329
Class F furnace welded pipe	ASTM A53/ A53M	7,200	49,608
Seamless copper tubing (annealed)	ASTM B88	5,100	35,164
Seamless copper tubing (drawn)	ASTM B88	9,000	62,055

Table F.2(b) SE Values for Pipe and Tubing That Is Pressurized for Less than 14.4 Minutes per 24-Hour Period

Pipe/Tubing Grade/Type	Pipe Specification	SE Value (psi)	SE Value (kPa)
Grade C seamless pipe	ASTM A106/ A106M	21,000	144,795
Grade B seamless pipe	ASTM A53/ A53M	18,000	124,110
Grade B seamless pipe	ASTM A106/ A106M	18,000	124,110
Grade A seamless pipe	ASTM A53/ A53M	14,400	99,288
Grade A seamless pipe	ASTM A106/ A106M	14,400	99,288
Grade B ERW	ASTM A53/ A53M	15,360	105,907
Grade A ERW pipe	ASTM A53/ A53M	12,240	84,395
Class F furnace welded pipe	ASTM A53/ A53M	8,640	59,573
Seamless copper tubing (annealed)	ASTM B88	6,120	42,197
Seamless copper tubing (drawn)	ASTM B88	10,800	74,466

Annex G System Flow Calculations

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

G.1 Introduction. The flow of nitrogen-pressurized Halon 1301 has been demonstrated to be a two-phase phenomenon; that is, the fluid in the piping consists of a mixture of liquid and vapor. In past editions of this standard, an effort was made to detail a portion of a complex calculation method that is used to determine pipeline pressures, densities, and other design factors. All the factors necessary for this very complex calculation were not listed. For example, the formulas that address heat transfer between the agent and the piping network were not included nor were the adjustments for the flow of agent through a tee. Many of the necessary final adjustments to the calculations are proprietary. Without this data, and much more, no flow calculation for unbalanced systems can be precise enough.

The tables, graphs, and calculations used in this section are provided to demonstrate the basis on which many calculation methods are founded. This information is not adequate and must not be considered as complete enough for design purposes. Only those calculation methods that are listed should be used for design purposes. Figure G.1 provides a comparison of test data with calculated pressure drop using a two-phase flow equation.

Friction losses occur as the liquid Halon 1301 flows through the pipeline to the discharge orifice. Allowance must be made for the equivalent lengths of the container valve, dip tube, and flexible connectors, selector valves, time delays, and other installed equipment through which the agent must flow. Equivalent lengths for these components must be obtained from the approval laboratory listings for the individual components. Equivalent lengths of common pipe fittings and values are given in Table G.1(a) and Table G.1(b).

Changes in elevation are accounted for by the following equation:

$$\Delta P = \frac{\rho(\Delta EL)}{144}$$

where:

 ΔP = pressure drop (psi)

ρ = pipeline density of agent at point of elevation change (lb/ft³)

 ΔEL = net change in elevation within the piping section, increase (+) and decrease (-)

Design flow rates should be high enough to ensure complete mixing of the liquid and vapor phases in the pipeline.

For proper system flow calculation and performance, it is necessary that a homogenous mixture of the liquid and vapor phases be present during equilibrium pipeline flow.

In other words, highly turbulent flow is required in the pipeline to prevent separation of the liquid and vapor phases. Turbulent flow is generally attained when pipeline flow rates exceed the minimum flow rates given in Table G.1(c).

Table G.1(a) Equivalent Length in Feet of Threaded Pipe Fittings Schedule 40 Steel Pipe

Pipe Size (in.)	Elbow Std. 45°	Elbow Std. 90°	Elbow 90° Long Rad. & Tee Thru Flow	Tee Side	Union Coupling or Gate Valve
3/8	0.6	1.3	0.8	2.7	0.3
3/8 1/2 3/4 1 1 ¹ / ₄	0.8	1.7	1.0	3.4	0.4
3/4	1.0	2.2	1.4	4.5	0.5
1	1.3	2.8	1.8	5.7	0.6
$1\frac{1}{4}$	1.7	3.7	2.3	7.5	0.8
$1\frac{1}{2}$	2.0	4.3	2.7	8.7	0.9
2	2.6	5.5	3.5	11.2	1.2
$2\frac{1}{2}$	3.1	6.6	4.1	13.4	1.4
2 2½ 3	3.8	8.2	5.1	16.6	1.8
4	5.0	10.7	6.7	21.8	2.4
5 6	6.3	13.4	8.4	27.4	3.0
6	7.6	16.2	10.1	32.8	3.5


Table G.1(b) Equivalent Length in Feet of Welded Pipe Fittings Schedule 40 Steel Pipe

Pipe Size (in.)	Elbow Std. 45°	Elbow Std. 90°	Elbow 90° Long Rad. & Tee Thru Flow	Tee Side	Union Coupling or Gate Valve
3/8	0.2	0.7	0.5	1.6	0.3
3/8 1/2 3/4 1 1 1 1/4	0.3	0.8	0.7	2.1	0.4
3/4	0.4	1.1	0.9	2.8	0.5
1	0.5	1.4	1.1	3.5	0.6
$1\frac{1}{4}$	0.7	1.8	1.5	4.6	0.8
$1\frac{1}{2}$	0.8	2.1	1.7	5.4	0.9
2	1.0	2.8	2.2	6.9	1.2
$\frac{2}{2\frac{1}{2}}$	1.2	3.3	2.7	8.2	1.4
3	1.5	4.1	3.3	10.2	1.8
4	2.0	5.4	4.4	13.4	2.4
5 6	2.5	6.7	5.5	16.8	3.0
6	3.0	8.1	6.6	20.2	3.5

Table G.1(c) Minimum Design Flow Rates to Achieve Turbulent Pipeline Flow

Nominal Pipe Diameter (in.)	Schedule 40 Minimum Flow Rate (lb/sec)	Schedule 80 Minimum Flow Rate (lb/sec)
1/8	0.20	0.11
1/8 1/4 3/8 1/2 3/4 1	0.34	0.24
3/8	0.68	0.48
1/2	1.0	0.79
3/4	2.0	1.9
1	3.4	2.8
$1\frac{1}{4}$	5.8	4.8
$1\frac{1}{2}$	8.4	7.5
2	13	13
$2\frac{1}{2}$	19.5	17
3	33	26
2 2½ 3 4	58	48
5	95	81
6	127	109

Note: For SI units, 1 lb/sec = 0.454 kg/s.



For SI units: 1 ft = 0.3048 m; 1 psi = 0.0689 bar.

 $\begin{tabular}{ll} FIGURE~G.1 & Comparison~of~Test~Data~with~Calculated~Pressure~Drop~Using~Two-Phase~Flow~Equation. \end{tabular}$

Annex H Nozzles

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

H.1 Introduction. The discharge nozzle is the device that ultimately delivers the agent to the hazard area. Its function is twofold: (1) It distributes the agent in an optimum manner in the hazard, and (2) it controls the system discharge rates. The maximum nozzle flow rate is controlled by the flow that the feed pipe can deliver. The maximum pipeline flow rate can be theoretically calculated by means of the two-phase equation. Figure H.1(a) shows the calculated maximum open-end pipe specific flow rate versus total terminal pressure. The general shape of the curve is also characteristic of nozzle flow curves.

Since the flow rate discharged from a nozzle or pipe depends on the energy available, the terminal pressure must be considered to consist of two parts: (1) the static pressure (the quantity calculated by the pipeline pressure drop), and (2) the velocity head energy.

Both quantities can contribute to the energy available to discharge the agent from the nozzle. The velocity head in psi can be calculated from the following equation:

[H.1a]

velocity head =
$$\frac{(3.63)(Q^2)}{\rho D^4}$$

where:

Q = nozzle rate (lb/sec)

 ρ = density (lb/ft³) at the terminal static pressure

D =feed pipe diameter (in.)

NOTE: The calculation method described in this standard is based on 70°F (21°C). For unbalanced systems, if the agent storage temperature is expected to vary by more than 10°F (5.5°C) from this temperature, the actual agent quantity discharged from each nozzle can vary significantly from the calculated agent distribution.

Flow calculations should be based on average pressure conditions existing in the system when half of the agent has been discharged from the nozzles. The average pressure in the storage container is determined on the basis of the pressure recession in the storage container and the effect of percent of agent in the piping during discharge. The calculated pressure recession for both 600 and 360 psi (4137 and 2482 kPa) storage is plotted in Figure H.1(b) and Figure H.1(c), respectively.

The rate of pressure recession in the storage container depends on the initial filling density as illustrated in Figure H.1(b) and Figure H.1(c). If the pipeline has negligible volume compared to the quantity of agent to be discharged, the average container pressure for pressure drop calculations would be the point in the recession curve where 50 percent of the charge has been expelled from the container. In many systems this will not be the case because a substantial portion of the charge will reside in the piping during discharge, reducing the average container pressure during actual discharge from the nozzle.

Figure H.1(d) illustrates the condition where 20 percent of the agent supply by weight resides in the piping during discharge. The average storage pressure for flow calculation for the 600 psi (4137 kPa) system with initial filling density of 70 lb/ft³ (1121 kg/m³) is reduced from a maximum of 403 psi (2779 kPa) to 355 psi (2448 kPa). Proceeding in this way, the average container pressure for flow calculation is a logical function of the percent of agent in the piping as given in Figure H.1(e). Several factors combine to allow a simple extrapolation of the average storage container pressure versus percent of agent in the piping curves up to a calculated 80 percent of the supply in the pipeline.

The percent of agent in piping is defined by the following equation and should not exceed 80 percent of the charged weight:

[H.1b]

percent in piping =
$$100\sum \frac{(Vp)(\rho)}{W}$$

where:

 Σ = summation of $(Vp)(\rho)$ values for all pipeline sections

Vp = internal volume of each section of piping (ft³)

 ρ = average pipeline density of agent for each section of piping (lb/ft³)

W = initial charge weight of Halon 1301 (lb)

The average density cannot be accurately determined until after the terminal pressure has been calculated. The problem does not have a direct solution; however, Equation H.1c and Table H.1(a) can be used to estimate the percent in piping for calculating purposes. This is based on the probability that the terminal pressure will be near the minimum permitted. Table H.1(b) and Table H.1(c) can be used to calculate the internal volume of the pipe.

[H.1c]

percent in piping =
$$\frac{K_1}{(W/V_p) + K_2}$$

where:

W = initial charge weight of Halon 1301 (lb)

 V_p = internal pipe volume (ft³) K_1 , K_2 = constants from Table H.1(a)

An alternative solution is to use Equation H.1(b) with the average density values from Figure H.1(f) for the 600 psi (4137 kPa) systems and from Figure H.1(g) for the 360 psi (2482 kPa) systems.

For piping systems, pressure drop should be calculated by means of the following two-phase equation or by any other method approved by the authority having jurisdiction:

[H.1d]

$$Q^2 = \frac{1.013D^{5.25}Y}{L + 8.08D^{1.25}Z}$$

where:

Q = flow rate (lb/sec)

 \vec{D} = inside pipe diameter (in.)

L = equivalent length of pipe (ft)

Y, Z = factors depending on density and pressure

NOTE: This flow equation contains a friction factor based on commercial steel pipe.

The two-phase flow equation becomes specific for Halon 1301 when the Y and Z factors are based on the proper pressure and density values using the following equations:

[H.1e]

$$Y = -\int_{P_1}^{P} \rho \Delta P$$

[H.1f]

$$Z = \ln \frac{\rho_{\rm i}}{\rho}$$

where:

 P_1 = storage pressure (psia)

P = pipeline pressure (psia)

 ρ_1 = density at pressure P_1 (lb/ft³)

 $\rho = \text{density at pressure } P (\text{lb/ft}^3)$

ln = natural logarithm

A direct solution of the flow equation for pressure is not possible; however, the equation can be rearranged to solve for *Y*, which is related to pressure:

[H.1g]

$$Y_2 = Y_1 + \frac{LQ^2}{A} + B(Z_2 - Z_1)Q^2$$

where:

 $Y_1 = Y$ factor at start of section

 $Y_2 = Y$ factor at end of section

 $Z_1 = Z$ factor at start of section

 $Z_9 = Z$ factor at end of section

 $A = 1.013 D^{5.25}$

 $B = 7.97/D^4$

L = equivalent length of section (ft)

Q = flow rate (lb/sec)

 \vec{D} = inside diameter of pipe (in.)

NOTE: A and B factors are for steel pipe.

Precalculated A and B factors for steel pipe are given in Table H.1(d).

The *Y* and *Z* factors depend on both storage pressure and filling density; therefore, separate tables are required for each storage condition. Table H.1(e) through Table H.1(h) are for the 600 psi (4137 kPa) systems with filling densities of 70, 60, 50, and 40 lb/ft³. Table H.1(i) through Table H.1(l) are for the 360 psi (2482 kPa) systems with the same filling densities.

Sample Calculation. An 80 lb (36 kg) supply of agent is to be discharged in 10 seconds through the piping system shown in Figure H.1(h). The agent storage container is pressurized to 360 psi (2482 kPa) and has a filling density of 70 lb/ft 3 (1121 kg/m 3). Table H.1(m) shows the two-phase solution.

(1) Calculate A and B:

For 1 in. pipe, A = 1.302 and B = 6.59.

For $\frac{3}{4}$ in. pipe, A = 0.3666 and B = 17.3.

(2) Determine piping volume using Table H.1(b).

For 1 in. pipe, $V_P = 0.0060 \text{ ft}^3/\text{ft x } 27 \text{ ft} = 0.162 \text{ ft}^3$

For $\frac{3}{4}$ in. pipe, $V_P = 0.0037$ ft³/ft x 30 ft = 0.111 ft³

Total $V_P = 0.273 \text{ ft}^3$

(3) Estimate percent in piping, using the following equation:

[H.1h]

% in piping =
$$\frac{6730}{(80/0.273) + 52} = 19.5\%$$

- (4) Determine average container pressure during discharge using Figure H.1(e), based on the estimated 19.5 percent in piping the average storage container pressure is 243 psi (1675 kPa).
- (5) Calculate the elevation correction. Before calculating pressure drop due to friction, the pressure change due to elevation in Section 1-2 of Table H.1(m) must be calculated. The relationship in G.1 is used:

[H.1i]

$$\Delta P = \frac{\rho(\Delta EL)}{144}$$

The elevation change (*EL*) is 7 ft. The density (ρ) of the Halon 1301 at the 243 psi (1675 kPa) starting pressure of the section is found to be 83 lb/ft³ in Figure H.1(g) on the 70 lb/ft³ fill density curve. The pressure loss due to the 7 ft increase in elevation is

[H.1j]

$$P = \frac{83 \times 7}{144} = 4 \text{ psi}$$

The new starting pressure is 243 - 4 = 239 psi.

(6) Determine Y_1 and Z_1 from Table H.1(i). For a starting pressure of 239 psi,

[H.1k]

$$Y_1 = 2819$$
 and $Z_1 = 0.173$

(7) Determine Y_2 from the following equation:

[H.11]

$$Y_2 = Y_1 + \left(\frac{LQ^2}{A}\right) + B(Z_2 - Z_1)Q^2$$

$$= 2819 + \frac{58(8)^2}{1309} + 6.59(Z_2 - 0.173)(8)^2$$

The Z term is small and can be neglected for an initial solution:

[H.1m]
$$Y_9 = 5670$$

(8) Determine terminal pressure. The terminal pressure of Section 1-2 of Table H.1(m) is approximately 200 psi from Table H.1(i). At this point the Zfactor is about 0.475. Using this value for Z₂, the last term of the equation becomes 127. Then,

$$[{\bf H.1n}]$$
 $Y_{2} = 5670 + 127 = 5797$

The final terminal pressure of Section 1

The final terminal pressure of Section 1-2 is then between 198 and 197 psi. Use 197 psi.

(9) Sections 2-3 and 2-4. For the next section,

[H.1o]
$$Y_2 = 5797 + \frac{19(4)^2}{0.366} + 17.3(Z_2 - 0.475)(4)^2$$
$$= 6628$$

Terminal pressure = 182 psi

[H.1p]

$$Z_2 = 0.652$$

 $Y_2 = 6628 + 17.3(0.652 - 0.475)(4)^2$
 $= 6628 + 49 = 6677$

Terminal pressure is between 182 and 181 psi. Use 181 psi.

The solution would then be reiterated until reasonable agreement between the estimated percent in the pipe and the final calculated quantity is obtained. Such reiteration is, however, time consuming and subject to numerical error when manual calculation means are used. For this reason, the two-phase method is normally used with a programmed computer.

In unbalanced systems, it is important to use the proper orifice size at each nozzle to give the desired flow rate at the calculated terminal pressure. This is based on the flow characteristics of individual nozzles as provided in the manufacturer's design manual. In no case should the nozzle pressure be lower than the listed minimum pressure.

Table H.1(a) Constants to Determine Percent of Agent in Piping

Storage (psi)	Filling Density	K_1	K_2
600	70	7180	46
600	60	7250	40
600	50	7320	34
600	40	7390	28
360	70	6730	52
360	60	6770	46
360	50	6810	40
360	40	6850	34

Table H.1(b) Internal Volume of Steel Pipe Cubic Feet per Foot of Length

Nominal Pipe Diameter		dule 40 Diameter	Schedule 80 Inside Diameter		
in.	in.	ft ³ /ft	in.	ft ³ /ft	
1/4	0.364	0.0007	0.302	0.0005	
3/8	0.493	0.0013	0.423	0.0010	
1/2	0.622	0.0021	0.546	0.0016	
3/4	0.824	0.0037	0.742	0.0030	
1	1.049	0.0060	0.957	0.0050	
$1\frac{1}{4}$	1.380	0.0104	1.278	0.0089	
$1\frac{1}{2}$	1.610	0.0141	1.500	0.0123	
2	2.067	0.0233	1.939	0.0205	
$2\frac{1}{2}$	2.469	0.0332	2.323	0.0294	
3	3.068	0.0513	2.900	0.0459	
$3\frac{1}{2}$	3.548	0.0687	3.364	0.0005 0.0010 0.0016 0.0030 0.0050 0.0089 0.0123 0.0205 0.0294	
4	4.026	0.0884	3.826	0.0798	

Table H.1(c) Internal Volume of Copper Tubing

Size	Туре	Actual Inside Diameter (in.)	Internal Volume (ft ³ /ft)
1/4	M	_	
/4	L	0.315	0.0005
	K	0.305	0.0005
3/8	M M	0.450	0.0003
/8	L	0.430	0.0011
	K	0.402	0.0010
1/2	M M	0.569	
/2	L	0.545	$0.0018 \\ 0.0016$
	K	0.527	
3/			0.0015
3/4	M	0.811	0.0037
	L	0.785	0.0034
	K	0.745	0.0030
1	M	1.055	0.0061
	\mathbf{L}	1.025	0.0057
180	K	0.995	0.0054
$1\frac{1}{4}$	M	1.291	0.0091
	L	1.265	0.0087
	K	1.245	0.0085
$1\frac{1}{2}$	M	1.527	0.0127
	L	1.505	0.0124
	K	1.481	0.0120
2	M	2.009	0.0220
	L	1.985	0.0215
	K	1.959	0.0209
$2\frac{1}{2}$	M	2.495	0.0340
	L	2.465	0.0331
	K	2.435	0.0323
3	M	2.981	0.0485
	L	2.945	0.0473
	K	2.907	0.0461
$3\frac{1}{2}$	M	3.459	0.0653
	L	3.425	0.0640
	K	3.385	0.0625
4	M	3.935	0.0845
~· 2	L	3.905	0.0832
	K	3.857	0.0811

Table H.1(d) A and B Factors for Steel Pipe

Pipe Size	Sched	ule 40	Sched	ule 80	
Nominal	A	В	A	В	
3/8	0.02472	135.0	0.01106	249.0	
1/2	0.08375	53.3	0.04225	89.7	
3/4	0.3666	17.3	0.2115	26.3	
1	1.302	6.59	0.8043	9.51	
$1\frac{1}{4}$	5.495	2.20	3.672	2.99	
$1\frac{1}{2}$	12.34	1.19	8.513	1.58	
2	45.83	0.437	32.76	0.564	
$2\frac{1}{2}$	115.3	0.216	84.6	0.274	
3	364.4	0.090	271.1	0.113	
4	1518.0	0.0304	1162.0	0.0372	
5	4972.0	0.0123	3875.0	0.0149	
6	13050.0	0.00589	9959.0	0.00724	

Table H.1(e) Halon 1301 at 600 psi and 70 lb/ft 3Y and Z Factors

							Y						
psi	Z	0	1	2	3	4	5	6	7	8	9		
400	0.006	290	194	97	0	0	0	0	0	0	0		
390	0.028	1243	1149	1054	960	865	769	674	578	482	386		
380	0.051	2176	2084	1991	1898	1806	1712	1619	1525	1432	1338		
370	0.076	3086	2996	2906	2816	2725	2634	2543	2451	2360	2268		
360	0.102	3974	3886	3798	3710	3622	3533	3444	3355	3266	3176		
350	0.129	4838	4753	4667	4581	4495	4409	4323	4236	4149	4069		
340	0.159	5678	5595	5512	5428	5345	5261	5177	5093	5008	4923		
330	0.191	6492	6412	6331	6251	6169	6088	6007	5925	5843	5760		
320	0.224	7281	7203	7125	7047	6968	6890	6811	6731	6652	6575		
310	0.260	8042	7967	7892	7816	7741	7665	7588	7512	7435	7358		
300	0.298	8776	8704	8631	8559	8486	8413	8339	8265	8191	811′		
290	0.339	9482	9412	9343	9273	9203	9132	9062	8991	8919	8848		
280	0.382	10158	10092	10025	9958	9891	9823	9756	9688	9619	955		
270	0.429	10805	10741	10678	10614	10550	10485	10420	10355	10290	1022		
260	0.478	11421	11361	11300	11239	11178	11117	11055	10993	10930	1086		
250	0.531	12007	11950	11892	11834	11776	11718	11659	11600	11541	1148		
240	0.588	12561	12507	12453	12398	12343	12288	12232	12176	12120	1206		
230	0.649	13084	13033	12982	12930	12878	12826	12774	12721	12668	12613		
220	0.713	13575	13527	13479	13431	13382	13333	13284	13234	13184	13134		
210	0.782	14034	13990	13945	13900	13854	13808	13762	13716	13669	13622		
200	0.855	14462	14421	14379	14337	14295	14252	14209	14166	14122	14078		
190	0.934	14859	14820	14782	14743	14704	14664	14624	14584	14544	14503		
180	1.017	15225	15190	15154	15118	15082	15046	15009	14972	14934	1489		
170	1.105	15561	15528	15496	15463	15430	15396	15363	15329	15294	15260		
160	1.198	15868	15838	15809	15779	15748	15718	15687	15656	15624	15593		
150	1.297	16146	16120	16093	16066	16038	16010	15982	15954	15926	1589'		
140	1.402	16398	16374	16350	16325	16301	16276	16250	16225	16199	1617		
130	1.513	16624	16603	16581	16559	16537	16514	16491	16469	16445	1642		
120	1.631	16826	16807	16787	16768	16748	16728	16708	16687	16666	1664		
110	1.755	17004	16987	16970	16953	16935	16918	16900	16882	16863	1684		
100	1.888	17161	17147	17132	17116	17101	17085	17070	17054	17037	1702		
90	2.029	17298	17286	17273	17259	17246	17232	17219	17205	17190	1717		
80	2.181	17417	17406	17395	17383	17372	17360	17348	17336	17324	1731		
70	2.347	17518	17509	17499	17489	17479	17469	17459	17449	17438	1742		
60	2.530	17603	17595	17587	17579	17571	17562	17554	17545	17536	1752		

Table H.1(f) Halon 1301 at 600 psi and 60 lb/ft 3Y and Z Factors

						3	Y							
psi	Z	0	1	2	3	4	5	6	7	8	9			
420	0.019	956	861	766	671	575	480	384	289	193	96			
410	0.039	1893	1800	1707	1614	1520	1426	1333	1239	1144	1050			
400	0.060	2811	2720	2629	2537	2446	2354	2262	2170	2078	1985			
390	0.083	3709	3620	3531	3442	3352	3262	3172	3082	2992	2901			
380	0.106	4587	4500	4413	4325	4238	4150	4062	3974	3886	3798			
370	0.132	5443	5358	5273	5188	5103	5017	4932	4846	4760	4673			
360	0.158	6277	6195	6112	6029	5946	5863	5779	5696	5612	5527			
350	0.187	7089	7009	6929	6848	6767	6686	6605	6523	6442	6360			
340	0.217	7877	7800	7722	7643	7565	7486	7407	7328	7249	7169			
330	0.249	8642	8566	8491	8415	8339	8263	8186	8109	8032	7955			
320 310	0.283 0.319	9381 10095	9308 10025	9235 9954	9162 9883	9088 9812	$9014 \\ 9741$	8940 9670	8866 9598	8791 9526	8717 9454			
	0.319	10095	10023	9934	9003	9012	9741	9070	9390	9520	9434			
300 290	0.358 0.399	10783 11444	10715 11379	10647 11314	10579 11248	10511 11183	$10442 \\ 11117$	$10373 \\ 11050$	10304 10984	10235 10917	$10165 \\ 10850$			
280 270	0.442 0.489	$\frac{12077}{12683}$	12015 12624	11953 12564	$11890 \\ 12504$	11827 12444	11764 12384	$11701 \\ 12323$	$\frac{11637}{12262}$	11573 12201	11508 12139			
260 250	0.538 0.591	13261 13809	13204 13756	13148 13702	13090 13648	13033 13593	12976 13539	12918 13484	12859 13428	12801 13373	12742 13317			
240 230	$0.647 \\ 0.707$	$\frac{14329}{14820}$	$\frac{14278}{14772}$	14227 14724	$14176 \\ 14675$	$\frac{14125}{14627}$	$14073 \\ 14578$	14021 14529	13968 14479	13916 14430	13863 14379			
220	0.770	15281	15236	15191	15145	15100	15054	15008	14961	14914	14867			
210	0.838	15713	15671	15629	15586	15543	15500	15457	15413	15369	15325			
200	0.909	16116	16077	16037	15998	15958	15918	15877	15837	15796	15754			
190	0.985	16490	16454	16417	16381	16344	16306	16269	16231	16193	16154			
180	1.066	16836	16802	16769	16735	16701	16666	16632	16597	16561	16526			
170	1.152	17154	17123	17093	17061	17030	16998	16966	16934	16902	16869			
160	1.243	17445	17418	17389	17361	17332	17303	17274	17244	17214	17184			
150	1.339	17711	17685	17660	17634	17608	17581	17555	17528	17501	17473			
140	1.441	17951	17928	17905	17882	17858	17834	17810	17786	17761	17736			
130	1.549	18168	18147	18126	18105	18084	18062	18041	18019	17996	17974			
120	1.664	18361	18343	18324	18306	18287	18267	18248	18228	18208	18188			
110	1.785	18534	18517	18501	18484	18467	18450	18433	18415	18398	18380			
100	1.914	18686	18671	18657	18642	18627	18612	18597	18581	18566	18550			
90	2.052	18818	18806	18793	18781	18767	18754	18741	18727	18714	18700			
80 70	2.201	18934	18923	18912	18901	18890	18878	18867	18855	18843	18831			
70	2.363	19032	19023	19014	19004	18995	18985	18975	18965	18955	18944			
60	2.543	19116	19108	19100	19092	19084	19076	19068	19059	19050	19041			

Table H.1(g) Halon 1301 at 600 psi and 50 lb/ft³Y and Z Factors

							Y				
psi	Z	0	1	2	3	4	5	6	7	8	9
450	0.012	667	573	478	382	287	192	96	0	0	0
440	0.030	1607	1513	1420	1327	1233	1139	1045	951	857	762
430	0.049	2529	2437	2346	2254	2162	2070	1978	1885	1792	1700
420	0.068	3434	3344	3254	3164	3074	2984	2893	2802	2711	2620
410	0.089	4321	4233	4145	4056	3968	3879	3791	3702	3613	3523
400	0.111	5189	5103	5017	4930	4844	4757	4670	4583	4496	4408
390	0.134	6038	5954	5870	5785	5701	5616	5531	5446	5360	5275
380	0.158	6867	6785	6702	6620	6538	6455	6372	6289	6205	6122
370	0.184	7675	7595	7515	7435	7354	7273	7192	7111	7030	6948
360	0.212	8462	8384	8306	8228	8150	8071	7992	7913	7834	7755
350	0.241	9227	9151	9076	9000	8924	8847	8771	8694	8617	8539
340	0.272	9970	9896	9823	9749	9675	9601	9527	9452	9377	9302
330	0.304	10689	10618	10547	10476	10404	10332	10260	10188	10115	10043
320	0.339	11385	11316	11247	11178	11109	11040	10970	10900	10830	10760
310	0.375	12056	11990	11924	11857	11790	11723	11656	11589	11521	11453
300	0.414	12702	12639	12575	12511	12447	12382	12318	12252	12187	12122
290	0.455	13324	13263	13201	13140	13078	13016	12954	12891	12829	12766
280	0.499	13919	13861	13802	13743	13684	13625	13565	13505	13445	13384
270	0.546	14488	14432	14376	14320	14264	14207	14150	14092	14035	13977
260	0.595	15031	14978	14924	14871	14817	14763	14708	14654	14599	14544
250	0.647	15546	15496	15445	15394	15343	15292	15240	15188	15136	15083
240	0.703	16035	15987	15939	15891	15842	15794	15745	15696	15646	15596
230	0.762	16496	16451	16406	16360	16315	16269	16222	16176	16129	16082
220	0.825	16930	16888	16845	16802	16759	16716	16673	16629	16585	16540
210	0.892	17337	17297	17257	17217	17177	17137	17096	17055	17013	16972
200	0.962	17716	17680	17642	17605	17568	17530	17492	17453	17415	17376
190	1.037	18069	18035	18001	17966	17931	17896	17861	17825	17789	17753
180	1.117	18396	18365	18333	18301	18269	18236	18203	17170	18137	18103
170	1.201	18698	18669	18639	18610	18580	18550	18520	18489	18459	18428
160	1.290	18974	18947	18921	18894	18866	18839	18811	18783	18755	18726
150	1.384	19226	19202	19178	19153	19128	19103	19078	19052	19026	19000
140	1.484	19455	19433	19411	19389	19366	19343	19320	19297	19274	19250
130	1.589	19662	19642	19622	19602	19582	19561	19540	19519	19498	19477
120	1.701	19847	19829	19811	19793	19775	19757	19738	19719	19700	19681
110	1.820	20012	19996	19981	19965	19948	19932	19915	19898	19881	19864
100	1.947	20158	20144	20130	20116	20102	20087	20073	20058	20043	20027
90	2.083	20286	20274	20262	20249	20237	20224	20211	20198	20185	20172
80	2.229	20397	20387	20376	20366	20355	20344	20333	20321	20310	20298
70	2.385	20493	20484	20475	20466	20457	20447	20437	20428	20418	20408
60	2.555	20574	20567	20559	20551	20543	20535	20527	20519	20510	20502

Table H.1(h) Halon 1301 at 600 psi and 40 lb/ft 3Y and Z Factors

340 0.325 12049 11980 11910 11841 11771 11701 11631 11561 11490 330 0.358 12727 12660 12593 12526 12458 12391 12323 12254 12186 320 0.393 13382 13318 13253 13188 13123 13057 12992 12926 12860 310 0.430 14014 13992 13890 13827 13764 13701 13638 13574 13510 300 0.469 14623 14563 14503 14443 14882 14321 14260 14199 14188 290 0.551 15767 15712 15657 15601 15546 15490 15434 15378 15321 260 0.555 15767 15712 15657 15601 15546 15490 15434 15378 15321 270 0.602 16302 16721 16662 16611 <								Y				
470	psi	z	0	1	2	3	4	5	6	7	8	9
470 0.024 1414 1321 1227 1134 1040 9469 852 758 664 460 0.041 2537 2246 2154 2062 1970 1878 1785 1692 1600 450 0.056 3245 3155 3065 2975 2884 2793 2702 2611 2520 440 0.076 4137 4049 3960 3871 3782 3693 3604 3515 3425 430 0.096 5012 4926 4839 4752 4064 4577 4489 4402 4314 420 0.116 5871 5785 5700 5615 5529 5444 5358 5272 6049 400 0.160 7533 7452 7370 7887 7056 7776 7937 7856 7776 70625 380 0.299 9129 9042 8866 8887 8809 8730	480	0.008	475	380	285	190	95	0	0	0	0	0
450 0.088 3245 3155 3065 2975 2884 2793 2702 2611 2520 440 0.076 4137 4049 3960 3871 3782 3693 3693 3151 3425 430 0.066 5012 4926 4839 4752 4664 4577 4489 4402 4314 420 0.116 5871 5785 5700 5615 5529 5444 5358 5272 5185 410 0.137 6711 6628 6544 6161 6377 6293 6209 6125 6040 400 0.160 7533 7452 7370 7288 7206 7124 7366 7727 7656 7776 7695 380 0.293 1380 8989 9382 9656 9580 9794 9428 9351 9274 360 0.293 1348 11277 11296 11134 11062								9469	852	758	664	570
		0.041	2337	2246								1507
430 0.096 5012 4926 4889 4752 4664 4577 4489 4402 4314 420 0.116 5871 5785 5700 5615 5529 5444 5358 5272 5185 410 0.137 6711 6628 6544 6461 6377 6293 6299 6125 6040 400 0.160 7533 7452 7370 7288 7206 7124 7042 6959 6877 390 0.184 8336 8237 8177 8097 8017 7937 7856 7776 7695 380 0.209 9120 9042 8895 8887 8809 8730 8652 8573 8494 360 0.264 10627 10553 10480 10406 10332 10258 10183 10109 10034 350 0.233 1338 1323 11341 11062 10990 10418 10435 </td <td>450</td> <td>0.058</td> <td>3245</td> <td>3155</td> <td>3065</td> <td>2975</td> <td>2884</td> <td>2793</td> <td>2702</td> <td>2611</td> <td>2520</td> <td>2429</td>	450	0.058	3245	3155	3065	2975	2884	2793	2702	2611	2520	2429
												3335
410 0.137 6711 6628 6544 6461 6377 6293 6299 6125 6040 400 0.160 7533 7452 7370 7288 7206 7124 7042 6959 6877 390 0.184 8336 8257 8177 8097 8017 7393 7856 7776 7695 380 0.290 9120 9042 8965 8887 8809 8730 8652 8573 8494 370 0.236 9883 9808 9732 9656 9580 9501 9428 9551 9274 360 0.264 10627 10553 10480 10406 10332 10258 10183 10109 10044 350 0.293 11348 11277 11260 11291 11841 11771 11701 11613 11490 330 0.353 13318 13223 13188 13123 1307 12992 <	430	0.096	5012	4926	4839	4752	4664	4577	4489	4402	4314	4225
												5099
390 0.184 8336 8257 8177 8097 8017 7937 7856 7776 7695 380 0.209 9120 9042 8065 8837 8809 8730 8652 8873 8494 370 0.236 1067 10553 10480 10406 10332 10288 10183 10109 10634 350 0.293 11348 11277 11206 11134 11062 10990 10918 10845 10773 340 0.325 12949 1180 11910 11841 11771 11701 11631 11561 11490 320 0.393 13382 13318 13523 13183 13123 13057 12922 12926 12860 310 0.430 14014 13952 13830 13827 13761 13638 13574 13510 300 0.469 14623 14563 14503 14443 14382 14321	410	0.137	6/11	6628	6544	6461	6377	6293	6209	6125	6040	5955
380 0.209 9120 9042 8965 8887 8809 9730 9504 9428 9351 9274 360 0.264 10627 10553 10480 10406 10332 10288 10183 10109 10034 350 0.293 11348 11277 11206 11134 11062 10990 10918 10845 10773 340 0.325 12049 1180 11910 11811 11771 11701 11631 11561 11490 330 0.358 12727 12660 12593 12326 12458 12391 12922 12266 12860 310 0.393 13382 13318 13253 13188 13123 13057 12992 12926 12860 310 0.469 14623 14563 14563 14453 14433 14352 14321 14199 14138 290 0.511 15207 15150 15092 1534 <td></td> <td>6794 7614</td>												6794 7614
370 0.236 9883 9808 9732 9656 9580 9504 9428 9351 9274 360 0.264 10627 10553 10480 10406 11332 10258 10183 10109 10918 10845 10773 360 0.264 12049 11980 11910 11841 11771 11701 11631 11561 11499 340 0.325 12949 11980 11910 11841 11771 11701 11631 11561 11499 320 0.393 13382 13318 13253 13188 13123 13057 12992 12926 12860 310 0.430 14044 13952 13880 13827 13764 13701 13638 13574 13510 300 0.4699 14623 14563 14503 14443 14982 14426 14198 14138 290 0.515 15767 15712 15657 15601												
360 0.264 10627 10553 10480 10406 10332 10258 10183 10109 10944 350 0.293 11348 11277 11206 11134 11062 10990 10918 10845 10773 340 0.325 12049 11980 11910 11841 11771 11701 11631 11561 11490 330 0.3538 12727 12660 12593 12526 12458 12391 12323 12254 12186 320 0.393 13382 13318 13253 13188 13123 13057 12992 12960 310 0.469 14623 14563 14503 14443 14382 14321 14260 14199 14138 290 0.511 15207 15150 15092 15034 14976 14918 14859 14800 14741 280 0.555 15767 15712 15667 15601 15546												8415 9197
350 0.293 11348 11277 11206 11134 11062 10990 10918 10845 10773 340 0.325 12049 11980 11910 11841 11771 11701 11631 11561 11490 330 0.358 12727 12660 12593 12526 12458 12391 12323 12254 12186 320 0.333 13382 13318 13253 13188 13123 13057 12992 12926 12860 310 0.430 14014 13952 13890 13827 13704 13638 13574 13510 300 0.469 14623 14563 14503 14443 14382 14321 14260 14199 14138 290 0.511 15207 15150 15092 15034 14976 14918 14859 14800 14741 280 0.555 15767 15712 15667 15601 15946 <												
340 0.325 12049 11980 11910 11841 11771 11701 11631 11561 11490 330 0.358 12727 12660 12593 12526 12458 12391 12323 12254 12186 320 0.393 13382 13318 13253 13188 13123 13057 12992 12926 12860 310 0.430 14014 13952 13890 13827 13764 13701 13638 13574 13510 300 0.469 14623 14563 14503 14443 14382 14321 14260 14199 14188 290 0.555 15767 15712 15657 15601 1546 15490 15434 15378 15321 270 0.602 16302 16250 16197 16144 16091 16038 1594 15930 15876 260 0.651 16812 16762 16712 16662 <th< td=""><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td>9959 10700</td></th<>												9959 10700
330 0.358 12727 12660 12593 12526 12458 12391 12323 12254 12186 320 0.393 13382 13318 13253 13188 13123 13057 12992 12926 12860 310 0.430 14014 13952 13890 13827 13764 13701 13688 13574 13510 300 0.469 14623 14563 14563 14443 14382 14321 14260 14199 14138 290 0.511 15207 15150 15092 15034 14976 14918 14859 14800 14791 14741 280 0.555 15767 15712 15657 15601 15546 15490 15434 15378 15321 270 0.602 16302 16250 16197 16144 16091 16038 15944 15930 15876 260 0.651 16812 16762 16712 <	940		19040	11000		11041	11771		11091		11400	
310 0.430 14014 13952 13890 13827 13764 13701 13638 13574 13510 300 0.469 14623 14563 14503 14443 14382 14321 14260 14199 14138 290 0.511 15207 15150 15092 15034 14976 14918 14859 14800 14741 280 0.555 15767 15712 15657 15601 15546 15490 15434 15878 15321 270 0.602 16302 16250 16197 16144 16091 16038 15984 15930 15876 260 0.651 16812 16762 16712 16662 16611 16560 16509 16458 16406 250 0.704 17296 17249 17202 17154 17106 17057 1700 16960 16911 240 0.759 17756 17711 17666 17621 <t< td=""><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td>$\frac{11419}{12118}$</td></t<>												$\frac{11419}{12118}$
310 0.430 14014 13952 13890 13827 13764 13701 13638 13574 13510 300 0.469 14623 14563 14503 14443 14382 14321 14260 14199 14138 290 0.511 15207 15150 15092 15034 14976 14918 14859 14800 14741 280 0.555 15767 15712 15657 15601 15546 15490 15434 15878 15321 270 0.602 16302 16250 16197 16144 16091 16038 15984 15930 15876 260 0.651 16812 16762 16712 16662 16611 16560 16509 16458 16406 250 0.704 17296 17249 17202 17154 17106 17057 1700 16960 16911 240 0.759 17756 17711 17666 17621 <t< td=""><td>390</td><td>0.303</td><td>13389</td><td>12212</td><td>13953</td><td>13188</td><td>12192</td><td>13057</td><td>19009</td><td>19096</td><td>19860</td><td>12793</td></t<>	390	0.303	13389	12212	13953	13188	12192	13057	19009	19096	19860	12793
290 0.511 15207 15150 15092 15034 14976 14918 14859 14800 14741 280 0.555 15767 15712 15657 15601 15546 15490 15434 15378 15321 270 0.602 16302 16250 16197 16144 16091 16038 15984 15930 15876 260 0.651 16812 16762 16712 16662 16611 16560 16509 16458 16406 250 0.704 17296 17249 17202 17154 17106 17057 17009 16960 16911 240 0.759 17756 17711 17666 17621 17575 17529 17483 17437 17390 230 0.818 18189 18147 18105 18062 18019 17976 17932 17888 17844 220 0.880 18597 18558 18518 18478 <												13446
290 0.511 15207 15150 15092 15034 14976 14918 14859 14800 14741 280 0.555 15767 15712 15657 15601 15546 15490 15434 15378 15321 270 0.602 16302 16250 16197 16144 16091 16038 15984 15930 15876 260 0.651 16812 16762 16712 16662 16611 16560 16509 16458 16406 250 0.704 17296 17249 17202 17154 17106 17057 17009 16960 16911 240 0.759 17756 17711 17666 17621 17575 17529 17483 17437 17390 230 0.818 18189 18147 18105 18062 18019 17976 17932 17888 17844 220 0.880 18597 18558 18518 18478 <	300	0.469	14623	14563	14503	14443	14389	14391	14960	14199	14138	14076
270 0.602 16302 16250 16197 16144 16091 16038 15984 15930 15876 260 0.651 16812 16762 16712 16662 16611 16560 16509 16458 16406 250 0.704 17296 17249 17202 17154 17106 17057 17009 16960 16911 240 0.759 17756 17711 17666 17621 17575 17529 17483 17437 17390 230 0.818 18189 18147 18105 18062 18019 17976 17932 17888 17844 220 0.880 18597 18558 18518 18478 18437 18397 18356 18314 18273 210 0.946 18980 18943 18906 18868 18830 18792 18754 18715 18676 200 1.016 19338 19303 19268 19233 <												14682
270 0.602 16302 16250 16197 16144 16091 16038 15984 15930 15876 260 0.651 16812 16762 16712 16662 16611 16560 16509 16458 16406 250 0.704 17296 17249 17202 17154 17106 17057 17009 16960 16911 240 0.759 17756 17711 17666 17621 17575 17529 17483 17437 17390 230 0.818 18189 18147 18105 18062 18019 17976 17932 17888 17844 220 0.880 18597 18558 18518 18478 18437 18397 18356 18314 18273 210 0.946 18980 18943 18906 18868 18830 18792 18754 18715 18676 200 1.016 19338 19303 19268 19233 <	280	0.555	15767	15712	15657	15601	15546	15490	15434	15378	15321	15264
250 0.704 17296 17249 17202 17154 17106 17057 17009 16960 16911 240 0.759 17756 17711 17666 17621 17575 17529 17483 17437 17390 230 0.818 18189 18147 18105 18062 18019 17976 17932 17888 17844 220 0.880 18597 18558 18518 18478 18437 18397 18356 18314 18273 210 0.946 18980 18943 18906 18868 18830 18792 18754 18715 18676 200 1.016 19338 19303 19268 19233 19198 19162 19126 19900 19054 190 1.090 19671 19639 19606 19574 19541 19508 19474 19440 19407 180 1.168 19979 19950 19920 19889 <	270	0.602	16302	16250		16144	16091	16038	15984	15930	15876	15821
240 0.759 17756 17711 17666 17621 17575 17529 17483 17437 17390 230 0.818 18189 18147 18105 18062 18019 17976 17932 17888 17844 220 0.880 18597 18558 18518 18478 18437 18397 18356 18314 18273 210 0.946 18980 18943 18906 18868 18830 18792 18754 18715 18676 200 1.016 19338 19303 19268 19233 19198 19162 19126 19090 19054 190 1.090 19671 19639 19606 19574 19541 19508 19474 19440 19407 180 1.168 19979 19950 19920 19889 19828 19797 19766 19735 170 1.251 20264 20237 20209 20181 20153 <		0.651				16662		16560	16509	16458	16406	16354
230 0.818 18189 18147 18105 18062 18019 17976 17932 17888 17844 220 0.880 18597 18558 18518 18478 18437 18397 18356 18314 18273 210 0.946 18980 18943 18906 18868 18830 18792 18754 18715 18676 200 1.016 19338 19303 19268 19233 19198 19162 19126 19990 19054 190 1.090 19671 19639 19606 19574 19541 19508 19474 19440 19407 180 1.168 19979 19950 19920 19889 19859 19828 19797 19766 19735 170 1.251 20264 20237 20209 20181 20153 20125 20096 20067 20038 160 1.339 20526 20500 20475 20449 <	250	0.704	17296	17249	17202	17154	17106	17057	17009	16960	16911	16861
220 0.880 18597 18558 18518 18478 18437 18397 18356 18314 18273 210 0.946 18980 18943 18906 18868 18830 18792 18754 18715 18676 200 1.016 19338 19303 19268 19233 19198 19162 19126 19090 19054 190 1.090 19671 19639 19606 19574 19541 19508 19474 19440 19407 180 1.168 19979 19950 19920 19889 19859 19828 19797 19766 19735 170 1.251 20264 20237 20209 20181 20153 20125 20096 20067 20038 160 1.339 20526 20500 20475 20449 20424 20398 20371 20345 20318 150 1.431 20764 20742 20718 20695 <												17344
210 0.946 18980 18943 18906 18868 18830 18792 18754 18715 18676 200 1.016 19338 19303 19268 19233 19198 19162 19126 19090 19054 190 1.090 19671 19639 19606 19574 19541 19508 19474 19440 19407 180 1.168 19979 19950 19920 19889 19859 19828 19797 19766 19735 170 1.251 20264 20237 20209 20181 20153 20125 20096 20067 20038 160 1.339 20526 20500 20475 20449 20424 20398 20371 20345 20318 150 1.431 20764 20742 20718 20695 20672 20648 20624 20600 20575 3 140 1.529 20982 20961 20940 20919 20897 20876 20854 20832 20810 3 <	230	0.818	18189	18147	18105	18062	18019	17976	17932	17888	17844	17800
200 1.016 19338 19303 19268 19233 19198 19162 19126 19090 19054 190 1.090 19671 19639 19606 19574 19541 19508 19474 19440 19407 180 1.168 19979 19950 19920 19889 19859 19828 19797 19766 19735 170 1.251 20264 20237 20209 20181 20153 20125 20096 20067 20038 2 160 1.339 20526 20500 20475 20449 20424 20398 20371 20345 20318 2 150 1.431 20764 20742 20718 20695 20672 20648 20624 20600 20575 3 140 1.529 20982 20961 20940 20919 20897 20876 20854 20832 20810 3 130 1.633 21178 21159 21140 21121 21102 21082 21063 21043 210												18231
190 1.090 19671 19639 19606 19574 19541 19508 19474 19440 19407 180 1.168 19979 19950 19920 19889 19859 19828 19797 19766 19735 170 1.251 20264 20237 20209 20181 20153 20125 20096 20067 20038 2 160 1.339 20526 20500 20475 20449 20424 20398 20371 20345 20318 2 150 1.431 20764 20742 20718 20695 20672 20648 20624 20600 20575 2 140 1.529 20982 20961 20940 20919 20897 20876 20854 20832 20810 3 130 1.633 21178 21159 21140 21121 21102 21082 21063 21043 21023 3 120 1.744 21354 21338 21321 21304 21286 21269 21251 21333 </td <td>210</td> <td>0.946</td> <td>18980</td> <td>18943</td> <td>18906</td> <td>18868</td> <td>18830</td> <td>18792</td> <td>18754</td> <td>18715</td> <td>18676</td> <td>18637</td>	210	0.946	18980	18943	18906	18868	18830	18792	18754	18715	18676	18637
180 1.168 19979 19950 19920 19889 19859 19828 19797 19766 19735 170 1.251 20264 20237 20209 20181 20153 20125 20096 20067 20038 20181 20153 20125 20096 20067 20038 20181 20153 20125 20096 20067 20038 20181 20181 20182 20182 20181 20182 20182 20181 20182 20182 20183 201843 20183 201843 20183 2												19017 19372
170 1.251 20264 20237 20209 20181 20153 20125 20096 20067 20038 3 160 1.339 20526 20500 20475 20449 20424 20398 20371 20345 20318 3 150 1.431 20764 20742 20718 20695 20672 20648 20624 20600 20575 3 140 1.529 20982 20961 20940 20919 20897 20876 20854 20832 20810 3 130 1.633 21178 21159 21140 21121 21102 21082 21063 21043 21023 3 120 1.744 21354 21338 21321 21304 21286 21269 21251 2133 21215 3 110 1.861 21512 21497 21482 21467 21451 21435 21420 21404 21387 3 90 2.120 21774 21763 21751 21739 21727 21715												
160 1.339 20526 20500 20475 20449 20424 20398 20371 20345 20318 20518 150 1.431 20764 20742 20718 20695 20672 20648 20624 20600 20575 20575 140 1.529 20982 20961 20940 20919 20897 20876 20854 20832 20810 20810 130 1.633 21178 21159 21140 21121 21102 21082 21063 21043 21023 21023 120 1.744 21354 21338 21321 21304 21286 21269 21251 21233 21215 2110 110 1.861 21512 21497 21482 21467 21451 21435 21420 21404 21387 2160 90 2.120 21774 21763 21751 21739 21727 21715 21702 21690 21677 21690 80 2.264 21881 21871 21861 21850 21840												19703 20009
150 1.431 20764 20742 20718 20695 20672 20648 20624 20600 20575 3 140 1.529 20982 20961 20940 20919 20897 20876 20854 20832 20810 3 130 1.633 21178 21159 21140 21121 21102 21082 21063 21043 21023 3 120 1.744 21354 21338 21321 21304 21286 21269 21251 21233 21215 3 110 1.861 21512 21497 21482 21467 21451 21435 21420 21404 21387 3 100 1.986 21651 21638 21625 21611 21598 21584 21570 21556 21541 3 90 2.120 21774 21763 21751 21739 21727 21715 21702 21690 21677 3 80 2.264 21881 21871 21861 21850 21840 21829												
140 1.529 20982 20961 20940 20919 20897 20876 20854 20832 20810 2												20291 20550
130 1.633 21178 21159 21140 21121 21102 21082 21063 21043 21023 21121 120 1.744 21354 21338 21321 21304 21286 21269 21251 21233 21215 2131 110 1.861 21512 21497 21482 21467 21451 21435 21420 21404 21387 21387 100 1.986 21651 21638 21625 21611 21598 21584 21570 21556 21541 21690 90 2.120 21774 21763 21751 21739 21727 21715 21702 21690 21677 2180 80 2.264 21881 21871 21861 21850 21840 21829 21819 21808 21797 2180												
120 1.744 21354 21338 21321 21304 21286 21269 21251 21233 21215 3 110 1.861 21512 21497 21482 21467 21451 21435 21420 21404 21387 3 100 1.986 21651 21638 21625 21611 21598 21584 21570 21556 21541 9 90 2.120 21774 21763 21751 21739 21727 21715 21702 21690 21677 3 80 2.264 21881 21871 21861 21850 21840 21829 21819 21808 21797 3												20787 21002
110 1.861 21512 21497 21482 21467 21451 21435 21420 21404 21387 2 100 1.986 21651 21638 21625 21611 21598 21584 21570 21556 21541 2 90 2.120 21774 21763 21751 21739 21727 21715 21702 21690 21677 2 80 2.264 21881 21871 21861 21850 21840 21829 21819 21808 21797 2												
90 2.120 21774 21763 21751 21739 21727 21715 21702 21690 21677 2 80 2.264 21881 21871 21861 21850 21840 21829 21819 21808 21797 2												21197 21371
90 2.120 21774 21763 21751 21739 21727 21715 21702 21690 21677 2 80 2.264 21881 21871 21861 21850 21840 21829 21819 21808 21797 2	100	1 986	91651	91638	21625	91611	91508	91584	91570	91556	91541	21527
												21664
	80	2.264	21881	21871	21861	21850	21840	21829	21819	21808	21797	21785
70 2.420 21973 21964 21955 21947 21938 21929 21919 21910 21900 5		2.420	21973	21964	21955	21947	21938	21929	21919	21910	21900	21891
60 2.591 22051 22044 22036 22029 22021 22013 22006 21998 21989 2	60	2.591	22051	22044	22036	22029	22021	22013	22006	21998	21989	21981

Table H.1(i) Halon 1301 at 360 psi and $70 \text{ lb/ft}^3 Y$ and Z Factors

							Y				
psi	Z	0	1	2	3	4	5	6	7	8	9
260	0.050	962	868	773	678	583	487	391	294	196	98
250	0.105	1874	1785	1696	1606	1515	1424	1333	1241	1148	1055
240	0.166	2735	2652	2567	2483	2397	2311	2225	2138	2051	1963
230	0.233	3543	3465	3386	3307	3227	3146	3065	2984	2901	2819
220	0.307	4297	4224	4150	4076	4002	3927	3851	3775	3698	3621
210	0.387	4994	4927	4859	4791	4722	4652	4582	4512	4441	4369
200	0.475	5635	5573	5511	5449	5385	5322	5257	5192	5127	5061
190	0.570	6220	6164	6107	6050	5993	5935	5876	5816	5757	5696
180	0.673	6750	6699	6648	6597	6544	6492	6439	6385	6330	6275
170	0.783	7227	7181	7135	7089	7042	6995	6947	6898	6849	6800
160	0.899	7652	7612	7571	7530	7488	7446	7403	7359	7316	7271
150	1.021	8030	7994	7958	7922	7885	7847	7809	7771	7732	7692
140	1.149	8364	8332	8300	8268	8235	8202	8169	8135	8100	8066
130	1.282	8656	8629	8601	8573	8544	8515	8486	8456	8425	8395
120	1.422	8912	8888	8864	8839	8814	8789	8763	8737	8710	8684
110	1.567	9133	9113	9092	9070	9049	9027	9004	8982	8959	8935
100	1.719	9324	9306	9288	9270	9251	9232	9213	9194	9174	9154
90	1.879	9488	9472	9457	9441	9425	9409	9393	9376	9359	9342
80	2.047	9626	9614	9600	9587	9574	9560	9546	9532	9517	9503
70	2.225	9743	9732	9721	9710	9699	9687	9676	9664	9651	9639
60	2.417	9840	9831	9822	9813	9804	9794	9784	9774	9764	9754

Table H.1(j) Halon 1301 at 360 psi and 60 lb/ft³Y and Z Factors

						3	Y				
psi	Z	0	1	2	3	4	5	6	7	8	9
280	0.004	98	0	0	0	0	0	0	0	0	0
270	0.051	1056	962	868	774	678	583	487	390	293	196
260	0.102	1969	1880	1790	1700	1609	1518	1427	1335	1242	1150
250	0.158	2834	2750	2665	2579	2494	2407	2321	2233	2146	2057
240	0.219	3650	3571	3491	3410	3330	3248	3166	3084	3001	2918
230	0.286	4415	4341	4266	4191	4115	4039	3962	3885	3807	3729
220	0.360	5129	5060	4990	4920	4850	4779	4707	4635	4562	4489
210	0.440	5789	5726	5662	5597	5532	5466	5399	5333	5265	5197
200	0.527	6397	6339	6280	6220	6160	6100	6039	5977	5915	5853
190	0.621	6952	6899	6845	6791	6736	6681	6625	6569	6512	6455
180	0.722	7456	7408	7359	7310	7260	7210	7160	7108	7057	7005
170	0.829	7910	7866	7823	7778	7734	7689	7643	7597	7550	7503
160	0.942	8316	8278	8239	8199	8159	8119	8078	8036	7995	7952
150	1.062	8678	8644	8609	8574	8538	8503	8466	8429	8392	8354
140	1.187	8998	8968	8937	8906	8875	8843	8811	8778	8745	8712
130	1.318	9280	9254	9227	9199	9172	9144	9115	9087	9058	9028
120	1.455	9527	9503	9480	9456	9432	9408	9383	9358	9332	9306
110	1.598	9741	9721	9700	9680	9659	9638	9616	9594	9572	9549
100	1.748	9926	9909	9891	9873	9855	9837	9818	9799	9780	9761
90	1.905	10085	10070	10055	10040	10024	10009	9993	9976	9960	9943
80	2.071	10220	10207	10195	10182	10169	10155	10142	10128	10114	10099
70	2.248	10334	10323	10313	10302	10291	10279	10268	10256	10244	10232
60	2.437	10429	10420	10411	10402	10393	10384	10374	10364	10354	10344

Table H.1(k) Halon 1301 at 360 psi and 50 lb/ft³Y and Z Factors

							Y				
psi	Z	0	1	2	3	4	5	6	7	8	9
290	0.008	195	98	0	0	0	0	0	0	0	0
280	0.051	1148	1055	961	867	772	677	581	485	389	292
270	0.098	2059	1970	1880	1790	1700	1609	1518	1426	1334	1241
260	0.150	2926	2841	2756	2670	2584	2498	2411	2324	2236	2148
250	0.206	3747	3667	3586	3505	3424	3342	3260	3177	3094	3010
240	0.268	4521	4446	4370	4294	4217	4140	4062	3984	3906	3827
230	0.335	5247	5177	5106	5035	4963	4890	4818	4744	4670	4596
220	0.408	5925	5859	5793	5727	5660	5592	5524	5456	5387	5317
210	0.487	6552	6491	6430	6369	6307	6244	6181	6118	6054	5989
200	0.573	7129	7074	7018	6961	6904	6847	6789	6730	6671	6612
190	0.666	7658	7607	7556	7504	7452	7400	7347	7293	7239	7184
180	0.764	8138	8092	8046	7999	7952	7904	7856	7807	7758	7708
170	0.870	8572	8530	8489	8446	8404	8361	8317	8273	8228	8183
160	0.981	8961	8924	8887	8849	8810	8772	8733	8693	8653	8613
150	1.097	9308	9275	9242	9208	9174	9140	9105	9069	9034	8998
140	1.220	9617	9587	9558	9528	9498	9467	9436	9405	9373	9341
130	1.348	9889	9863	9837	9811	9784	9757	9730	9702	9674	9645
120	1.482	10127	10105	10082	10059	10036	10012	9988	9963	9939	9914
110	1.623	10335	10316	10296	10276	10255	10235	10214	10193	10171	10149
100	1.770	10515	10498	10481	10464	10446	10428	10410	10392	10373	10354
90	1.926	10670	10656	10641	10626	10611	10596	10580	10564	10548	10532
80	2.090	10802	10790	10777	10765	10752	10739	10725	10712	10698	10684
70	2.264	10913	10903	10893	10882	10871	10860	10849	10837	10826	10814
60	2.454	11006	10998	10989	10980	10971	10962	10953	10943	10933	10923

Table H.1(1) Halon 1301 at 360 psi and 40 lb/ft³Y and Z Factors

							Y				
psi	Z	0	1	2	3	4	5	6	7	8	9
300	0.011	292	195	98	0	0	0	0	0	0	0
290	0.051	1239	1146	1053	959	865	770	675	580	484	388
280	0.094	2149	2060	1970	1880	1790	1669	1608	1516	1425	1332
270	0.142	3017	2932	2847	2761	2675	2588	2501	2414	2326	2237
260	0.194	3843	3763	3682	3600	3518	3436	3353	3270	3186	3102
250	0.251	4626	4550	4473	4396	4318	4240	4162	4083	4003	3924
240	0.313	5363	5292	5219	5147	5074	5000	4926	4852	4777	4702
230	0.380	6055	5988	5920	5852	5784	5715	5646	5576	5505	5435
220	0.453	6700	6637	6574	6511	6447	6383	6318	6253	6188	6121
210	0.532	7297	7240	7182	7123	7064	7004	6944	6884	6823	6762
200	0.616	7848	7795	7742	7688	7634	7579	7523	7468	7411	7355
190	0.707	8353	8304	8256	8206	8156	8106	8056	8004	7953	7901
180	0.805	8812	8768	8724	8679	8634	8588	8542	8495	8448	8401
170	0.908	9228	9188	9148	9107	9066	9025	8983	8941	8899	8856
160	1.016	9601	9566	9530	9493	9457	9420	9382	9344	9306	9267
150	1.131	9936	9904	9872	9839	9807	9773	9740	9706	9671	9637
140	1.251	10233	10205	10176	10148	10118	10089	10059	10029	9998	9967
130	1.377	10496	10471	10446	10421	10395	10369	10342	10315	10288	10261
120	1.508	10727	10705	10683	10661	10638	10615	10592	10569	10545	10521
110	1.646	10929	10910	10891	10872	10852	10832	10811	10791	10770	10749
100	1.792	11105	11088	11072	11055	11038	11020	11003	10985	10966	10948
90	1.945	11256	11242	11227	11213	11198	11183	11168	11153	11137	11121
80	2.107	11385	11373	11361	11348	11336	11323	11310	11297	11283	11270
70	2.280	11494	11484	11474	11463	11453	11442	11431	11420	11408	11397
60	2.465	11586	11577	11569	11560	11551	11542	11533	11523	11514	11504

Table H.1(m) Two-Phase Solution

Section	Pipe	L (ft)	EQL (ft)	Elevation (ft)	Rate (lb/sec)	Start (psi)	End (psi)
1-2	1 in. Sch. 40	27	58	7	8	243	197
2-3	¾ in. Sch. 40	15	19	0	4	197	181
2-4	% in. Sch. 40	15	19	0	4	197	181

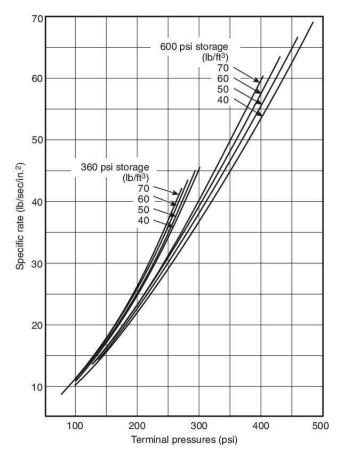


FIGURE H.1(a) Calculated Maximum Open-End Pipe Specific Flow Rate Versus Total Terminal Pressure.

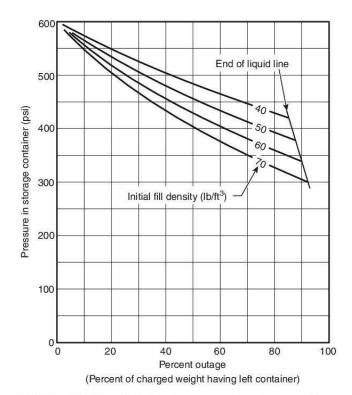


FIGURE H.1(b) Calculated Pressure Recession for $600~\mathrm{psi}$ Storage.

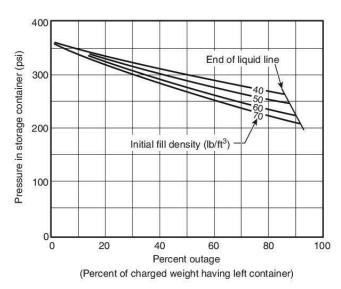


FIGURE H.1(c) Calculated Pressure Recession for 360 psi Storage.

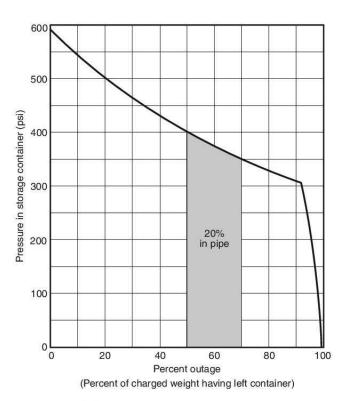


FIGURE H.1(d) Percent Outage.

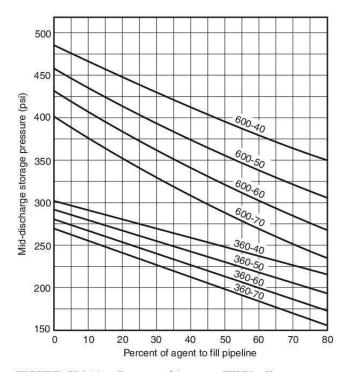


FIGURE H.1(e) Percent of Agent to Fill Pipeline.

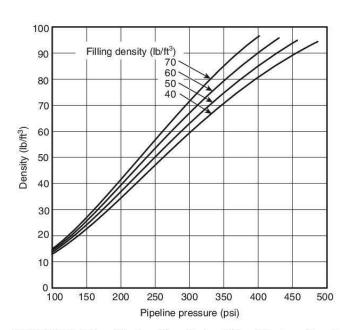


FIGURE H.1(f) Pipeline Density for 600 psi Systems Based on Constant Enthalpy Expansion.

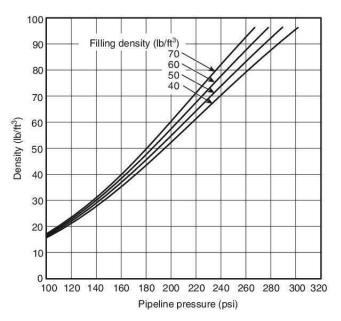


FIGURE H.1(g) Pipeline Density for 360 psi Systems Based on Constant Enthalpy Expansion.




FIGURE H.1(h) Calculated Solution.

Annex I Fire Extinguishment

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

I.1 Introduction. Halon 1301, like other halogenated hydrocarbons, chemically inhibits the propagation of flame. However, although the presence of Halon 1301 in the vicinity of a deep-seated fire will extinguish the flame, thereby greatly reducing the rate of burning, the quantity of agent required for complete extinction of all embers is difficult to assess. It depends on the nature of the fuel, its state of comminution, its distribution within the enclosure, the length of time it has been burning, the ratio of the area of the burning surface to the volume of the enclosure, and the degree of ventilation in the enclosure. It is usually difficult or impractical to maintain an adequate concentration for a sufficient time to ensure the complete extinction of a deep-seated fire. However, the concentration should be maintained for the time period required to obtain response by emergency personnel.

I.2 Fires in Solid Materials. Two types of fires can occur in solid fuels: one in which volatile gases resulting from heating or decomposition of the fuel surface are the source of combustion; and another in which oxidation occurs at the surface of, or within, the mass of fuel. The former is commonly referred to as "flaming" combustion, while the latter is often called "smoldering" or "glowing" combustion. The two types of fires frequently occur concurrently, although one type of burning can precede the other. For example, a wood fire can start as flaming combustion and become smoldering as burning progresses. Conversely, spontaneous ignition in a pile of oily rags can begin as a smoldering fire and break into flames at some later point. Flaming combustion, because it occurs in the vapor phase, is promptly extinguished with low levels of Halon 1301. In the absence of smoldering combustion, it will stay out.

Smoldering combustion is not subject to immediate extinguishment as is flaming combustion. Characteristic of this type of combustion is the slow rate of heat losses from the reaction zone. Thus, the fuel remains hot enough to react with oxygen, even though the rate of reaction, which is controlled by diffusion processes, is extremely slow. Smoldering fires can continue to burn for many weeks, for example, in bales of cotton and jute and within heaps of sawdust. A smoldering fire ceases to burn only when either all of the available oxygen or fuel has been consumed or when the fuel surface is at too low a temperature to react. These fires are usually extinguished by reducing the fuel temperature, either directly by application of a heatabsorbing medium, such as water, or by blanketing with an inert gas. The inert gas slows the reaction rate to the point where heat generated by oxidation is less than heat losses to surroundings. This causes the temperature to fall below the level necessary for spontaneous ignition after removal of the inert atmosphere.

For the purposes of this standard, smoldering fires are divided into two classes: (1) where the smoldering is not "deep seated" and (2) deep-seated fires. The difference is only a matter of degree, and the distinction is a functional one: If a 5 percent concentration of Halon 1301 will not extinguish it within 10 minutes of application, it is considered to be deep seated. In practice, experiments have shown a rather sharp dividing line between the two. Deep-seated fires usually require much higher concentrations than 10 percent and much longer soaking times than 10 minutes.

Whether a fire will become deep seated depends, in part, on the length of time it has been burning before application of the extinguishing agent. This time is usually called the "preburn" time. Underwriters Laboratories' wood crib fires (1A) and stacks of wood pallets have been readily extinguished with less than 5 percent Halon 1301 maintained for less than 10 minutes following discharge. (See UL 711.) In these tests, a 10-minute preburn was allowed. Charcoal, the ultimate product of a wood fire, required over 30 minutes for complete extinguishment in a 5 percent Halon 1301 concentration. In charcoal fires, higher agent concentrations were found to reduce the soaking times. At a 10 percent concentration, a 20-minute soaking time was required, and at 20 percent, the soaking time was reduced below 15 minutes.

Another important variable is the fuel configuration. While wood cribs and pallets are easily extinguished with 5 percent Halon 1301, vertical wood panels closely spaced and parallel require about 25 percent concentrations for 30 to 40 minutes for extinguishment. Fires in boxes of excelsior and in piles of shredded paper also required about 20 percent Halon 1301 for extinguishment. In these situations, heat tends to be retained in the fuel array rather than being dissipated to the surroundings. Radiation is an important mechanism for heat removal from smoldering fires.

Experiments with a similar agent, Halon 1211, have shown that the ratio of the burning surface area to the enclosure volume can affect the concentration-soaking time requirements for some deep-seated fires. Low area/volume ratios required higher agent concentrations and longer soaking times than higher ratios did. In other words, small fires in large enclosures were more difficult to extinguish than the contrary situation. This suggested that oxygen depletion is important in the extinguishment of deep-seated fires.

To date, no firm basis has been developed to predict the agent requirements for a deep-seated fire. In a practical sense, however, the use of a Halon 1301 system for control or extinguishment of a deep-seated fire is usually unattractive. Long soaking times are usually difficult to maintain without an extended agent discharge, and at high agent concentrations these systems become rather expensive. The use of Halon 1301 systems will generally be limited to solid combustibles that do not become deep seated.

The deep-seated potential of a solid material in a given situation can be established positively only by experiment. The information given in this standard can assist the authority having jurisdiction in deciding whether such experimentation is necessary. Table I.2(a) provides the quantity of fuel required to achieve ½ of lower explosive limit in air at 1.0 atm and 70°F (21°C). Table I.2(b) provides information on the development of Halon 1301 design concentrations for flame extinguishment for certain fuels.

Table I.2(a) Quantity of Fuel Required to Achieve of Lower Explosive Limit in Air at 1.0 atm and 70°F (21°C)

	Fuel Quantity (p	er enclosed volume)
Material	lb/ft ³	kg/m ³
n-Butane	0.0014	0.0224
Isobutane	0.0016	0.0256
Carbon disulfide	0.00099	0.0159
Carbon monoxide	0.0045	0.0721
Ethane	0.0012	0.0192
Ethyl alcohol	0.0018	0.0288
Ethylene	0.0020	0.0320
n-Heptane	0.0016	0.0256
Hydrogen	0.00011	0.0018
Methane	0.0011	0.0176
Propane	0.0013	0.0256

Table I.2(b) Development of Halon 1301 Design Concentrations for Flame Extinguishment

	Concentration in Air in Volume Percent										
Fuel	Averagea	Safety Factor	Total	Design ^b	Reference						
Acetone	3.3	+0.7	=4.0	5.0	1, 2, 3						
Benzene	3.3	+0.7	=4.0	5.0	1, 2, 3						
Ethanol	3.8	+0.8	=4.6	5.0	1, 2, 3						
Ethylene	6.8	+1.4	=8.2	8.2	1, 2, 3						
Methane	3.1	+0.7	=3.8	5.0	1, 2, 3						
n-Heptane	4.1	+0.8	=4.9	5.0	1, 2, 3						
Propane	4.3	+0.9	=5.2	5.2	1, 2, 3						

 $^{{\}rm ^a\!Average}$ of values reported in references measured at elevated temperature conditions.

^bMeasured extinguishing concentration plus safety factor are increased to a minimum 5 percent for design concentrations.

References:

^{1.} Bajpai, S. N., "Extinction of Diffusion Flames by Halons," FMRC Serial No. 22545, Report No. 76-T-59, July 1976.

^{2.} Riley, J. F., and K. R. Olson, "Determination of Halon 1301/1211 Threshold Extinguishment Concentrations Using the Cup Burner Method," Ansul Report AL-530A, July 1, 1976.

^{3.} Data on file at NFPA.

Annex J Surface Fires

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

J.1 Introduction. Most materials that develop deep-seated fires do so after exposure to flaming combustion for a certain length of time, which varies with the material. In others, the fire can begin as deep seated through internal ignition, such as spontaneous heating.

Surface fires associated with the burning of solid materials are also quickly extinguished by Halon 1301. In many solid materials, smoldering combustion can continue at the surface of the fuel after extinguishment of the flames. These surface embers will normally be extinguished by low concentrations of Halon 1301 maintained for short periods of time.

Deep-seated fires can become established beneath the surface of a fibrous or particulate material. This situation can result from flaming combustion at the surface or from ignition within the mass of fuel. Smoldering combustion then progresses slowly through the mass. A fire of this kind is referred to in this standard as a deep-seated fire. The burning rate of these fires can be reduced by the presence of Halon 1301, and they can be extinguished if a high concentration can be maintained for an adequate soaking time. However, it is not normally practical to maintain a sufficient concentration of Halon 1301 for a sufficient time to extinguish a deep-seated fire.

- J.2 Solid Surface Fires. Almost all flammable solids begin burning on the surface. In many materials, such as plastics without filler materials, surface combustion is the only type that occurs. These fires are readily extinguished with a 5 percent concentration of Halon 1301. Although glowing embers can remain at the surface of the fuel following extinguishment of flames, these embers will usually be completely extinguished within 10 minutes, provided the Halon 1301 concentration is maintained around the fuel for this period of time. It is appropriate to consider maintaining the agent concentration around the fuel until response by emergency personnel can be achieved.
- **J.2.1 Halon 1301 Requirements for Surface Fires.** The following two basic types of extinguishment data have been obtained for Halon 1301:
- Flame extinguishment data, which determine the agent concentration necessary to extinguish a flame of a particular fuel
- (2) Inerting data, which determine the minimum premixed agent concentration to suppress propagation of a flame front at the "flammability peak," or stoichiometric fuel/air composition

Flame extinguishment data generally relate closest to the concentration actually required in a fire extinguishing system. The test recommended for these measurements is the cup burner method similar to that described in Bajpai, 1976; Booth et al., 1976; and Riley et al., 1976. Liquid fuels are examined at the following two temperatures:

- (1) Ambient: 25°C, or approximately 5°C above ASTM opencup flash point of the fuel, whichever is higher
- (2) Elevated: approximately 5°C below the boiling point of the fuel, or 200°C, whichever is lower

Gaseous fuels are examined at two temperatures, 25°C and 150°C. A 20 percent safety factor is added to experimental threshold concentrations. Design concentrations less than 5 percent Halon 1301 are not used for flame extinguishment. Measured flame extinguishment data plus safety factor that are less than 5 percent should be increased to a 5 percent minimum because the potential array of fuels likely to be involved in every real fire requires the higher concentration.

The cup burner test method has been shown to compare well with other test methods and with tests at larger scale. Data produced by the cup burner are somewhat more conservative than those of tests using conventional total flooding techniques. (See M. 1. 2. 7.)

In inerting measurements, a fuel/air mixture is contained in a test chamber, and an ignition source is activated. If the mixture cannot support a flame front, the mixture is considered to be nonflammable. Typical results can be plotted as shown in Figure J.2.1.

The normal flammability range that exists when no agent is present is shown at the left-hand side of the graph. As Halon 1301 is added to the system, the flammability range is reduced until it finally disappears entirely. The agent concentration at which this occurs is called the "flammability peak" concentration. All fuel/air mixtures containing concentrations of agent equal to or greater than the flammability-peak value are nonflammable, hence the term "inert." The results in Table 5.4.1.1.1 were measured using a spherical vessel described in Dalzell, 1975.

The choice between using the flame extinguishing concentration or the inerting concentration for a given fuel depends on (1) the volatility characteristics of the fuel, (2) the quantity of fuel present, and (3) the conditions of use in the hazard. Applying Halon 1301 at the flame extinguishment concentration to actual fires will effectively extinguish the fire without sacrificing the reliability of the system. It is desirable to use this lower concentration when possible because of the following advantages:

- (1) The cost of the system will be correspondingly lower.
- (2) The concentration to which personnel will be (inadvertently) exposed will be lower.

The danger in supplying this lower concentration is that, at some time after extinguishment, a flammable concentration of fuel, air, and agent could possibly be attained through release or vaporization of additional fuel. This is more likely with highly volatile liquid fuels, gaseous fuels, or fuels heated to near their flash point than it is with high flash point liquids or solid fuels. In addition, stratification of the evolved fuel vapors, the size and possible duration of the fire, and other materials that can become heated or involved in the fire must be taken into account. If the volatility of the fuel can be shown to be sufficiently low, and the detection-plus-extinguishment time is short enough to prevent the volatility of the fuel from reaching its flash point as a result of the fire, the use of flame extinguishment data is adequate.

In addition, the extinguishing concentration can be used if the amount of fuel present in the hazard is too low to permit attainment of the lower flammable limit of the fuel. The minimum fuel quantity required to achieve the lower explosive limit is as follows:

$$\frac{\text{pounds of fuel quantity}}{100 \text{ ft}^3 \text{ of enclosed volume}} = \frac{(LFL)(MW)(1.37)}{T + 460}$$

where:

LFL = lower flammable limit of fuel in air, % (vol)

MW = molecular weight of fuel

 $T = \text{temperature } (^{\circ}\text{F})$

For SI units:

fuel quantity
$$(kg/m^3) = \frac{(LFL)(MW)(4.75)}{K}$$

where:

 $K = \text{Kelvin} = ^{\circ}\text{C} + 273.15$

To account for possible stratification effects that might create localized explosive pockets, the fuel quantity as determined above should be divided by an appropriate safety factor. Table I.2(a) lists quantities for several fuels, to which an arbitrary safety factor of 2 has been applied. Greater safety factors can be required by individual situations.

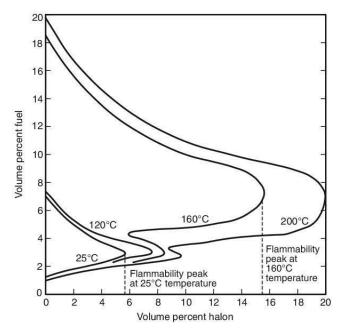


FIGURE J.2.1 Typical Flammability-Peak Concentration.

Annex K Total Flooding Quantity

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

K.1 Total Flooding Quantity. The volume of Halon 1301 required to develop a given concentration will be greater than the final volume remaining in the enclosure.

In most cases, Halon 1301 must be applied in a manner that promotes progressive mixing of the atmosphere. As Halon 1301 is injected, the displaced atmosphere is exhausted freely from the enclosure through small openings or through special vents. Some Halon 1301 is therefore lost with the vented atmosphere, and the higher the concentration, the greater the loss of halon.

For the purposes of this standard, it is assumed that the Halon 1301/air mixture lost in this manner contains the final design concentration of Halon 1301. This represents the worst case from a theoretical standpoint and provides a built-in safety factor to compensate for non-ideal discharge arrangements.

Table K.1(a) and Table K.1(b) show a tabulation of the Halon 1301 weight per cubic foot of hazard volume required to produce the specified concentration of various hazard temperature conditions.

The initial discharge is to be completed within the limits specified in 5.7.1.2. [See Figure K.1(a) and Figure K.1(b) (Metric).]

Table K.1(a) Halon 1301 Total Flooding Quantity

Temperature	Halon 1301 Specific Vapor _		Halon 1	301 Weight F	Requirements	of Hazard V	olume (W/V) [lb/ft ³]	
(t)	Volume(s)			Halon 130	01 Concentra	tion (C) [% l	y Volume]	Vis.	
[°F]	[ft ³ /lb]	3	4	5	6	7	8	9	10
-70	1.8468	0.0167	0.0225	0.0285	0.0345	0.0407	0.0471	0.0536	0.0602
-60	1.8986	0.0163	0.0219	0.0277	0.0336	0.0396	0.0458	0.0521	0.0585
-50	1.9502	0.0158	0.0213	0.0270	0.0327	0.0386	0.0446	0.0507	0.0570
-40	2.0016	0.0154	0.0208	0.0263	0.0319	0.0376	0.0434	0.0494	0.0555
-30	2.0530	0.0151	0.0203	0.0256	0.0311	0.0366	0.0423	0.0482	0.0541
-20	2.1042	0.0147	0.0198	0.0250	0.0303	0.0357	0.0413	0.0470	0.0528
-10	2.1552	0.0143	0.0193	0.0244	0.0296	0.0349	0.0403	0.0459	0.0515
0	2.2062	0.0140	0.0189	0.0239	0.0289	0.0341	0.0394	0.0448	0.0504
10	2.2571	0.0137	0.0185	0.0233	0.0283	0.0334	0.0385	0.0438	0.0492
20	2.3078	0.0134	0.0181	0.0228	0.0277	0.0326	0.0377	0.0429	0.0481
30	2.3585	0.0131	0.0177	0.0223	0.0271	0.0319	0.0369	0.0419	0.047
40	2.4091	0.0128	0.0173	0.0218	0.0265	0.0312	0.0361	0.0411	0.046
50	2.4597	0.0126	0.0169	0.0214	0.0260	0.0306	0.0354	0.0402	0.0452
60	2.5101	0.0123	0.0166	0.0210	0.0254	0.0300	0.0346	0.0394	0.0443
70	2.5605	0.0121	0.0163	0.0206	0.0249	0.0294	0.0340	0.0386	0.0434
80	2.6109	0.0118	0.0160	0.0202	0.0244	0.0288	0.0333	0.0379	0.0426
90	2.6612	0.0116	0.0156	0.0198	0.0240	0.0283	0.0327	0.0371	0.041'
100	2.7114	0.0114	0.0154	0.0194	0.0235	0.0277	0.0320	0.0365	0.0410
110	2.7616	0.0112	0.0151	0.0190	0.0231	0.0272	0.0315	0.0358	0.0405
120	2.8118	0.0110	0.0148	0.0187	0.0227	0.0267	0.0309	0.0351	0.039
130	2.8619	0.0108	0.0145	0.0184	0.0223	0.0263	0.0303	0.0345	0.0388
140	2.9119	0.0106	0.0143	0.0181	0.0219	0.0258	0.0298	0.0340	0.0389
150	2.9620	0.0104	0.0140	0.0178	0.0215	0.0254	0.0293	0.0334	0.037
160	3.0120	0.0103	0.0138	0.0175	0.0212	0.0250	0.0289	0.0328	0.0369
170	3.0169	0.0101	0.0136	0.0172	0.0208	0.0246	0.0284	0.0323	0.0363
180	3.1119	0.0099	0.0134	0.0169	0.0205	0.0242	0.0280	0.0318	0.035'
190	3.1618	0.0098	0.0132	0.0166	0.0202	0.0238	0.0275	0.0313	0.035
200	3.2116	0.0096	0.0130	0.0164	0.0199	0.0234	0.0271	0.0308	0.0346

Note:

W/V [agent weight requirements (lb/ft³)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified:

[K.1a]

$$W = \frac{V}{s} \left(\frac{C}{100 - C} \right)$$

t [temperature (°F)] = the design temperature in the hazard area

s [specific volume (ft³/lb)] = specific volume of superheated Halon 1301 vapor approximated by the formula s = 2.2062 + 0.005046t

where:

 $t = \text{temperature } (^{\circ}\text{F})$

C [concentration (%)] = volumetric concentration of Halon 1301 in air at the temperature indicated

Table K.1(b) (Metric) Halon 1301 Total Flooding Quantity

Temperature	Halon 1301 Specific Vapor _	pecific Vapor Halon 1301 Weight Requirements of Hazard Volume (W/V)[kg/m ³]									
(t)	Volume(s)			Halon 130	01 Concentra	tion (C) [% l	oy Volume]				
[°C]	[m ³ /kg]	3	4	5	6	7	8	9	10		
-50	0.11946	0.2589	0.3488	0.4406	0.5343	0.6301	0.7279	0.8279	0.930		
-45	0.12230	0.2529	0.3407	0.4304	0.5219	0.6155	0.7110	0.8087	0.9083		
-40	0.12513	0.2472	0.3330	0.4206	0.5101	0.6015	0.6949	0.7904	0.8879		
-35	0.12797	0.2417	0.3256	0.4113	0.4988	0.5882	0.6795	0.7729	0.8683		
-30	0.13080	0.2364	0.3185	0.4024	0.4880	0.5754	0.6648	0.7561	0.849		
-25	0.13364	0.2314	0.3118	0.3938	0.4776	0.5632	0.6507	0.7401	0.831		
-20	0.13647	0.2266	0.3053	0.3857	0.4677	0.5515	0.6372	0.7247	0.814		
-15	0.13931	0.2220	0.2991	0.3778	0.4582	0.5403	0.6242	0.7099	0.797		
-10	0.14214	0.2176	0.2931	0.3703	0.4491	0.5295	0.6118	0.6958	0.781		
-5	0.14498	0.2133	0.2874	0.3630	0.4403	0.5192	0.5998	0.6822	0.766		
0	0.14781	0.2092	0.2819	0.3561	0.4318	0.5092	0.5883	0.6691	0.751		
5	0.15065	0.2053	0.2766	0.3494	0.4237	0.4996	0.5772	0.6565	0.737		
10	0.15348	0.2015	0.2715	0.3429	0.4159	0.4904	0.5666	0.6444	0.723		
15	0.15632	0.1979	0.2666	0.3367	0.4083	0.4815	0.5563	0.6327	0.710		
20	0.15915	0.1943	0.2618	0.3307	0.4011	0.4729	0.5464	0.6214	0.698		
25	0.16199	0.1909	0.2572	0.3249	0.3940	0.4647	0.5368	0.6105	0.685		
30	0.16482	0.1876	0.2528	0.3193	0.3873	0.4567	0.5276	0.6000	0.674		
35	0.16766	0.1845	0.2485	0.3139	0.3807	0.4489	0.5187	0.5899	0.662		
40	0.17049	0.1814	0.2444	0.3087	0.3744	0.4415	0.5100	0.5801	0.651		
45	0.17333	0.1784	0.2404	0.3037	0.3683	0.4343	0.5017	0.5706	0.641		
50	0.17616	0.1756	0.2365	0.2988	0.3623	0.4273	0.4936	0.5614	0.630		
55	0.17900	0.1728	0.2328	0.2940	0.3566	0.4205	0.4858	0.5525	0.620		
60	0.18183	0.1701	0.2291	0.2895	0.3510	0.4139	0.4782	0.5439	0.611		
65	0.18467	0.1675	0.2256	0.2850	0.3456	0.4076	0.4709	0.5356	0.601		
70	0.18750	0.1649	0.2222	0.2807	0.3404	0.4014	0.4638	0.5275	0.592		
75	0.19034	0.1625	0.2189	0.2765	0.3353	0.3954	0.4569	0.5196	0.583		
80	0.19317	0.1601	0.2157	0.2725	0.3304	0.3896	0.4501	0.5120	0.575		
85	0.19601	0.1578	0.2126	0.2685	0.3256	0.3840	0.436	0.5046	0.566		
90	0.19884	0.1555	0.2095	0.2647	0.3210	0.3785	0.4373	0.4974	0.558		
95	0.20168	0.1534	0.2066	0.2610	0.3165	0.3732	0.4312	0.4904	0.550		

Note:

W/V [agent weight requirements (kg/m³)] = kilograms of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified:

[K.1b]

$$W = \frac{V}{s} \left(\frac{C}{100 - C} \right)$$

where:

 $t = \text{temperature } (^{\circ}\text{C})$

C [concentration (%)] = volumetric concentration of Halon 1301 in air at the temperature indicated

t [temperature (°C)] = the design temperature in the hazard area

s [specific volume (m³/kg)] = specific volume of superheated Halon 1301 vapor can be approximated by the formula: s = 0.14781 + 0.000567t

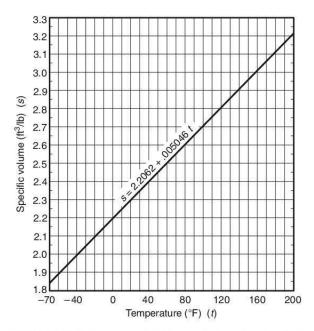


FIGURE K.1(a) Specific Volume of Superheated Halon 1301 Vapor (at 1 atmosphere).

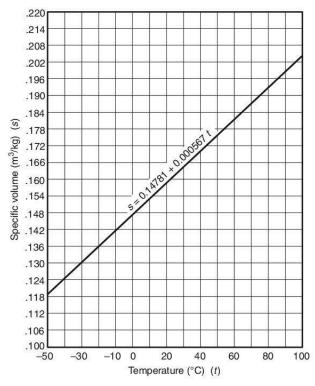


FIGURE K.1(b) Specific Volume of Superheated Halon 1301 Vapor (at 1 atmosphere) (Metric).

Annex L Approval of Installations

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

L.1 Introduction. Where circumstances exist that require a discharge test, test agents sulfur hexafluoride or R-22 (chlorodifluoromethane) can be used. These agents have been identified as having characteristics similar to Halon 1301. The discharge test is not a substitute for any of the approval tests required in Section 6.7, except for the "puff" test (see 6.7.2.1.13).

- (1) Planning for a Discharge Test.
 - (a) A date and time should be set well in advance of the test to ensure that proper preparations are made.
 - (b) To ensure that the testing objectives are met, an evaluation team should be set up, including the following: the user, the installer, and the authority having jurisdiction.
- (2) Preparing for a Discharge Test.
 - (a) All members of the testing evaluation team should meet and make sure all items on the pretest inspection have been resolved.
 - (b) Before conducting an actual system test, all appropriate steps in the preceding predischarge checklist should be read and performed. (Disregard if the steps in the predischarge test have resulted in failures to pass tests.)
 - (c) The following equipment will be required for the test:
 - An accurate concentration meter capable of providing both direct readout and printout. Multiple recorders can be required for large installations.
 - ii. A stopwatch.
 - Portable exhaust fans, if needed for post-test ventilation.
- (3) Test Preparation.
 - (a) Use of Halon 1301 as a test agent further reduces availability for fire extinguishing purposes. Therefore, this standard recommends that Halon 1301 not be used as a test agent.
 - (b) When using sulfur hexafluoride, the following information should be used for guidance.
 - Enclosure leakage rate of sulfur hexafluoride dispersed in air is nearly identical to Halon 1301. The vapor densities of the two materials are almost the same.
 - ii. Distribution in balanced piping systems is similar to that expected with Halon 1301. THIS SUBSTANCE MIGHT NOT BE SUITA-BLE FOR TESTING HYDRAULICALLY COMPLEX SYSTEMS. Tests to determine suitability for testing hydraulically complex systems are ongoing.
 - Sulfur hexafluoride is compatible with Halon 1301 systems hardware.
 - iv. The toxicity of sulfur hexafluoride is no greater than that of Halon 1301.
 - The dynamic loads exerted on the piping network will be similar to that of Halon 1301.

- vi. The test cylinder should be filled to 98 percent of the Halon 1301 weight to achieve the same volume percent concentration. Cylinders with a DOT CTC rating of 500 psig (3447 kPa) [typically used in 360 psig (2482 kPa) applications] will not meet DOT regulations for shipping when filled with sulfur hexafluoride. However, these cylinders can be filled with sulfur hexafluoride and safely used and/or stored at the job site, provided the temperature of the cylinders is not allowed to go above 100°F (37.8°C).
- vii. Test meters used for Halon 1301 are suitable for use with sulfur hexafluoride. It is recommended that test thermoconductivity meters be calibrated with a sample sulfur hexafluoride in air. If desired, calibration with Halon 1301 can be done, but percent concentration values must be multiplied by a factor of 2.
- Sulfur hexafluoride is not a fire extinguishing agent.
- Sulfur hexafluoride ozone depletion is zero and not regulated by the Montreal Protocol.
- (c) When using R-22 the following information should be used for guidance:
 - Because of its lower vapor density, the enclosure leakage rate of R-22 is slower than that for Halon 1301.
 - Distribution in balanced systems is similar to Halon 1301. Hydraulically complex systems might not be suitable for testing with this agent.
 - Common materials of construction are satisfactory for use with R-22. However, the compatibility with exposed Buna-N seals should be established for the duration of storage.
 - iv. Self-contained breathing apparatus must be used if personnel enter the protected space while the agent is present. The threshold limit value for R-22 is 1000 ppm by volume.
 - v. The test cylinders should be filled to 58 percent of the Halon 1301 weight.
 - vi. The test meter should be calibrated with a sample of R-22 in air. Thermoconductivity meters used to measure Halon 1301 concentrations are suitable for this purpose.
 - vii. The ozone depleting potential of R-22 is 0.055, and the global warming potential is 1760. As of September 18, 2015, the EPA has prohibited its use in fire protection systems, including as a test agent.
 - viii. The suitability of R-22 at minimum cylinder fill densities has not been determined.
 - ix. R-22 is not a recognized fire extinguishing agent.
- (d) Replacement 1301 should be on hand, and the replacement containers should be weighed at the site.

- (4) Test Procedure. The following guidelines are for information purposes only and are not intended to replace or restrict the manufacturer's recommendations. The protected enclosure should be prepared as follows:
 - (a) The room should be in the normal operating condition. Taping and other nonpermanent methods should not be allowed.
 - (b) All openings that are to be automatically closed on system actuation should be in their normal open position (doors, fire dampers, etc.).
 - (c) All ceiling tiles should be installed.
 - (d) All nozzle locations should be checked for obstructions. All loose papers and light materials that can be moved by the discharge of halon should be removed.
 - (e) All areas where halon discharge can stir up dust or debris that could damage equipment should be vacuumed clean to minimize potential damage.
 - (f) Adjacent rooms should be checked to make sure that halon migrating from the room will not trip adjacent halon systems or affect people or equipment.
 - (g) Provisions should be provided for removal of the halon at the end of the testing.
 - (h) Experience has shown that the primary cause of discharge test failure is the inability to hold the specified concentration for the entire holding period. Room vacuum/pressurization techniques should be considered for locating unwanted room leakage. These techniques are highly recommended for locating room leakage, both immediately prior to a discharge test and on a future periodic basis.
 - Test Evaluation. For total flooding systems, a listed or approved concentration meter should be used and calibrated in strict accordance with the manufacturer's instructions. The meters should be checked for accuracy by means of a known sample. Concentration readings should be taken at the point of the highest combustible being protected or at a level equivalent to 75 percent of the height of the enclosure, whichever is greater. The sampling points should not be located less than 12 in. (305 mm) from the ceiling unless the combustibles being protected extend within the area, in which case special design consideration might be necessary. If more than one space or compartment is being simultaneously protected, a sampling point should be located in each space in accordance with the preceding criteria. (The minimum design concentration for the hazard should be achieved at all sampling points in the enclosure within 1 minute after the end of the initial discharge.) For flammable liquids and gases, the minimum specified concentration need not be maintained for an extended period. For surface fire hazards other than flammable liquids and gases, 80 percent of the minimum design concentration should be maintained for a period of 10 minutes after the initial discharge or as required by the authority having jurisdiction. Hazards involving deep-seated combustibles require maintenance of the design concentrations for longer periods of time (see 5.4.2.2). Where an inerting concentration is required, a more stringent test could be necessary. Refer to 5.2.6 to determine that concentrations do not exceed the safety limits specified therein. A 110 volt, 60 cycle power source should be available for operating a recordable-type analyzer. The power to the

analyzer should remain on when the fire extinguisher system is activated. The following information is provided as guidance when performing a full discharge test:

- (a) Halon analyzers should be field calibrated and adjusted, in accordance with the analyzer manufacturer's instructions, prior to each use.
- (b) If the system is linked to an alarm circuit providing local and remote fire call, the appropriate party should be notified and advised prior to and at the completion of the test.
- (c) The system should be actuated for discharge.
- (d) Concentration will be reported for the time period that the authority having jurisdiction has determined to be appropriate for that particular occupancy. CAUTION: There should be no smoking in or around the test area during and after the discharge.
- (e) The following items should be complied with to designate the system as acceptable:
 - Liquid discharge should be in accordance with 5.7.1.2.
 - The system should achieve the specified concentration in the protected volume within 1 minute after the end of the initial discharge.
 - iii. The specified concentration should be maintained for the specified holding period.
 - iv. The system should be properly installed and should perform as designed without causing unacceptable damage to the protected volume.
- (f) Once the requirement for hold time has been completed, ventilation to exhaust the halon from the area should be started and maintained as necessary.
- (g) Operation of all auxiliary system functions, horns, lights, local and remote alarms, magnetic releases, and so on, should be confirmed.
- (6) Failure Classification. Discharge test failure can be classified as one of the following:
 - (a) Primary Failure. The failure of equipment necessary to complete system discharge and achieve initial design concentration (i.e., hydraulic calculations, inoperative containers, control panel malfunction, etc.).
 - (b) Secondary Failure. The failure of ancillary equipment that does not inhibit the system from completing discharge and achieving initial design concentration (i.e., dampers, door closures, bells, dry contact relays, etc.).
 - (c) Room Integrity Failure. The failure of the room to hold the specified concentration for the specified holding period.
- (7) Test Documentation. The results of the test should be documented in report form for each member of the test team. This report should include, but not necessarily be limited to, the following:
 - (a) A sketch of the protected area showing the location of sampling points, in plan and elevation.
 - (b) Copies of clearly identified analyzer chart records showing halon concentration. This should also include analyzer calibration results, and the tapes should be signed by the authority having jurisdiction.

- (c) A signoff by each member of the test team.
- (8) Placing System Back in Service. The system should be placed back in service. (Refer to the manufacturer's recommendations.) The steps should include, but not necessarily be limited to, the following:
 - (a) Verify that all detectors and manual pull stations have been reset.
 - (b) Refurbish or replace agent storage containers with the proper amount of agent. Containers should be weighed to verify the required amount of agent.
 - (c) Verify that the system control unit is in a normal operating condition free of all fault indication. Normally this is done before arming each agent storage container release mechanism.
 - (d) Secure the system control unit and lock where applicable.
 - (e) Verify that the end user has been properly instructed in the use and operation of this system.
 - (f) Clean the area of any debris that might have resulted during the system installation.
 - (g) Verify that an emergency telephone number has been left with the end user.

Annex M Informational References

- **M.1 Referenced Publications.** The following documents or portions thereof are referenced within this standard for informational purposes only and are thus not part of the requirements of this document unless also listed in Chapter 2.
- **M.1.1 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 10, Standard for Portable Fire Extinguishers, 2018 edition. NFPA 68, Standard on Explosion Protection by Deflagration Venting, 2018 edition.

NFPA 69, Standard on Explosion Prevention Systems, 2019 edition.

NFPA 72[®], National Fire Alarm and Signaling Code[®], 2019 edition.

NFPA 77, Recommended Practice on Static Electricity, 2019 edition.

NFPA 90A, Standard for the Installation of Air-Conditioning and Ventilating Systems, 2021 edition.

NFPA 90B, Standard for the Installation of Warm Air Heating and Air-Conditioning Systems, 2021 edition.

M.1.2 Other Publications.

M.1.2.1 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5590.

ASME B31.1, Power Piping Code, 2016.

ASME B31.9, Building Services Piping, 2014.

M.1.2.2 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM A53/A53M, Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless, 2012.

ASTM A106/A106M, Standard Specification for Seamless Carbon Steel Pipe for High Temperature Service, 2015.

ASTM A120, Specification for Pipe, Steel, Black and Hot-Dipped Zinc-Coated (Galwanized) Welded and Seamless for Ordinary Uses, 1984 (withdrawn 1987).

ASTM B88, Standard Specification for Seamless Copper Water Tube, 2016.

ASTM E779, Standard Test Method for Determining Air Leakage Rate by Fan Pressurization, 2010.

ASTM SI10, American National Standard for Metric Practice, 2016.

M.1.2.3 CGA Publications. Compressed Gas Association, 14501 George Carter Way, Suite 103, Chantilly, VA 20151-2923.

CGA P-1, Safe Handling of Compressed Gas in Containers, 2015.

M.1.2.4 CSA Group Publications. CSA Group, 178 Rexdale Blvd., Toronto, ON M9W 1R3, Canada.

CAN/CGSB-149.10-M86, Determination of the Airtightness of Building Envelopes by the Fan Depressurization Method, 1986.

M.1.2.5 EPA Publications. Environmental Protection Agency, William Jefferson Clinton East Bldg., 1200 Pennsylvania Avenue, NW, Washington, DC 20460.

Safety Guide for Decommissioning Halon Systems, Volume 2 of the US Environmental Protection Agency Outreach Report, "Moving Towards a World Without Halon," 1999.

M.1.2.6 Flame Extinguishment and Inerting References.

Bajpai, S. N., July 1976, "Extinction of Diffusion Flames by Halons," FMRC Serial No. 22545, Report No. 76-T-59.

Booth, K., B. J. Melia, and R. Hirst, June 24, 1976, "A Method for Critical Concentration Measurements for the Flame Extinguishment of Liquid Surface and Gaseous Diffusion Flames Using a Laboratory 'Cup Burner' Apparatus and Halons 1211 and 1301 as Extinguishants."

Dalzell, W. G., October 7, 1975, "A Determination of the Flammability Envelope of Four Ternary Fuel-Air-Halon 1301 Systems," Fenwal Inc., Report DSR-624.

Riley, J. F., and K. R. Olson, July 1, 1976, "Determination of Halon 1301/1211 Threshold Extinguishment Concentrations Using the Cup Burner Method," Ansul Report AL-530A.

M.1.2.7 Toxicology References.

Clark, D. G., 1970, "The toxicity of bromotrifluoromethane (FE 1301) in animals and man," Ind. Hyg. Res. Lab. Imperial Chemical Industries, Alderley Park, Cheshire, England.

The Hine Laboratories, Inc., 1968, "Clinical toxicologic studies on Freon FE 1301," Report No. 1, San Francisco, CA (unpublished).

Paulet, G., 1962, "Etude toxicologique et physiopathologique du mono-bromo-trifluoromethane (CF3Br)," *Arch. Mal. Prof. Med. Trav. Secur. Soc.* 23:341-348. (*Chem. Abstr. 60:738e*).

Stewart, Richard D., Paul E. Newton, Anthony Wu, Carl L. Hake, and Neil D. Krivanek, 1978, "Human Exposure to Halon 1301," Medical College of Wisconsin, Milwaukee (unpublished).

Trochimowicz, H. J., A. Azar, J. B. Terrill, and L.S. Mullin, 1974, "Blood Levels of Fluorocarbon Related to Cardiac Sensitization," Part II, *Am. Ind. Hyg. Assoc. J.* 35:632-639.

Trochimowicz, H. J., et al., 1978, "The effect of myocardial infarction on the cardiac sensitization potential of certain halocarbons." *J. Occup. Med.* 18(1):26-30.

Van Stee, E. W., and K. C. Back, 1969, "Short-term inhalation exposure to bromotrifluoromethane," *Tox. & Appl. Pharm.* 15:164-174.

M.1.2.8 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

UL 711, Rating and Fire Testing of Fire Extinguishers, 2002. [Historical reference. See I.2.]

M.1.2.9 Other Publications.

HRC Code of Practice for Halon Reclaiming Companies, Halon Recycling Corporation, 1001 19th Street North, Suite 1200, Arlington, VA 22209 (www.halon.org).

United Nations Environment Programme, Montreal Protocol on Substances that Deplete the Ozone Layer — Final Act 1987, UNEP/RONA, Room DC2-0803, United Nations, New York, NY 10017.

M.2 Informational References. (Reserved)

M.3 References for Extracts in Informational Sections. (Reserved)

INDEX 12A-67

Index

Copyright © 2021 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

-A-	Definitions, B.1.3
Administration, Chap. 1	Limitations and Assumptions, B.1.2
Purpose, 1.2	Door Fan Measurements, B.1.2.2
Safety, 1.5	Halon System Enclosure, B.1.2.1
Decommissioning and Removal of Systems, 1.5.3, A.1.5.3	Retention Calculations, B.1.2.3
Electrical Clearances, 1.5.2	Scope, B.1.1
Hazards to Personnel, 1.5.1	Test Procedure, B.2
Safety Requirements, 1.5.1.2, A.1.5.1.2	Door Fan Enclosure Evaluation, B.2.5
Unnecessary Exposure, 1.5.1.1	Pressure Run-up Inspection, B.2.5.1
Scope, 1.1	Static Pressure Measurement, B.2.5.2
Units, 1.3	Door Fan Installation, B.2.4
Use and Limitations, 1.4	Door Fan Measurement, B.2.6
Duration of Protection, 1.4.6	Equivalent Leakage Area Calculation, B.2.6.3
Approval of Installations, Annex L	Suspended Ceiling Leakage Neutralization Method
Introduction, L.1	(Optional), B.2.6.2
Approved	Total Enclosure Leakage Method, B.2.6.1
Definition, 3.2.1, A.3.2.1	Equipment Required, B.2.2
Authority Having Jurisdiction (AHJ)	Accessories, B.2.2.2
and the filter of the second second of the second s	Door Fan System, B.2.2.1
Definition, 3.2.2, A.3.2.2	Field Calibration Check, B.2.2.3
-C-	Initial Enclosure Evaluation, B.2.3
Clearance	Inspection, B.2.3.1
Definition, 3.3.1	Measurement of Enclosure, B.2.3.2
	Preparation, B.2.3.3
Components, Chap. 4 Detection, Actuation, Alarm, and Control Systems, 4.3	Leakage Control, B.2.8
	Leakage Alteration, B.2.8.2
Automatic Detection, 4.3.2	Materials, B.2.8.2.2
Control Equipment, 4.3.4	Procedure, B.2.8.2.1
Electric Control Equipment, 4.3.4.1	Leakage Identification, B.2.8.1
Pneumatic Control Equipment, 4.3.4.2	Preliminary Preparations, B.2.1
Operating Alarms and Indicators, 4.3.5	Retention Calculation, B.2.7
Operating Devices, 4.3.3	Acceptance Criteria, B.2.7.2
Unwanted System Operation, 4.3.6, A.4.3.6	Calculation, B.2.7.1
Distribution, 4.2	Halon Mixture Density, B.2.7.1.4
Discharge Nozzles, 4.2.5	Leak Fraction, B.2.7.1.3
Fittings, 4.2.3, A.4.2.3	Lower Leakage Area, B.2.7.1.2
Piping, 4.2.1, A.4.2.1	Minimum Height, B.2.7.1.6
Piping Joints, 4.2.2	Static Pressure, B.2.7.1.5
Valves, 4.2.4	
Halon 1301 Supply, 4.1	Time, B.2.7.1.7
Quality, 4.1.2, A.4.1.2	Total Leakage Area, B.2.7.1.1
Quantities, 4.1.1	Sample Calculation, B.2.7.3
Storage Container Arrangement, 4.1.3	Enclosure and System Data, B.2.7.3.2
Storage Containers, 4.1.4	General, B.2.7.3.1
n.	Preliminary Calculations, B.2.7.3.3
-D-	Sample Calculation Results, B.2.7.3.6
Definitions, Chap. 3	Suspended Ceiling Leakage Neutralization Method (Optional), B.2.7.3.5
-E-	Leakage Area Calculation, B.2.7.3.5.1
Enclosure Integrity Procedure, Annex B	Retention Calculation, B.2.7.3.5.2
Procedure Fundamentals R 1	Total Enclosure Leakage Method, B.2.7.3.4

Procedure Fundamentals, B.1

Introduction, H.1 Leakage Area Calculation, B.2.7.3.4.1 Retention Calculation, B.2.7.3.4.2 -P-Test Report, B.2.9 Explanatory Material, Annex A Piping, Annex F Introduction, F.1 -F-Minimum Piping Requirements for Halon 1301 Systems with 360 psi (2482 kPa) and 600 psi (4137 kPa) Charging Filling Density Pressure, F.2 Definition, 3.3.2 Fire Extinguishment, Annex I -R-Fires in Solid Materials, I.2 Referenced Publications, Chap. 2 Introduction, I.1 -H-Shall Halogenated Extinguishing Agents, Annex C Definition, 3.2.4 Halon Nomenclature System, C.2 Should Halon 1301, C.2.1 Definition, 3.2.5 Extinguishing Mechanism, C.2.1.3 Standard Fire Extinguishment Characteristics, C.2.1.2 Definition, 3.2.6 Physical Properties, C.2.1.1 Storage Containers, Annex E Introduction, C.1 Storage Containers, E.1 Hazards to Personnel, Annex D Nitrogen Superpressurization, E.1.1 Decomposition Products of Halon 1301, D.3 Surface Fires, Annex J Hazards to Personnel, D.1 Introduction, J.1 Natural or Undecomposed Halon 1301, D.2 Solid Surface Fires, J.2 Animals, D.2.1 Halon 1301 Requirements for Surface Fires, J.2.1 Humans, D.2.2 System Design, Chap. 5 -I-Altitude Adjustments, 5.6, A.5.6 Design Concentration Requirements, 5.4 Informational References, Annex M Fires in Solid Materials, 5.4.2 Inspection, Maintenance, Testing, and Training, Chap. 6 Deep-Seated Fires, 5.4.2.2 Approval of Installations, 6.7 Solid Surface Fires, 5.4.2.1 Installation Acceptance, 6.7.2 Determination of Halon 1301 Quantity for Total Flooding Electrical Acceptance, 6.7.2.3 Systems, 5.5 Enclosure Integrity Acceptance, 6.7.2.2, A.6.7.2.2 Total Flooding Quantity, 5.5.1 Functional Testing, 6.7.2.4 Distribution System, 5.7 Mechanical Acceptance, 6.7.2.1 Rate of Application, 5.7.1, A.5.7.1 Container Test, 6.2 Discharge Time, 5.7.1.2, A.5.7.1.2 Enclosure Inspection, 6.4 Enclosure, 5.3 Hose Test, 6.3 Nozzle Choice and Location, 5.8 Inspection and Tests, 6.1, A.6.1 Specifications, Plans, and Approvals, 5.1 Maintenance, 6.5 Plans and Approvals, 5.1.2 Training, 6.6 Specifications, 5.1.1 System Flow Calculations, 5.2 -L-System Flow Calculations, Annex G Listed Introduction, G.1 Definition, 3.2.3, A.3.2.3 -T-

Total Flooding Quantity, Annex K

Total Flooding Quantity, K.1

Normally Occupied Area

Definition, 3.3.3, A.3.3.3

-N-

Nozzles, Annex H

Sequence of Events for the Standards Development Process

Once the current edition is published, a Standard is opened for Public Input.

Step 1 – Input Stage

- Input accepted from the public or other committees for consideration to develop the First Draft
- Technical Committee holds First Draft Meeting to revise Standard (23 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Technical Committee ballots on First Draft (12 weeks);
 Technical Committee(s) with Correlating Committee (11 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (5 weeks)
- First Draft Report posted on the document information page

Step 2 – Comment Stage

- Public Comments accepted on First Draft (10 weeks) following posting of First Draft Report
- If Standard does not receive Public Comments and the Technical Committee chooses not to hold a Second Draft meeting, the Standard becomes a Consent Standard and is sent directly to the Standards Council for issuance (see Step 4) or
- Technical Committee holds Second Draft Meeting (21 weeks); Technical Committee(s) with Correlating Committee (7 weeks)
- Technical Committee ballots on Second Draft (11 weeks);
 Technical Committee(s) with Correlating Committee (10 weeks)
- Correlating Committee Second Draft Meeting (9 weeks)
- Correlating Committee ballots on Second Draft (8 weeks)
- Second Draft Report posted on the document information page

Step 3 – NFPA Technical Meeting

- Notice of Intent to Make a Motion (NITMAM) accepted (5 weeks) following the posting of Second Draft Report
- NITMAMs are reviewed and valid motions are certified by the Motions Committee for presentation at the NFPA Technical Meeting
- NFPA membership meets each June at the NFPA Technical Meeting to act on Standards with "Certified Amending Motions" (certified NITMAMs)
- Committee(s) vote on any successful amendments to the Technical Committee Reports made by the NFPA membership at the NFPA Technical Meeting

Step 4 - Council Appeals and Issuance of Standard

- Notification of intent to file an appeal to the Standards Council on Technical Meeting action must be filed within 20 days of the NFPA Technical Meeting
- Standards Council decides, based on all evidence, whether to issue the standard or to take other action

Notes:

- Time periods are approximate; refer to published schedules for actual dates.
- Annual revision cycle documents with certified amending motions take approximately 101 weeks to complete.
- Fall revision cycle documents receiving certified amending motions take approximately 141 weeks to complete.

Committee Membership Classifications^{1,2,3,4}

The following classifications apply to Committee members and represent their principal interest in the activity of the Committee.

- M Manufacturer: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
- 2. U *User:* A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
- 3. IM *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
- 4. L *Labor*: A labor representative or employee concerned with safety in the workplace.
- RT Applied Research/Testing Laboratory: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
- E Enforcing Authority: A representative of an agency or an organization that promulgates and/or enforces standards.
- 7. I *Insurance:* A representative of an insurance company, broker, agent, bureau, or inspection agency.
- 8. C *Consumer:* A person who is or represents the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in (2).
- 9. SE *Special Expert*: A person not representing (1) through (8) and who has special expertise in the scope of the standard or portion thereof.

NOTE 1: "Standard" connotes code, standard, recommended practice, or guide.

NOTE 2: A representative includes an employee.

NOTE 3: While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of member or unique interests need representation in order to foster the best possible Committee deliberations on any project. In this connection, the Standards Council may make such appointments as it deems appropriate in the public interest, such as the classification of "Utilities" in the National Electrical Code Committee.

NOTE 4: Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.

Submitting Public Input / Public Comment Through the Online Submission System

Following publication of the current edition of an NFPA standard, the development of the next edition begins and the standard is open for Public Input.

Submit a Public Input

NFPA accepts Public Input on documents through our online submission system at www.nfpa.org. To use the online submission system:

- Choose a document from the List of NFPA codes & standards or filter by Development Stage for "codes accepting public input."
- Once you are on the document page, select the "Next Edition" tab.
- Choose the link "The next edition of this standard is now open for Public Input." You will be asked to sign in or create a free online account with NFPA before using this system.
- Follow the online instructions to submit your Public Input (see www.nfpa.org/publicinput for detailed instructions).
- Once a Public Input is saved or submitted in the system, it can be located on the "My Profile" page by selecting the "My Public Inputs/Comments/NITMAMs" section.

Submit a Public Comment

Once the First Draft Report becomes available there is a Public Comment period. Any objections or further related changes to the content of the First Draft must be submitted at the Comment Stage. To submit a Public Comment follow the same steps as previously explained for the submission of Public Input.

Other Resources Available on the Document Information Pages

Header: View document title and scope, access to our codes and standards or NFCSS subscription, and sign up to receive email alerts.


Current & Prior Editions	Research current and previous edition information.
Next Edition	Follow the committee's progress in the processing of a standard in its next revision cycle.
Technical Committee	View current committee rosters or apply to a committee.
Ask a Technical Question	For members, officials, and AHJs to submit standards questions to NFPA staff. Our Technical Questions Service provides a convenient way to receive timely and consistent technical assistance when you need to know more about NFPA standards relevant to your work.
News	Provides links to available articles and research and statistical reports related to our standards.
Purchase Products & Training	Discover and purchase the latest products and training.
Related Products	View related publications, training, and other resources available for purchase.

Information on the NFPA Standards Development Process

I. Applicable Regulations. The primary rules governing the processing of NFPA standards (codes, standards, recommended practices, and guides) are the NFPA Regulations Governing the Development of NFPA Standards (Regs). Other applicable rules include NFPA Bylaws, NFPA Technical Meeting Convention Rules, NFPA Guide for the Conduct of Participants in the NFPA Standards Development Process, and the NFPA Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council. Most of these rules and regulations are contained in the NFPA Standards Directory. For copies of the Directory, contact Codes and Standards Administration at NFPA headquarters; all these documents are also available on the NFPA website at "www.nfpa.org/regs."

The following is general information on the NFPA process. All participants, however, should refer to the actual rules and regulations for a full understanding of this process and for the criteria that govern participation.

- **II. Technical Committee Report.** The Technical Committee Report is defined as "the Report of the responsible Committee(s), in accordance with the Regulations, in preparation of a new or revised NFPA Standard." The Technical Committee Report is in two parts and consists of the First Draft Report and the Second Draft Report. (See *Regs* at Section 1.4.)
- **III. Step 1: First Draft Report.** The First Draft Report is defined as "Part one of the Technical Committee Report, which documents the Input Stage." The First Draft Report consists of the First Draft, Public Input, Committee Input, Committee and Correlating Committee Statements, Correlating Notes, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.3.) Any objection to an action in the First Draft Report must be raised through the filing of an appropriate Comment for consideration in the Second Draft Report or the objection will be considered resolved. [See *Regs* at 4.3.1(b).]
- **IV. Step 2: Second Draft Report.** The Second Draft Report is defined as "Part two of the Technical Committee Report, which documents the Comment Stage." The Second Draft Report consists of the Second Draft, Public Comments with corresponding Committee Actions and Committee Statements, Correlating Notes and their respective Committee Statements, Committee Comments, Correlating Revisions, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.4.) The First Draft Report and the Second Draft Report together constitute the Technical Committee Report. Any outstanding objection following the Second Draft Report must be raised through an appropriate Amending Motion at the NFPA Technical Meeting or the objection will be considered resolved. [See *Regs* at 4.4.1(b).]
- **V. Step 3a: Action at NFPA Technical Meeting.** Following the publication of the Second Draft Report, there is a period during which those wishing to make proper Amending Motions on the Technical Committee Reports must signal their intention by submitting a Notice of Intent to Make a Motion (NITMAM). (See *Regs* at 4.5.2.) Standards that receive notice of proper Amending Motions (Certified Amending Motions) will be presented for action at the annual June NFPA Technical Meeting. At the meeting, the NFPA membership can consider and act on these Certified Amending Motions as well as Follow-up Amending Motions, that is, motions that become necessary as a result of a previous successful Amending Motion. (See 4.5.3.2 through 4.5.3.6 and Table 1, Columns 1-3 of *Regs* for a summary of the available Amending Motions and who may make them.) Any outstanding objection following action at an NFPA Technical Meeting (and any further Technical Committee consideration following successful Amending Motions, see *Regs* at 4.5.3.7 through 4.6.5) must be raised through an appeal to the Standards Council or it will be considered to be resolved.
- VI. Step 3b: Documents Forwarded Directly to the Council. Where no NITMAM is received and certified in accordance with the *Technical Meeting Convention Rules*, the standard is forwarded directly to the Standards Council for action on issuance. Objections are deemed to be resolved for these documents. (See *Regs* at 4.5.2.5.)
- **VII. Step 4a: Council Appeals.** Anyone can appeal to the Standards Council concerning procedural or substantive matters related to the development, content, or issuance of any document of the NFPA or on matters within the purview of the authority of the Council, as established by the *Bylaws* and as determined by the Board of Directors. Such appeals must be in written form and filed with the Secretary of the Standards Council (see *Regs* at Section 1.6). Time constraints for filing an appeal must be in accordance with 1.6.2 of the *Regs*. Objections are deemed to be resolved if not pursued at this level.
- **VIII. Step 4b: Document Issuance.** The Standards Council is the issuer of all documents (see Article 8 of *Bylaws*). The Council acts on the issuance of a document presented for action at an NFPA Technical Meeting within 75 days from the date of the recommendation from the NFPA Technical Meeting, unless this period is extended by the Council (see *Regs* at 4.7.2). For documents forwarded directly to the Standards Council, the Council acts on the issuance of the document at its next scheduled meeting, or at such other meeting as the Council may determine (see *Regs* at 4.5.2.5 and 4.7.4).
- **IX. Petitions to the Board of Directors.** The Standards Council has been delegated the responsibility for the administration of the codes and standards development process and the issuance of documents. However, where extraordinary circumstances requiring the intervention of the Board of Directors exist, the Board of Directors may take any action necessary to fulfill its obligations to preserve the integrity of the codes and standards development process and to protect the interests of the NFPA. The rules for petitioning the Board of Directors can be found in the *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council* and in Section 1.7 of the *Regs.*
- **X. For More Information.** The program for the NFPA Technical Meeting (as well as the NFPA website as information becomes available) should be consulted for the date on which each report scheduled for consideration at the meeting will be presented. To view the First Draft Report and Second Draft Report as well as information on NFPA rules and for up-to-date information on schedules and deadlines for processing NFPA documents, check the NFPA website (www.nfpa.org/docinfo) or contact NFPA Codes & Standards Administration at (617) 984-7246.

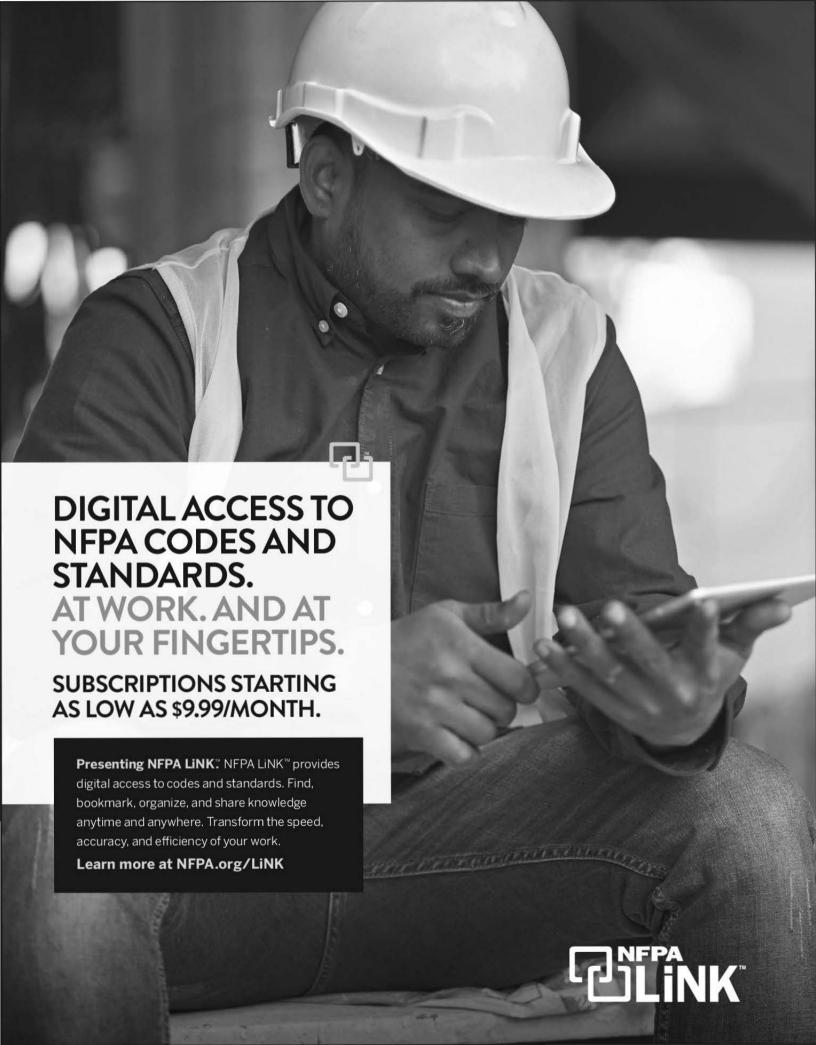



مدرس ، طراح و مشاور سیستم های (آتش نشانی ، تهویه ، اگزاست و فشار مثبت)

دارای صلاحیت سازمان آتش نشانی


اخذ تاییده از سازمان آتش نشانی



اولین هند بوک سیستم اطفاء حریق و مدیریت دود در ایران



Handbook of Smoke Control Engineering





طراحی سیستم های اگزاست و تهویه پارکینگ ، فشار مثبت راه پله - آسانسور وآتریوم ها











نرم افزار انتخاب فن، دمپرهای دود و آتش Sodeca Quick Fan & RF Damper





برای دریافت اطلاعات بیشتر کد روبرو را اسکن کنید



www.fire-gas.com



Aparat/fire-gas.com



02634411758



00989123280127

البرز گوهردشت خ۱۲ شرقی پ۸ ط اول واحد ۲





instagram/firegascom



as



